
**User's
Manual**

**AXF
Magnetic Flowmeter
Integral Flowmeter/
Remote Flowtube
[Hardware Edition]**

ADMAG AXF™

IM 01E20D01-01E

vigilantplant.®

Contents

| | |
|---|------------|
| 1. INTRODUCTION | 1-1 |
| 1.1 Using the Magnetic Flowmeter Safely | 1-2 |
| 1.2 Warranty | 1-3 |
| 1.3 Combination Remote Converters | 1-3 |
| 1.4 ATEX Documentation | 1-4 |
| 2. HANDLING PRECAUTIONS | 2-1 |
| 2.1 Checking Model and Specifications | 2-1 |
| 2.2 Accessories | 2-1 |
| 2.3 Storage Precautions | 2-2 |
| 2.4 Installation Location Precautions | 2-2 |
| 3. INSTALLATION | 3-1 |
| 3.1 Piping Design Precautions | 3-1 |
| 3.2 Handling Precautions | 3-3 |
| 3.2.1 General Precautions | 3-3 |
| 3.2.2 Flowmeter Piping | 3-4 |
| 3.3 Mounting Procedures | 3-4 |
| 3.3.1 Nominal Diameter 2.5 mm (0.1 in.) to 10 mm (0.4 in.), Union Joint Type | 3-4 |
| 3.3.2 Nominal Diameter 2.5 mm (0.1 in.) to 40 mm (1.5 in.), Wafer Type | 3-6 |
| 3.3.3 Nominal Diameter 50 mm (2.0 in.) to 300 mm (12.0 in.), Wafer Type | 3-10 |
| 3.3.4 Nominal Diameter 2.5 mm (0.1 in.) to 400 mm (16 in.), Flange Type | 3-15 |
| 3.3.5 Nominal Diameter 500 mm (20 in.) to 2600 mm (104 in.), Flange Type | 3-19 |
| 3.3.6 Sanitary Type | 3-22 |
| 4. WIRING | 4-1 |
| 4.1 Wiring the Integral Flowmeter | 4-1 |
| 4.1.1 Wiring Precautions | 4-1 |
| 4.1.2 Power Cable/Output Cable | 4-1 |
| 4.1.3 Wiring Ports | 4-2 |
| 4.1.4 Wiring Connections | 4-3 |
| 4.2 Wiring the Remote Flowtube | 4-8 |
| 4.2.1 Wiring Precautions | 4-8 |
| 4.2.2 Cables | 4-9 |
| 4.2.3 Wiring Ports | 4-10 |
| 4.2.4 Wiring Connections | 4-11 |

| | | |
|---|--|----------------|
| 5. | MAINTENANCE | 5-1 |
| 5.1 | Changing Direction of Electrical Connection | 5-1 |
| 5.2 | Removing, Cleaning, and Installing Replaceable Electrodes (General-Purpose Use Type Only) | 5-2 |
| 5.2.1 | Removing Replaceable Electrodes | 5-2 |
| 5.2.2 | Cleaning Replaceable Electrodes | 5-3 |
| 5.2.3 | Installing Replaceable Electrodes | 5-4 |
| 5.3 | Removing and Installing Adapters for Sanitary Types | 5-5 |
| 5.4 | Maintenance for Converter (Integral Flowmeter Only) | 5-7 |
| 5.4.1 | Fuse Replacement | 5-7 |
| 5.4.2 | Changing the Direction of the Display Unit | 5-7 |
| 5.5 | Setting of Switches (Integral Flowmeter Only) | 5-8 |
| 5.5.1 | Setting of Burnout Switch | 5-8 |
| 5.5.2 | Setting of Write Protect Switch | 5-9 |
| 5.6 | Regular Inspection Items | 5-9 |
| 5.7 | Excitation Coil and Insulation Resistance Check (Remote Flowtube Only) .. | 5-9 |
| 5.8 | Troubleshooting | 5-11 |
| 5.8.1 | No Indication | 5-11 |
| 5.8.2 | Unstable Zero | 5-12 |
| 5.8.3 | Disagreement Between Indication and Actual Flow | 5-13 |
| 6. | OUTLINE | 6-1 |
| 7. | PED (PRESSURE EQUIPMENT DIRECTIVE) | 7-1 |
| 8. | EXPLOSION PROTECTED TYPE INSTRUMENT | 8-1 |
| 8.1 | ATEX | 8-1 |
| 8.2 | FM | 8-4 |
| 8.3 | CSA | 8-5 |
| 8.4 | IECEX | 8-7 |
| 8.5 | TIIS | 8-8 |
| INSTALLATION AND OPERATING PRECAUTIONS FOR TIIS FLAMEPROOF EQUIPMENT | | EX-B03E |
| 1. | General | 1 |
| 2. | Electrical Apparatus of Flameproof Type of Explosion-Protected Construction | 1 |
| 3. | Terminology | 1 |
| 4. | Installation of Flameproof Apparatus | 2 |
| 5. | External Wiring for Flameproof Apparatus | 2 |
| 6. | Maintenance of Flameproof Apparatus | 3 |
| 7. | Selection of Cable Entry Devices for Flameproof Type | 3 |
| REVISION RECORD | | 1 |

1. INTRODUCTION

This instrument has been adjusted at the factory before shipment.

To ensure correct use of the instrument, please read this manual thoroughly and fully understand how to operate the instrument before operating it.



NOTE

This manual describes the hardware configuration of integral flowmeter and remote flowtube of the AXF magnetic flowmeters.

For details of the “basic operating procedures”, “parameter description”, “operation via BRAIN terminal (BT200)”, “operation via HART communicator”, and “actual operation” for the AXF integral flowmeter, see the user’s manual of the AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

For FOUNDATION Fieldbus protocol (Converter Output Signal and Communication suffix code; -F), please refer to IM 01E20F02-01E.

For PROFIBUS PA protocol (Converter Output Signal and Communication suffix code; -G), please refer to IM 01E20F12-01E.

■ Regarding This User’s Manual

- This manual should be provided to the end user.
- Before use, read this manual thoroughly to comprehend its contents.
- The contents of this manual may be changed without prior notice.
- All rights are reserved. No part of this manual may be reproduced in any form without Yokogawa’s written permission.
- Yokogawa makes no warranty of any kind with regard to this material, including, but not limited to, implied warranties of merchantability and suitability for a particular purpose.
- All reasonable effort has been made to ensure the accuracy of the contents of this manual. However, if any errors or omissions are found, please inform Yokogawa.
- Yokogawa assumes no responsibilities for this product except as stated in the warranty.
- Please note that this user’s manual may not be revised for any specification changes, construction changes or operating part changes that are not considered to affect function or performance.

- If the customer or any third party is harmed by the use of this product, Yokogawa assumes no responsibility for any such harm owing to any defects in the product which were not predictable, or for any indirect damages.



NOTE

For details of the AXFA11G magnetic flowmeter converter, see the IM01E20C01-01E instruction manual. For details on the AXFA14G/C magnetic flowmeter converter, see the IM01E20C02-01E instruction manual.

■ Safety and Modification Precautions

- The following general safety precautions must be observed during all phases of operation, service, and repair of this instrument. Failure to comply with these precautions or with specific WARNINGS given elsewhere in this manual violates safety standards of design, manufacture, and intended use of the instrument. Yokogawa assumes no liability for the customer’s failure to comply with these requirements. If this instrument is used in a manner not specified in this manual, the protection provided by this instrument may be impaired.
- Yokogawa will not be liable for malfunctions or damage resulting from any modification made to this instrument by the customer.
- The following safety symbol marks are used in this user’s manual and instrument.



WARNING

A WARNING sign denotes a hazard. It calls attention to procedure, practice, condition or the like, which, if not correctly performed or adhered to, could result in injury or death of personnel.



CAUTION

A CAUTION sign denotes a hazard. It calls attention to procedure, practice, condition or the like, which, if not correctly performed or adhered to, could result in damage to or destruction of part or all of the product.

**IMPORTANT**

An **IMPORTANT** sign denotes that attention is required to avoid damage to the instrument or system failure.

**NOTE**

A **NOTE** sign denotes information necessary for essential understanding of operation and features.



Protective grounding terminal



Functional grounding terminal

(This terminal should not be used as a protective grounding terminal.)



Alternating current



Direct current


1.1 Using the Magnetic Flowmeter Safely

**WARNING**

(1) Installation

- Installation of the magnetic flowmeter must be performed by expert engineer or skilled personnel. No operator shall be permitted to perform procedures relating to installation.
- The magnetic flowmeter is a heavy instrument. Be careful that no damage is caused to personnel through accidentally dropping it, or by exerting excessive force on the magnetic flowmeter. When moving the magnetic flowmeter, always use a trolley and have at least two people carry it.
- When the magnetic flowmeter is processing hot fluids, the instrument itself may become extremely hot. Take sufficient care not to get burnt.
- Where the fluid being processed is a toxic substance, avoid contact with the fluid and avoid inhaling any residual gas, even after the instrument has been taken off the piping line for maintenance and so forth.
- Do not apply excessive weight, for example, a person stepping on the magnetic flowmeter.
- All procedures relating to installation must comply with the electrical code of the country where it is used.

(2) Wiring

- The wiring of the magnetic flowmeter must be performed by expert engineer or skilled personnel. No operator shall be permitted to perform procedures relating to wiring.
- When connecting the wiring, check that the supply voltage is within the range of the voltage specified for this instrument before connecting the power cable. In addition, check that no voltage is applied to the power cable before connecting the wiring.
- The protective grounding must be connected securely at the terminal with the  mark to avoid danger to personnel.

(3) Operation

- When opening the cover, wait for more than 10 minutes after turning off the power. Only expert engineer or skilled personnel are permitted to open the cover.
- Be sure to set parameters as "Protect" on the write protect function after finish of parameter setting work.

Under extremely rare case, the infra-red switches may respond unexpectedly in such conditions as sticking ball of water or extraneous substances on the surface of display panel glass according to the principle of infra-red switch operation.

Its probability rises in such cases as sticking rain water by storm or other similar situation and washing up work near flowmeter installation place.

Either to illuminate or stop illuminating the infra-red switches by the flashlight may cause the mis-reaction.

Refer to Chapter 6 "Menu P: Parameter Protection Items" and section "10.2.2" in the manual IM 01E20C02-01E how to use the write protect function in detail.

(4) Maintenance

- Maintenance of the magnetic flowmeter should be performed by the trained personnel having knowledge of safety standard. No operator shall be permitted to perform any operations relating to maintenance.
- When opening the cover, wait for more than 10 minutes after turning off the power.
- Always conform to maintenance procedures outlined in this manual. If necessary, contact Yokogawa.


- Care should be taken to prevent the build up of dirt, dust or other substances on the display panel glass or data plate. If these surfaces do get dirty, wipe them clean with a soft dry cloth.

(5) Explosion Protected Type Instrument

- Magnetic flowmeters with the model name AXF□□□C are products which have been certified as explosion proof type instruments. Strict limitations are applied to the structures, installation locations, external wiring work, maintenance and repairs, etc. of these instruments. Sufficient care must be taken, as any violation of the limitations may cause dangerous situations.

Be sure to read Chapter 8 “EXPLOSION PROTECTED TYPE INSTRUMENT” before handling the instruments. The description in Chapter 8 is prior to the other description in this user’s manual.

For TIIS flameproof type instruments, be sure to read “INSTALLATION AND OPERATING PRECAUTIONS FOR TIIS FLAMEPROOF EQUIPMENT” at the end of this manual.

- Only trained persons use this instrument in the industrial location.
 - The protective grounding  must be connected to a suitable IS grounding system.
 - Take care not to generate mechanical spark when access to the instrument and peripheral devices in hazardous locations.
- #### (6) European Pressure Equipment Directive (PED)
- When using the instrument in compliance with PED, be sure to read Chapter 7 before use.

1.2 Warranty

- The terms of this instrument that are guaranteed are described in the quotation. We will make any repairs that may become necessary during the guaranteed term free of charge.
- Please contact our sales office if this instrument requires repair.
- If the instrument is faulty, contact us with concrete details about the problem and the length of time it has been faulty, and state the model and serial number. We would appreciate the inclusion of drawings or additional information.
- The results of our examination will determine whether the meter will be repaired free of charge or on an at-cost basis.

■ The guarantee will not apply in the following cases:

- Damage due to negligence or insufficient maintenance on the part of the customer.
- Problems or damage resulting from handling, operation or storage that violates the intended use and specifications.
- Problems that result from using or performing maintenance on the instrument in a location that does not comply with the installation location specified by Yokogawa.
- Problems or damage resulting from repairs or modifications not performed by Yokogawa or someone authorized by Yokogawa.
- Problems or damage resulting from inappropriate reinstallation after delivery.
- Problems or damage resulting from disasters such as fires, earthquakes, storms, floods, or lightning strikes and external causes.

■ Trademarks:

ADMAG, AXF and ADMAG AXF are registered trademarks of Yokogawa Electric Corporation. Company names and product names used in this material are registered trademarks or trademarks of their respective owners.

1.3 Combination Remote Converters



IMPORTANT

- The AXF remote flowtube (size 2.5 (0.1 in.) to 400 mm (16 in.)) should be used in combination with one of the following converters:
 - AXFA11 remote converter
 - AXFA14 remote converter

Contact Yokogawa before using it in combination with converters other than those listed above.

- The AXF remote flowtube (size 500 (20 in.) to 2600 mm (104 in.)) should be used in combination with AXFA11 remote converter. Contact Yokogawa before using it in combination with converters other than AXFA11.
- In case of TIIS Flameproof type, a remote flowtube is available for combined use with the AXFA14 remote converter only.
- If the converter combined with the AXF magnetic flowmeter’s remote flowtube is changed from the AXFA11 to AXFA14 or vice versa, the meter factor of the remote flowtube must be readjusted according to its flow calibration.

1.4 ATEX Documentation

This procedure is only applicable to the countries in European Union.

GB

All instruction manuals for ATEX Ex related products are available in English, German and French. Should you require Ex related instructions in your local language, you are to contact your nearest Yokogawa office or representative.

DK

Alle brugervejledninger for produkter relateret til ATEX Ex er tilgængelige på engelsk, tysk og fransk. Skulle De ønske yderligere oplysninger om håndtering af Ex produkter på eget sprog, kan De rette henvendelse herom til den nærmeste Yokogawa afdeling eller forhandler.

I

Tutti i manuali operativi di prodotti ATEX contrassegnati con Ex sono disponibili in inglese, tedesco e francese. Se si desidera ricevere i manuali operativi di prodotti Ex in lingua locale, mettersi in contatto con l'ufficio Yokogawa più vicino o con un rappresentante.

E

Todos los manuales de instrucciones para los productos antiexplosivos de ATEX están disponibles en inglés, alemán y francés. Si desea solicitar las instrucciones de estos artículos antiexplosivos en su idioma local, deberá ponerse en contacto con la oficina o el representante de Yokogawa más cercano.

NL

Alle handleidingen voor producten die te maken hebben met ATEX explosiebeveiliging (Ex) zijn verkrijgbaar in het Engels, Duits en Frans. Neem, indien u aanwijzingen op het gebied van explosiebeveiliging nodig hebt in uw eigen taal, contact op met de dichtstbijzijnde vestiging van Yokogawa of met een vertegenwoordiger.

SF

Kaikkien ATEX Ex -tyyppisten tuotteiden käyttöohjeet ovat saatavilla englannin-, saksan- ja ranskankielisinä. Mikäli tarvitsette Ex -tyyppisten tuotteiden ohjeita omalla paikallisella kielellänne, ottakaa yhteyttä lähimpään Yokogawa-toimistoon tai -edustajaan.

P

Todos os manuais de instruções referentes aos produtos Ex da ATEX estão disponíveis em Inglês, Alemão e Francês. Se necessitar de instruções na sua língua relacionadas com produtos Ex, deverá entrar em contacto com a delegação mais próxima ou com um representante da Yokogawa.

F

Tous les manuels d'instruction des produits ATEX Ex sont disponibles en langue anglaise, allemande et française. Si vous nécessitez des instructions relatives aux produits Ex dans votre langue, veuillez bien contacter votre représentant Yokogawa le plus proche.

D

Alle Betriebsanleitungen für ATEX Ex bezogene Produkte stehen in den Sprachen Englisch, Deutsch und Französisch zur Verfügung. Sollten Sie die Betriebsanleitungen für Ex-Produkte in Ihrer Landessprache benötigen, setzen Sie sich bitte mit Ihrem örtlichen Yokogawa-Vertreter in Verbindung.

S

Alla instruktionsböcker för ATEX Ex (explosionssäkra) produkter är tillgängliga på engelska, tyska och franska. Om Ni behöver instruktioner för dessa explosionssäkra produkter på annat språk, skall Ni kontakta närmaste Yokogawakontor eller representant.

GR

Όλα τα εγχειρίδια λειτουργίας των προϊόντων με ATEX Ex διατίθενται στα Αγγλικά, Γερμανικά και Γαλλικά. Σε περίπτωση που χρειάζεστε οδηγίες σχετικά με Ex στην τοπική γλώσσα παρακαλούμε επικοινωνήστε με το πλησιέστερο γραφείο της Yokogawa ή αντιπρόσωπο της.

SK

Všetky návody na obsluhu pre prístroje s ATEX Ex sú k dispozícii v jazyku anglickom, nemeckom a francúzskom. V prípade potreby návodu pre Ex-prístroje vo Vašom národnom jazyku, skontaktujte prosím miestnu kanceláriu firmy Yokogawa.

CZ

Všechny uživatelské příručky pro výrobky, na něž se vztahuje nevybušné schválení ATEX Ex, jsou dostupné v angličtině, němčině a francouzštině. Požadujete-li pokyny týkající se výrobků s nevybušným schválením ve vašem lokálním jazyku, kontaktujte prosím vaši nejbližší reprezentační kancelář Yokogawa.

LT

Visos gaminiø ATEX Ex kategorijos Eksploatavimo instrukcijos teikiami anglø, vokieèiø ir prancûzø kalbomis. Norëdami gauti prietaisø Ex dokumentacijà kitomis kalbomis susisiekiite su artimiausiu bendrovës “Yokogawa” biuru arba atstovu.

LV

Visas ATEX Ex kategorijas izstrādājumu Lietošanas instrukcijas tiek piegādātas angļu, vācu un franču valodās. Ja vēlaties saņemt Ex ierīšu dokumentāciju citā valodā, Jums ir jāsazinās ar firmas Jokogava (Yokogawa) tuvāko ofisu vai pārstāvi.

EST

Kõik ATEX Ex toodete kasutamishendid on esitatud inglise, saksa ja prantsuse keeles. Ex seadmete muukeelse dokumentatsiooni saamiseks pöörduge lähima Iokagava (Yokogawa) kontori või esindaja poole.

PL

Wszystkie instrukcje obsługi dla urządzeń w wykonaniu przeciwwybuchowym Ex, zgodnych z wymaganiami ATEX, dostępne są w języku angielskim, niemieckim i francuskim. Jeżeli wymagana jest instrukcja obsługi w Państwa lokalnym języku, prosimy o kontakt z najbliższym biurem Yokogawy.

SLO

Vsi predpisi in navodila za ATEX Ex sorodni izdelki so pri roki v angleščini, nemščini ter francoščini. Če so Ex sorodna navodila potrebna v vašem tujejnem jeziku, kontaktirajte vaš najbližji Yokogawa office ili predstavnika.

H

Az ATEX Ex műszerek gépkönyveit angol, német és francia nyelven adjuk ki. Amennyiben helyi nyelven kérlek az Ex eszközök leírásait, kérjük keressék fel a legközelebbi Yokogawa irodát, vagy képviselőt.

BG

Всички упътвания за продукти от серията ATEX Ex се предлагат на английски, немски и френски език. Ако се нуждаете от упътвания за продукти от серията Ex на родния ви език, се свържете с най-близкия офис или представителство на фирма Yokogawa.

RO

Toate manualele de instructiuni pentru produsele ATEX Ex sunt in limba engleza, germana si franceza. In cazul in care doriti instructiunile in limba locala, trebuie sa contactati cel mai apropiat birou sau reprezentant Yokogawa.

M

Il-manwali kollha ta' l-istruzzjonijiet għal prodotti marbuta ma' ATEX Ex huma disponibbli bl-Ingliż, bil-Ġermaniż u bil-Franċiż. Jekk tkun teħtieġ struzzjonijiet marbuta ma' Ex fil-lingwa lokali tiegħek, għandek tikkuntattja lill-eqreb rappreżentant jew ufficiju ta' Yokogawa.

2. HANDLING PRECAUTIONS

This instrument has been inspected carefully at the factory before shipment. When the instrument is delivered, visually check that no damage has occurred during transportation.

Read this section carefully as it contains important information on handling this instrument. Refer to the relevant sections for information not contained in this section. If you have any problems or questions, please contact Yokogawa sales office.

2.1 Checking Model and Specifications

The model code and specifications are found on the data plate located on the outside of the case. Check that the model code and specifications match what you have ordered.

Be sure you have your model number and serial number available when contacting Yokogawa.




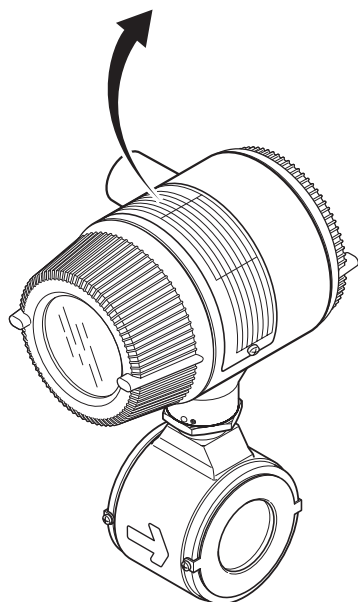


Figure 2.1.1 Data Plate (Integral Flowmeter Type)

*1) In case of the sizes of 2.5 to 25mm (0.1 to 1.0 in.), "0038" is not described.

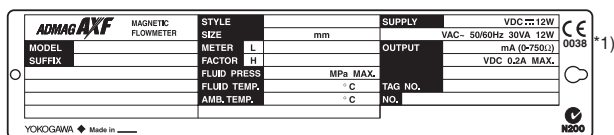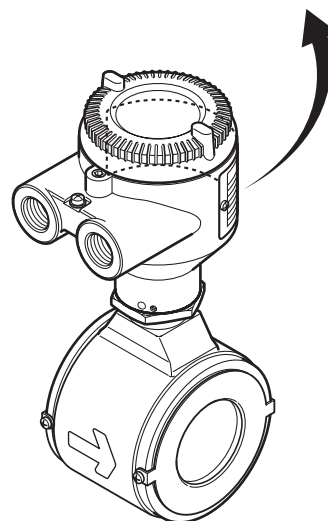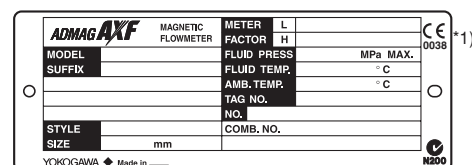

F0202.EPS

Figure 2.1.2 Data Plate (Remote Flowtube Type)

*1) In case of the sizes of 2.5 to 25mm (0.1 to 1.0 in.), "0038" is not described.

In case of the sizes of 500 to 2600mm (20 to 104 in.), CE marking and "0038" are not described.

2.2 Accessories

Check that the parts shown below are included in the package:

- Remote Flowtube(size 2.5 to 1000 mm(0.1 to 40 in.)):
 - Centering device (wafer type only): 1 pc.
 - Hexagonal wrench: 2 pcs. (one each of 1.5 mm and 3 mm nominal sizes)
- Integral Flowmeter:
 - Centering device (wafer type only): 1 pc.
 - Hexagonal wrench: 2 pcs. (one each of 1.5 mm and 3 mm nominal sizes)

2.3 Storage Precautions

If the instrument is to be stored for a long period of time after delivery, observe the following points.

- The instrument should be stored in its original packing condition in the storage location.
- Select a storage location that fulfils the following conditions:
 - A place where it will not be exposed to rain or water
 - A place subject to minimal vibrations or shocks
 - Temperature and humidity levels should be as follows:

Temperature: -30 to 70°C

Humidity: 5 to 80% RH (no condensation)

The preferred ambient temperature and humidity levels are 25°C and approximately 65% RH.
- If the AXF magnetic flowmeter is transferred to the installation site and stored without being installed, its performance may be impaired due to the infiltration of rainwater and so forth. Be sure to install and wire the AXF magnetic flowmeter as soon as possible after transferring it to the installation location.

2.4 Installation Location Precautions

Select the installation location with consideration to the following items to ensure long-term stable operation of the instrument.

■ Ambient Temperature:

Avoid installing the instrument in locations with constantly fluctuating temperatures. If the location is subject to radiant heat from the plant, provide heat insulation or improve ventilation.

■ Atmospheric Condition:

Avoid installing the instrument in a corrosive atmosphere. In situations where this is unavoidable, consider ways to improve ventilation and to prevent rainwater from entering and being retained in the conduit pipes.

■ Vibrations or Shocks:

Avoid installing the instrument in a place subject to shocks or vibrations.

■ Explosion protected type:

Explosion protect types can be installed in hazardous areas according to the types of gases for which they are certified. See the description in Chapter 8 “EXPLOSION PROTECTED TYPE INSTRUMENT” and “INSTALLATION AND OPERATING PRECAUTIONS FOR THIS FLAMEPROOF EQUIPMENT” in this user's manual.

3. INSTALLATION

3.1 Piping Design Precautions



WARNING

Installation of the magnetic flowmeter must be performed by expert engineer or skilled personnel. No operator shall be permitted to perform procedures relating to installation.



IMPORTANT

Design piping correctly, referring to the following to prevent damage to flowtubes and to assure accurate measuring.



NOTE

This chapter describes the remote flowtube as an example. The same attention must be paid to the integral flowmeter.

(1) Location



IMPORTANT

Install the flowmeter in a location where it is not exposed to direct sunlight. The minimum ambient temperature is limited by the minimum fluid temperature of the flowtube (the lining). For more information, refer to Chapter 6 "OUTLINE". The flowmeter may be used in an ambient humidity where the relative humidity ranges from 0 to 100%. However, avoid long-term continuous operation at relative humidity above 95%.

(2) Noise Avoidance



IMPORTANT

The flowmeter should be installed away from electrical motors, transformers, and other power sources in order to avoid interference with measurement.

(3) Required Lengths of Straight Runs

To maintain accurate measurement, see JIS B7554 "Electro Magnetic Flowmeters" which explains the requirements for upstream piping conditions of magnetic flowmeters.

Based on JIS B7554 "Electromagnetic Flowmeters" and our piping condition test data, we recommend the piping conditions as shown in the following figures.

When installing two or more magnetic flowmeters on a single pipe, provide a run of at least 5D between them.

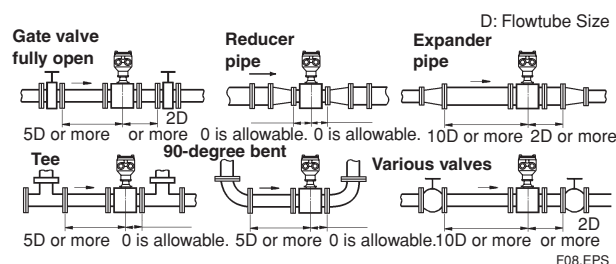


Figure 3.1.1 Required Lengths of Straight Runs

- *1: Do not install anything in the vicinity that may interfere with the magnetic field, induced signal voltages, or flow velocity distributions of the flowmeter.
- *2: A straight run may not be required on the downstream side of the flowmeter. However, if a downstream valve or other fitting causes irregularity or deviation in flows, provide a straight run of 2D to 3D on the downstream side.
- *3: The valves shall be mounted on the downstream side so that deviated flows do not occur in the flowtube and to avoid startup from an empty condition.

(4) Maintaining Stable Fluid Conductivity



IMPORTANT

Do not install the flowmeter where fluid conductivity tends to become uneven. If chemicals are fed near the upstream side of a magnetic flowmeter, they may affect the flow rate's indications. To avoid this situation, it is recommended that the chemical feed ports be located on the downstream side of the flowmeter. If it is unavoidable that chemicals must be fed on the upstream side, provide a sufficient length of straight run (approximately 50D) to ensure the proper mixture of fluids.

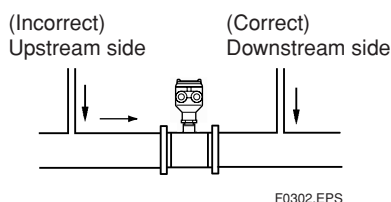


Figure 3.1.2 Chemical Injection

(5) Precautions for Use of Liquid Sealing Compounds



IMPORTANT

Care must be taken in using liquid sealing compounds on the piping, as it may have a negative influence on the flow indications by flowing out and covering the surfaces of an electrode or grounding ring. In particular, care must be taken if a liquid sealing compound is used in the case of vertical piping.

(6) Service Area

Select locations where there is adequate space to service installing, wiring, overhauling, etc.

(7) Bypass Line

It is recommended to install a bypass line to facilitate maintenance and zero adjustment.

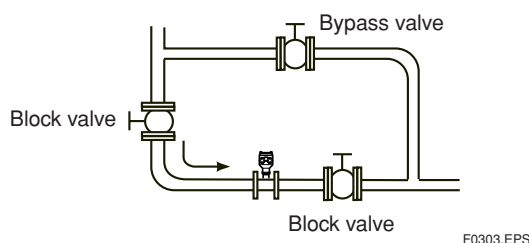


Figure 3.1.3 Bypass Line

(8) Supporting the Flowmeter



CAUTION

Do not secure the flowmeter separately to prevent the vibrations, shocks, and expansion and contraction forces of the piping from affecting it. Fix the pipes first, then support the flowmeter with the pipes. With extra small-sized flowmeters (2.5-10 mm), in particular, fix the flowmeter in parallel with the piping on a mounting base.

(9) Mounting Positions

- Pipes must be fully filled with liquids.



IMPORTANT

It is essential that pipes remain fully filled at all times, otherwise flow rate indications may be affected and measurement errors may be caused.

Piping shall be designed so as to maintain the interior of the flowtube filled with fluids.

Vertical mounting is effective in such cases as when fluids tend to separate or solid matter may be precipitated. When employing vertical mounting, direct the fluids from the bottom to the top to ensure that the pipes remain fully filled.

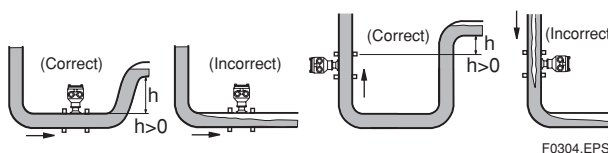


Figure 3.1.4 Mounting Positions

- Avoid air bubbles.



IMPORTANT

If air bubbles enter a measurement pipe, flow rate indications may be affected and measurement errors may be caused.

In cases where fluids contain air bubbles, piping must be designed to prevent them from accumulating in the measurement pipe of a flowtube.

If a valve exists near the flowmeter, try to mount the flowmeter on the valve's upstream side in order to prevent a possible reduction of pressure inside the pipe, thereby avoiding the possibility of air bubbles.

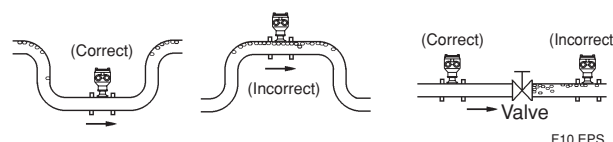


Figure 3.1.5 Avoiding Air Bubbles

• Mounting orientation



IMPORTANT

If electrodes are perpendicular to the ground, air bubbles near the top or precipitates at the bottom may cause measurement errors. Ensure that the terminal box of a remote flowtube and converter of an integral flowmeter are mounted above the piping to prevent water from entering them.

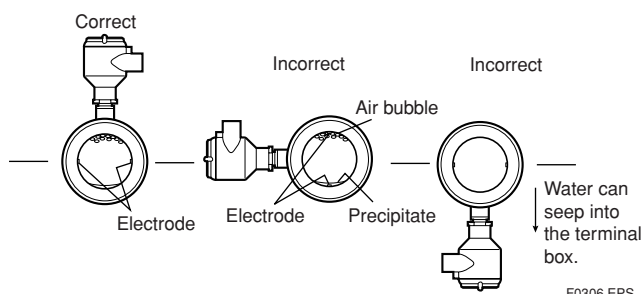


Figure 3.1.6 Mounting Orientation

3.2 Handling Precautions



WARNING

The magnetic flowmeter is a heavy instrument. Be careful that no damage is caused to personnel through accidentally dropping it, or by exerting excessive force on the magnetic flowmeter. When moving the magnetic flowmeter, always use a trolley and have at least two people carry it.



NOTE

This chapter describes the remote flowtube as an example. The same attention must be paid to the integral flowmeter.

3.2.1 General Precautions


(1) Precaution during Transportation

The magnetic flowmeter is packed tightly. When it is unpacked, pay attention to prevent damaging the flowmeter. To prevent accidents while it is being transported to the installing location, transport it to the site in its original packing.



CAUTION

In order to lift a magnetic flowmeter that is fitted with eyebolts, proceed as in Figure 3.2.1. Never lift it using a bar passed through the flowtube as this damages the liner severely.

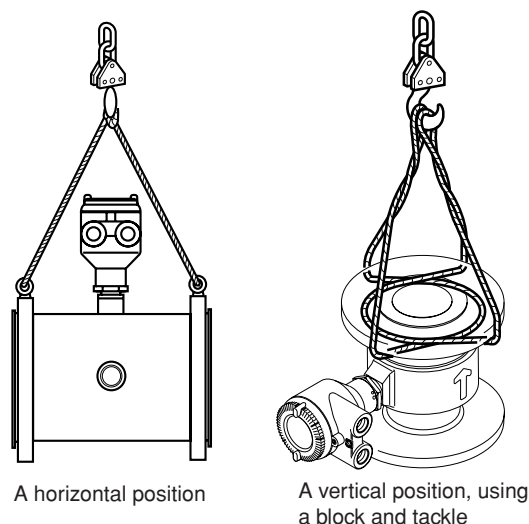

F0307.EPS

Figure 3.2.1 Lifting Flowmeter

(2) Avoid Shocks from Impact



CAUTION

Care should be taken not to drop the flowmeter or expose it to excessive shock. In particular, be careful not to subject the flange surface to shock. This may lead to liner damage which will result in inaccurate readings.

(3) Flange Protection Covers



IMPORTANT

Keep the protective covering (i.e. the corrugated cardboard or other cushioning material) in place over the flange except when mounting the flowmeter to the pipe.

(4) Terminal Box Cover**IMPORTANT**

As it is possible that the insulation will deteriorate, do not open the terminal box cover until it is time to wire it.

(5) Long-term Non-use**IMPORTANT**

It is not desirable to leave the flowmeter unused for a long term after installation. If this situation is unavoidable, take care of the flowmeter by observing the following.

- **Confirmation of sealing conditions for the flowmeter**

Confirm that the terminal box screw and wiring ports are well sealed. Equip the conduit piping with drain plugs or waterproof glands to prevent moisture or water from penetrating into the flowmeter through the conduit.

- **Regular inspections**

Inspect the sealing conditions as mentioned above, and the inside of the terminal box at least once a year. Also, due to rain, etc. when it is suspected that water may have penetrated into the inside flowmeter perform supplementary inspections.

3.2.2 Flowmeter Piping**CAUTION**

Misaligned or slanted piping can lead to leakage and damage to the flanges.

- (1) Correct any misaligned or slanted piping, and any gaps that may exist between mounting flanges before installing the flowmeter (refer to Figure 3.2.2).

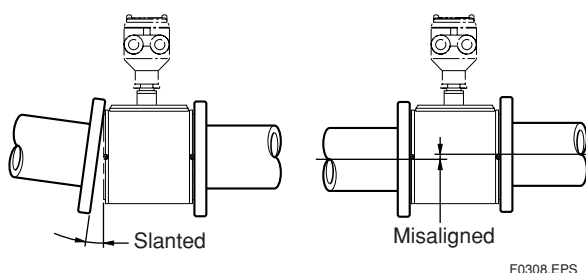


Figure 3.2.2 Slanted and Misaligned Flowmeter Piping

- (2) Inside a newly installed pipeline, there may be some foreign substances such as residue from welding or wood chips. Remove them by flushing the piping before mounting the flowmeter. This prevents the lining from being damaged, as well as the occurrence of erroneous measured signals resulting from foreign substances passing through the flowtube during measurement.

3.3 Mounting Procedures**IMPORTANT**

Do not forget to insert gaskets from Yokogawa between pipes and flowmeter, which shall be supplied when the flowmeter has ceramics lining with no grounding rings.

In case of grounding rings to be supplied and attached later, these gaskets shall be inserted between grounding rings and flowmeter.

**NOTE**


- The tightening torque value to which gaskets must be tightened varies depending on the type and external dimensions of the lining and the gasket. In this section, the tables indicating tightening torque values include the corresponding gasket types. The internal diameters of the gaskets are close to those of the grounding rings.
- For fluids capable of potentially permeating PFA linings (such as nitric acid, hydrofluoric acid, or sodium hydrate at high temperatures), different tightening torque values must be applied. The tables of these torque values is indicated in this section.
- For replacement models for the earlier ADMAG or ADMAG AE, the tightening torque values in the tables can be applied if their process connections, the lining types, and the nominal sizes are the same.

3.3.1 Nominal Diameter 2.5 mm (0.1 in.) to 10 mm (0.4 in.), Union Joint Type

Ceramics linings with diameters of 2.5 (0.1), 5 (0.2), or 10 mm (0.4 in.) are connected using union joints. Weld or screw the connecting fittings in Table 3.3.1 onto the piping. The external dimensions of the fittings are shown in the table.

Table 3.3.1 Fitting Dimensions


Screw joint (process connection codes: GUR and GUN)

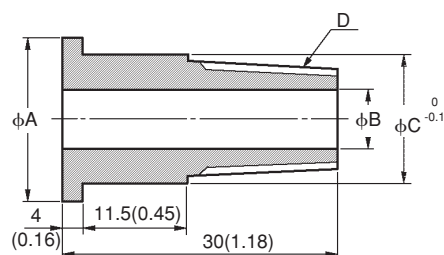

| Size mm(inch) | Code | A | B | C | D |
|------------------|------|--------------|--------------|----------------|-------------|
| 2.5 (0.1) | GUR | 22 (0.87) | 8 (0.31) | 18.5 (0.73) | R1/4(PT1/4) |
| | GUN | 22 (0.87) | 8 (0.31) | 18.5 (0.73) | NPT1/4 |
| 5 (0.2) | GUR | 22 (0.87) | 8 (0.31) | 18.5 (0.73) | R1/4(PT1/4) |
| | GUN | 22 (0.87) | 8 (0.31) | 18.5 (0.73) | NPT1/4 |
| 10 (0.4) | GUR | 25 (0.98) | 10 (0.39) | 22.5 (0.89) | R3/8(PT3/8) |
| | GUN | 25 (0.98) | 10 (0.39) | 22.5 (0.89) | NPT3/8 |

T0301.EPS

Weld joint (process connection code: GUW)

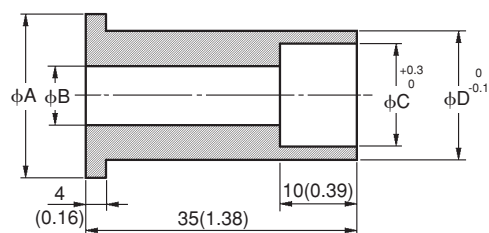

| Size mm(inch) | Code | A | B | C | D |
|------------------|------|----------|----------|------------|------------|
| 2.5 (0.1) | GUW | 22(0.87) | 8(0.31) | 14.3(0.56) | 18.5(0.73) |
| 5 (0.2) | GUW | 22(0.87) | 8(0.31) | 14.3(0.56) | 18.5(0.73) |
| 10 (0.4) | GUW | 25(0.98) | 10(0.39) | 17.8(0.70) | 22.5(0.89) |

T0302.EPS

(1) Mounting Direction

Mount the flowmeter so that the flow direction of the fluid to be measured is in line with the direction of the arrow mark on the flowmeter.



IMPORTANT

If it is impossible to match the direction of the arrow mark, the direction of the electrical connection can be changed. Refer to Section 5.1 to do this properly.

In case the fluid being measured flows against the arrow direction, refer to the parameter **J20: Flow Direction** in the user's manual of the AXFA11 Magnetic Flowmeter Remote Converter (IM 01E20C01-01E) or the AXFA14 Magnetic Flowmeter Remote Converter/AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

(2) Connecting Process Piping

Weld or screw the connection fittings to the process piping.



IMPORTANT

- Be sure to pass the connection fittings through the union joint nuts in advance.
- When welding the fittings, pay attention to the edge preparation, level differences between the fittings and the piping, and the welding current to avoid deforming the piping or causing stagnation portion of the fluid.

(3) Positioning the Flowmeter

Install the flowmeter on a mounting base and position it so that the center axis of the flowtube is aligned with that of the process piping. Then screw the union joint nuts to the connecting ports of the flowmeter.



CAUTION

Ceramics pipes may be damaged if the nuts are tightened when the center axes are not properly aligned.

(4) Tightening Nuts

Use a torque wrench to tighten the union joint nuts.



CAUTION

Tighten the union joint nuts according to the tightening torque values in Table 3.3.2. For permeable fluid (such as nitric acid, hydrofluoric acid or sodium hydrate at high temperature), tighten the nuts according to the torque values in Table 3.3.3.

As the gasket material is fluorocarbon PTFE, it is possible that the nuts may loosen as time passes. Retighten the nuts if this is the case. Be sure to use the gasket (thickness is 1.5 mm) which comes with the flowmeter.

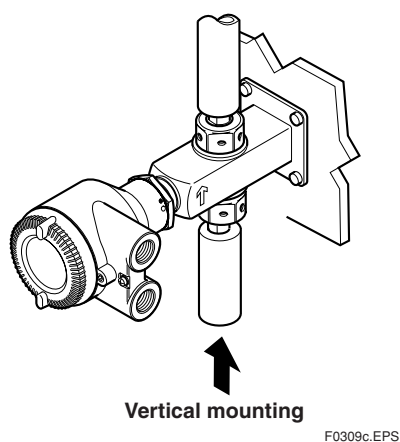
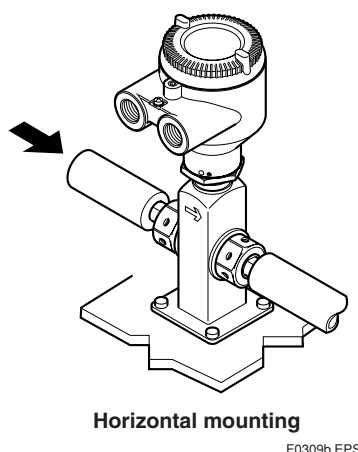
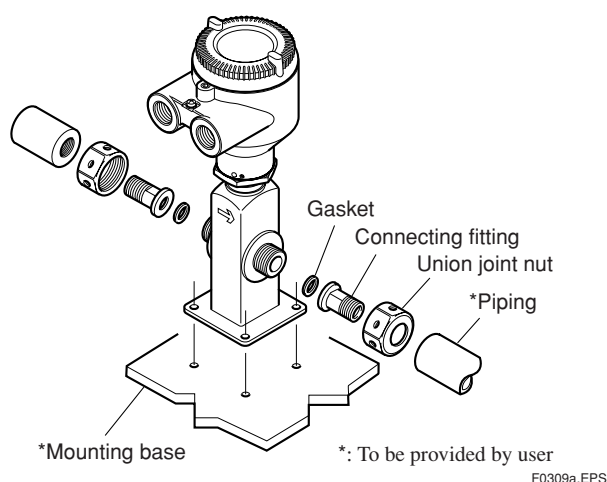


Figure 3.3.1 Mounting Procedure for Union Joint Type

Table 3.3.2 Tightening torque values for Union Joint Type

Apply these tightening torque values when the gaskets are Valqua #7020 (standard) or alkali-resistant gaskets for the metal piping (optional code GF).

| Size mm (inch) | Torque (N-m / {kgf-cm} / [in-lbf]) |
|----------------|--|
| 2.5 (0.1) | 9 to 12 / {91.77 to 122.4} / [79.66 to 106.2] |
| 5 (0.2) | 9 to 12 / {91.77 to 122.4} / [79.66 to 106.2] |
| 10 (0.4) | 14 to 18 / {142.8 to 183.5} / [123.9 to 159.3] |

T0303.EPS

Table 3.3.3 Tightening torque values for Union Joint Type and Permeable Fluids

| Size mm (inch) | Torque (N-m / {kgf-cm} / [in-lbf]) |
|----------------|--|
| 2.5 (0.1) | 11 to 15 / {112.2 to 153} / [97.36 to 132.8] |
| 5 (0.2) | 11 to 15 / {112.2 to 153} / [97.36 to 132.8] |
| 10 (0.4) | 17 to 23 / {173.4 to 234.5} / [150.5 to 203.6] |

T0304.EPS

3.3.2 Nominal Diameter 2.5 mm (0.1 in.) to 40 mm (1.5 in.), Wafer Type



IMPORTANT

Use bolts and nuts in compliance with the flange ratings. When stud-type through-bolts are used, be sure the outside diameter of the shank is smaller than that of the thread ridge. Be sure to choose a gasket with inner and outer diameters that does not protrude inside the piping (refer to Table 3.3.13). If the inner diameter of the gasket is too large, or outer diameter of the gasket is too small, fluid leakage may result.

(1) Mounting Direction

Mount the flowmeter so that the flow direction of the fluid to be measured is in line with the direction of the arrow mark on the flowmeter.



IMPORTANT

If it is impossible to match the direction of the arrow mark, the direction of the electrical connection can be changed. Refer to Section 5.1 to do this properly.

In case the fluid being measured flows against the arrow direction, refer to the parameter **J20: Flow Direction** in the user's manual of the AXFA11 Magnetic Flowmeter Remote Converter (IM 01E20C01-01E) or the AXFA14 Magnetic Flowmeter Remote Converter/AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

(2) Mounting Centering Devices

To maintain concentricity of the flowmeter with the pipes, install centering devices on the Mini-flanges of the flowmeter. Use the appropriate centering devices according to the nominal diameter and the flange ratings.

(3) Positioning the Flowmeter

Pass two through-bolts through the adjacent holes of both flanges and position the flowmeter so that the Mini-flanges and the centering devices come in close contact with each other. Pass the other through-bolts through the other holes (refer to Figures 3.3.2 and 3.3.3). In case stud-type through-bolts are used, position them in such a way that the centering devices come in contact with the bolt threads.

(4) Tightening Nuts

Tighten the nuts according to the torque values for metal piping in Table 3.3.4. For PVC piping, select an option code of /GA, /GC, or /GD, use rubber gaskets and tighten the nuts to the torque values for PVC piping in Table 3.3.5.

For permeable fluids (such as nitric acid, hydrofluoric acid, or sodium hydrate at high temperatures), tighten the nuts according to the torque values in Table 3.3.6.

**CAUTION**

For a flowmeter with fluorocarbon PFA lining, it is possible that the nuts may loosen as time passes, so tighten them regularly. Be sure to tighten the nuts according to the prescribed torque values. Tighten them diagonally with the same torque values, step by step up to the prescribed torque value.

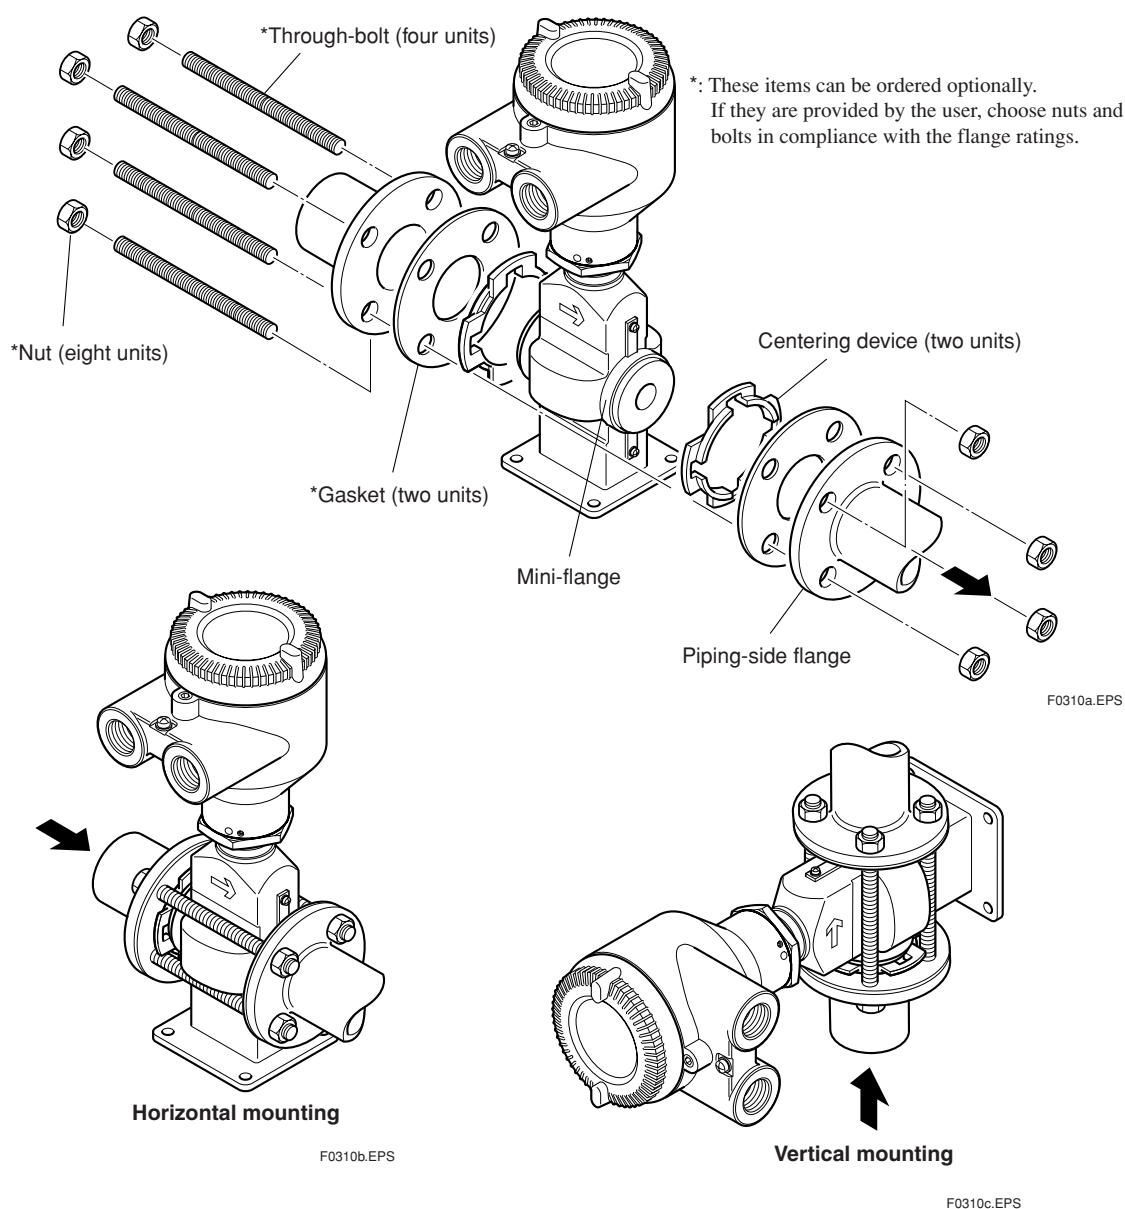


Figure 3.3.2 Mounting Procedure for Wafer Type (size: 2.5 (0.1) to 15 mm (0.5 in.))

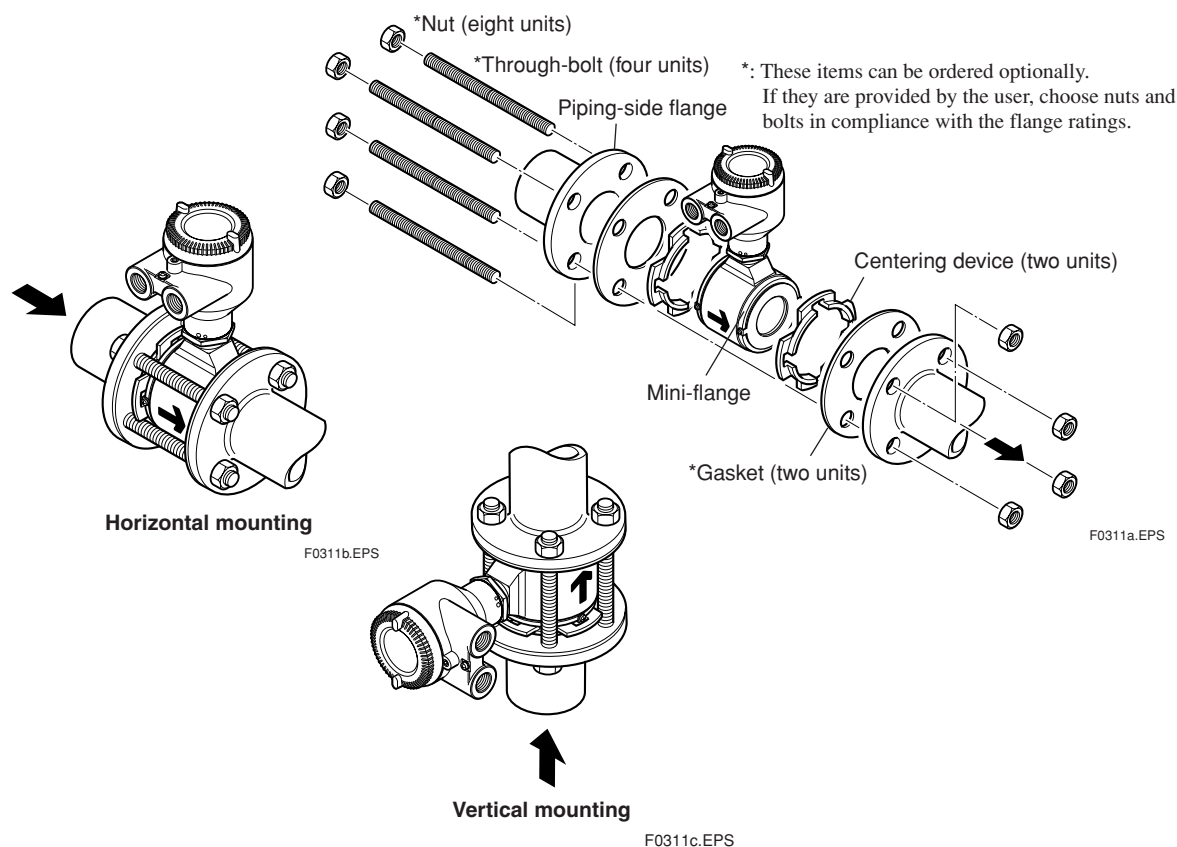


Figure 3.3.3 Mounting Procedure for Wafer Type (size: 25 (1.0), 32 (1.25), and 40 mm (1.5 in.))

Table 3.3.4 Wafer Type Tightening Torque Values for Metal Piping

| Tightening torque values for PFA/Polyurethane Rubber lining type (N-m / {kgf-cm} / [in-lbf]) | | | | |
|--|--|--|--|--|
| Gasket types within flowtube | No gasket (standard) | | | |
| Gasket types for user's flange | Non-asbestos fiber gasket, PTFE-sheathed non-asbestos gasket (optional codes BCF and BSF), or the equivalent in hardness | | | |
| Flange ratings Size mm (inch) | JIS 10K, ANSI Class 150, and DIN PN10 | JIS 20K, ANSI Class 300, and DIN PN16 | DIN PN40 | |
| 2.5 (0.1) | 7.2 to 8.4 / {73.42 to 85.66} / [63.72 to 74.35] | 7.3 to 8.4 / {74.44 to 85.66} / [64.61 to 74.35] | 7.6 to 8.4 / {77.5 to 85.66} / [67.26 to 74.35] | |
| 5 (0.2) | 7.2 to 8.4 / {73.42 to 85.66} / [63.72 to 74.35] | 7.3 to 8.4 / {74.44 to 85.66} / [64.61 to 74.35] | 7.6 to 8.4 / {77.5 to 85.66} / [67.26 to 74.35] | |
| 10 (0.4) | 7.2 to 8.4 / {73.42 to 85.66} / [63.72 to 74.35] | 7.3 to 8.4 / {74.44 to 85.66} / [64.61 to 74.35] | 7.6 to 8.4 / {77.5 to 85.66} / [67.26 to 74.35] | |
| 15 (0.5) | 7.2 to 8.4 / {73.42 to 85.66} / [63.72 to 74.35] | 7.3 to 8.4 / {74.44 to 85.66} / [64.61 to 74.35] | 7.6 to 8.4 / {77.5 to 85.66} / [67.26 to 74.35] | |
| 25 (1.0) | 23.5 to 27.3 / {239.6 to 278.4} / [208 to 241.6] | 23.7 to 27.3 / {241.7 to 278.4} / [209.8 to 241.6] | 22.3 to 27.3 / {227.4 to 278.4} / [197.4 to 241.6] | |
| 32 (1.25) | 26.2 to 30.5 / {267.2 to 311} / [231.9 to 269.9] | 26.6 to 30.5 / {271.2 to 311} / [235.4 to 269.9] | 28.0 to 30.5 / {285.5 to 311} / [247.8 to 269.9] | |
| 40 (1.5) | 36.2 to 42.4 / {369.1 to 432.4} / [320.4 to 375.3] | 36.9 to 42.4 / {376.3 to 432.4} / [326.6 to 375.3] | 39.1 to 42.4 / {398.7 to 432.4} / [346.1 to 375.3] | |

| Tightening torque values for Ceramics lining type (N-m / {kgf-cm} / [in-lbf]) | | | | |
|---|---|--|--|--|
| Gasket types within flowtube | Fluororesin with ceramic fillers (Valqua #7020) (standard) gasket, or fluororesin with carbon gasket (optional code GF) | | | |
| Gasket types for user's flange | Non-asbestos gasket, PTFE-sheathed non-asbestos gasket (optional codes BCF and BSF), or the equivalent in hardness | | | |
| Flange ratings Size mm (inch) | JIS 10K, ANSI Class 150, and DIN PN10 | JIS 20K, ANSI Class 300, and DIN PN16 | DIN PN40 | |
| 15 (0.5) | 2.9 to 4.8 / {29.57 to 48.95} / [25.67 to 42.48] | 2.9 to 4.8 / {29.57 to 48.95} / [25.67 to 42.48] | 3.0 to 5.0 / {30.59 to 50.99} / [26.55 to 44.25] | |
| 25 (1.0) | 8.2 to 13.6 / {83.62 to 138.7} / [72.57 to 120.4] | 8.2 to 13.7 / {83.62 to 139.7} / [72.57 to 121.3] | 7.9 to 13.1 / {80.56 to 133.6} / [69.92 to 115.9] | |
| 40 (1.5) | 14.1 to 23.6 / {143.8 to 240.7} / [124.8 to 208.9] | 14.4 to 24.1 / {146.8 to 245.8} / [127.4 to 213.3] | 15.5 to 25.8 / {158.1 to 263.1} / [137.2 to 228.3] | |

T0305.EPS

Table 3.3.5 Wafer Type Tightening Torque Values for PVC Piping

| Tightening torque values for PFA lining type (N-m / {kgf-cm} / [in-lbf]) | | | |
|--|--|--|---|
| Gasket types within flowtube | Fluororubber gasket (optional codes GA, GC, and GD) | | |
| Gasket types for user's flange | Fluororubber gasket, chloroprene rubber gasket (optional codes BSC and BCC), or the equivalent in hardness | | |
| Flange ratings Size mm (inch) | JIS 10K, ANSI Class 150, and DIN PN10 | JIS 20K, ANSI Class 300, and DIN PN16 | DIN PN40 |
| 2.5 (0.1) | 1.5 to 2.5 / {15.3 to 25.49} / [13.28 to 22.13] | 1.5 to 2.5 / {15.3 to 25.49} / [13.28 to 22.13] | 1.5 to 2.4 / {15.3 to 24.47} / [13.28 to 21.24] |
| 5 (0.2) | 1.5 to 2.5 / {15.3 to 25.49} / [13.28 to 22.13] | 1.5 to 2.5 / {15.3 to 25.49} / [13.28 to 22.13] | 1.5 to 2.4 / {15.3 to 24.47} / [13.28 to 21.24] |
| 10 (0.4) | 1.5 to 2.5 / {15.3 to 25.49} / [13.28 to 22.13] | 1.5 to 2.5 / {15.3 to 25.49} / [13.28 to 22.13] | 1.5 to 2.4 / {15.3 to 24.47} / [13.28 to 21.24] |
| 15 (0.5) | 1.5 to 2.5 / {15.3 to 25.49} / [13.28 to 22.13] | 1.5 to 2.5 / {15.3 to 25.49} / [13.28 to 22.13] | 1.5 to 2.4 / {15.3 to 24.47} / [13.28 to 21.24] |
| 25 (1.0) | 4.9 to 8.1 / {49.97 to 82.6} / [43.37 to 71.69] | 5.0 to 8.3 / {50.99 to 84.64} / [44.25 to 73.46] | 4.3 to 7.2 / {43.85 to 73.42} / [38.06 to 63.72] |
| 32 (1.25) | 5.5 to 9.2 / {56.08 to 93.81} / [48.68 to 81.43] | 5.7 to 9.5 / {58.12 to 96.87} / [50.45 to 84.08] | 5.4 to 8.9 / {55.06 to 90.75} / [47.79 to 78.77] |
| 40 (1.5) | 7.7 to 12.9 / {78.52 to 131.5} / [68.15 to 114.2] | 8.1 to 13.4 / {82.6 to 136.6} / [71.69 to 118.6] | 7.5 to 12.5 / {76.48 to 127.5} / [66.38 to 110.6] |

| Tightening torque values for Ceramics lining type (N-m / {kgf-cm} / [in-lbf]) | | | |
|---|--|--|--|
| Gasket types within flowtube | Fluororubber gasket (optional codes GA, GC, and GD) | | |
| Gasket types for user's flange | Fluororubber gasket, chloroprene rubber gasket (optional codes BSC and BCC), or the equivalent in hardness | | |
| Flange ratings Size mm (inch) | JIS 10K, ANSI Class 150, and DIN PN10 | JIS 20K, ANSI Class 300, and DIN PN16 | DIN PN40 |
| 15 (0.5) | 0.6 to 1.0 / {6.118 to 10.2} / [5.31 to 8.85] | 0.6 to 1.0 / {6.118 to 10.2} / [5.31 to 8.85] | 0.6 to 1.0 / {6.118 to 10.2} / [5.31 to 8.85] |
| 25 (1.0) | 1.7 to 2.8 / {17.34 to 28.55} / [15.05 to 24.78] | 1.7 to 2.8 / {17.34 to 28.55} / [15.05 to 24.78] | 1.5 to 2.5 / {15.3 to 25.49} / [13.28 to 22.13] |
| 40 (1.5) | 3.0 to 5.0 / {30.59 to 50.99} / [26.55 to 44.25] | 3.1 to 5.2 / {31.61 to 53.03} / [27.44 to 46.02] | 2.9 to 4.8 / {29.57 to 48.95} / [25.67 to 42.48] |

T0306.EPS

Table 3.3.6 Wafer Type Tightening Torque Values for Metal Piping and Permeable Fluids

| Tightening torque values for PFA lining type (N-m / {kgf-cm} / [in-lbf]) | | | |
|--|---|--|--|
| Gasket types within flowtube | No gasket (standard) | | |
| Gasket types for user's flange | PTFE-sheathed non-asbestos gasket (optional codes BCF and BSF), or the equivalent in hardness | | |
| Flange ratings Size mm (inch) | JIS 10K, ANSI Class 150, and DIN PN10 | JIS 20K, ANSI Class 300, and DIN PN16 | DIN PN40 |
| 2.5 (0.1) | 10.8 to 12.4 / {110.1 to 126.4} / [95.59 to 109.7] | 10.8 to 12.4 / {110.1 to 126.4} / [95.59 to 109.7] | 11.1 to 12.4 / {113.2 to 126.4} / [98.24 to 109.7] |
| 5 (0.2) | 10.8 to 12.4 / {110.1 to 126.4} / [95.59 to 109.7] | 10.8 to 12.4 / {110.1 to 126.4} / [95.59 to 109.7] | 11.1 to 12.4 / {113.2 to 126.4} / [98.24 to 109.7] |
| 10 (0.4) | 10.8 to 12.4 / {110.1 to 126.4} / [95.59 to 109.7] | 10.8 to 12.4 / {110.1 to 126.4} / [95.59 to 109.7] | 11.1 to 12.4 / {113.2 to 126.4} / [98.24 to 109.7] |
| 15 (0.5) | 10.8 to 12.4 / {110.1 to 126.4} / [95.59 to 109.7] | 10.8 to 12.4 / {110.1 to 126.4} / [95.59 to 109.7] | 11.1 to 12.4 / {113.2 to 126.4} / [98.24 to 109.7] |
| 25 (1.0) | 34.9 to 40.1 / {355.9 to 408.9} / [308.9 to 354.9] | 35.2 to 40.1 / {358.9 to 408.9} / [311.5 to 354.9] | 32.3 to 37.1 / {329.4 to 378.3} / [285.9 to 328.4] |
| 32 (1.25) | 38.8 to 44.6 / {395.6 to 454.8} / [343.4 to 394.7] | 39.2 to 44.6 / {399.7 to 454.8} / [346.9 to 394.7] | 40.6 to 46.7 / {414.0 to 476.2} / [359.3 to 413.3] |
| 40 (1.5) | 53.5 to 61.5 / {545.5 to 627.1} / [473.5 to 544.3] | 54.2 to 61.5 / {552.7 to 627.1} / [479.7 to 544.3] | 56.4 to 61.5 / {575.1 to 627.1} / [499.2 to 544.3] |

| Tightening torque values for Ceramics lining type (N-m / {kgf-cm} / [in-lbf]) | | | |
|---|---|--|--|
| Gasket types within flowtube | Fluororesin with ceramic fillers (Valqua #7020) gasket (standard), or fluororesin with carbon gasket (optional code GF) | | |
| Gasket types for user's flange | PTFE-sheathed non-asbestos gasket (optional codes BCF and BSF), or the equivalent in hardness | | |
| Flange ratings Size mm (inch) | JIS 10K, ANSI Class 150, and DIN PN10 | JIS 20K, ANSI Class 300, and DIN PN16 | DIN PN40 |
| 15 (0.5) | 4.2 to 7.1 / {42.83 to 72.4} / [37.17 to 62.84] | 4.3 to 7.1 / {43.85 to 72.4} / [38.06 to 62.84] | 4.4 to 7.3 / {44.87 to 74.44} / [38.94 to 64.61] |
| 25 (1.0) | 12.1 to 20.2 / {123.4 to 206.0} / [107.1 to 178.8] | 12.2 to 20.3 / {124.4 to 207.0} / [108.0 to 179.7] | 11.3 to 18.9 / {115.2 to 192.7} / [100.0 to 167.3] |
| 40 (1.5) | 20.8 to 34.7 / {212.1 to 353.8} / [184.1 to 307.1] | 21.1 to 35.2 / {215.2 to 358.9} / [186.7 to 311.5] | 22.2 to 37.0 / {226.4 to 377.3} / [196.5 to 327.5] |

T0307.EPS

3.3.3 Nominal Diameter 50 mm (2.0 in.) to 300 mm (12.0 in.), Wafer Type



IMPORTANT

Use bolts and nuts in compliance with the flange ratings. When stud-type through-bolts are used, be sure the outside diameter of the shank is smaller than that of the thread ridge. Be sure to choose a gasket with inner and outer diameters that does not protrude inside the piping (refer to Table 3.3.13). If the inner diameter of the gasket is too large, or outer diameter of the gasket is too small, fluid leakage may result.

(1) Mounting Direction

Mount the flowmeter so that the flow direction of the fluid to be measured is in line with the direction of the arrow mark on the flowmeter.



IMPORTANT

If it is impossible to match the direction of the arrow mark, the direction of the electrical connection can be changed. Refer to Section 5.1 to do this properly.

In case the fluid being measured flows against the arrow direction, refer to the parameter **J20: Flow Direction** in the user's manual of the AXFA11 Magnetic Flowmeter Remote Converter (IM 01E20C01-01E) or the AXFA14 Magnetic Flowmeter Remote Converter/AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

(2) Mounting Centering Devices

To maintain concentricity of the flowmeter with the pipes, install centering devices. From the process piping side, pass two through-bolts through the four centering devices (two for each bolt) and the adjacent two holes (the lower two holes for horizontal mounting) of both of the flanges (refer to Figure 3.3.4). Use the appropriate centering devices according to the nominal diameter and the flange ratings. The centering devices are engraved with an identifying character. Use the appropriate ones which meet the required specifications by referring to Tables 3.3.10 and 3.3.11 (AXF standard models) and Table 3.3.12 (replacement models for the earlier ADMAG or ADMAG AE).

(3) Positioning the Flowmeter

Position the flowmeter so that the Mini-flanges and the centering devices come in close contact with each other. Be careful to prevent the four centering devices from coming into contact with the housing. If stud-type through-bolts are used, position them in such a way that the four centering devices come in contact with the bolt threads (refer to Figure 3.3.4). Pass the other through-bolts through from the process piping side.



NOTE

Precautions for size 125 mm (5 in.), 150 mm (6 in.), replaceable electrode type

When installing this type of flowmeter with JIS F12 (JIS 75M) flanges, turn the flowmeter slightly because the cover of the electrode chambers will interfere with the bolts.

(4) Tightening Nuts

Tighten the nuts according to the torque values for metal piping in Table 3.3.7. For PVC piping, select an optional code of GA, GC, or GD, use rubber gaskets and tighten the nuts to the torque values for PVC piping in Table 3.3.8.

For permeable fluids (such as nitric acid, hydrofluoric acid, or sodium hydrate at high temperatures), tighten the nuts according to the torque values in Table 3.3.9.



CAUTION

For a flowmeter with fluorocarbon PFA lining, it is possible that the nuts may loosen as time passes, so tighten them regularly. Be sure to tighten the nuts according to the prescribed torque values. Tighten them diagonally with the same torque values, step by step up to the prescribed torque value.

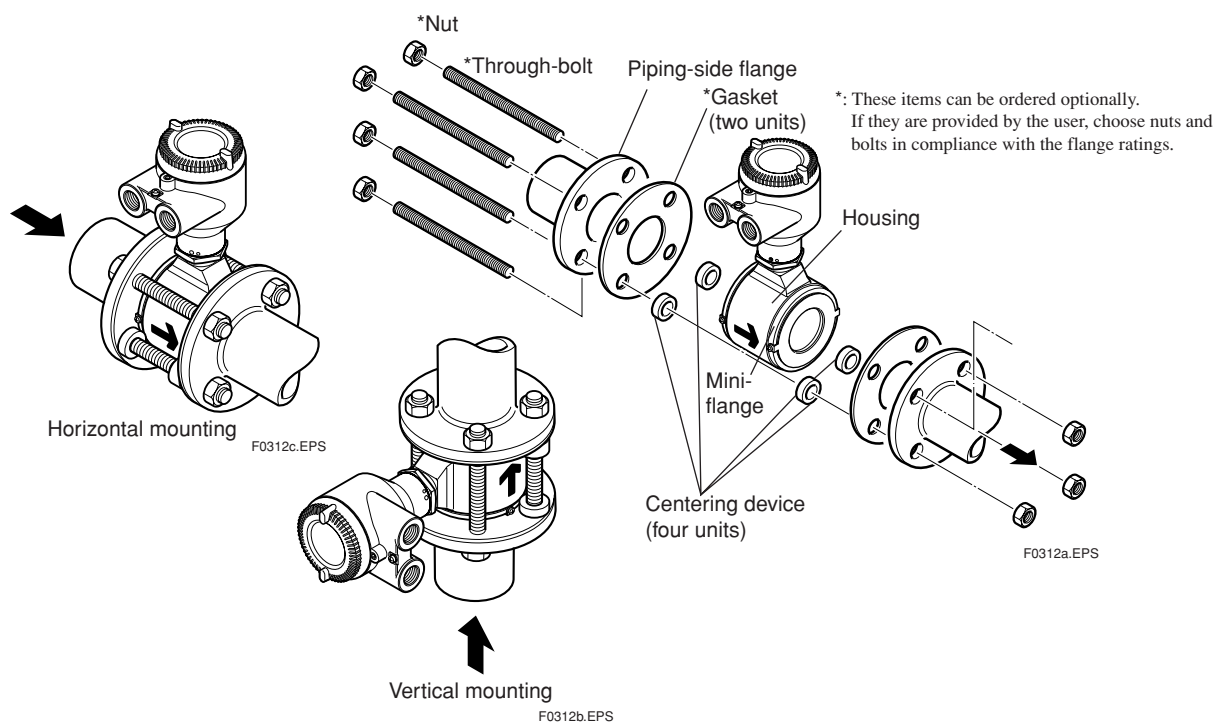


Figure 3.3.4 Mounting Procedure for Wafer Type (size: 50 mm (2 in.) to 300 mm (12 in.))

Table 3.3.7 Wafer Type Tightening Torque Values for Metal Piping

| Tightening torque values for PFA/Polyurethane Rubber/Natural Soft Rubber/EPDM Rubber lining type | | | | | | | | | Unit: N·m (kgf·cm) (in·lbf) |
|--|--|--|---|--|--|--|--|--|---|
| Gasket types within flowtube | No gasket (standard) | | | | | | | | |
| Gasket types for user's flange | Non-asbestos fiber gasket, PTFE-sheathed non-asbestos gasket (optional codes BCF and BSF), or the equivalent in hardness | | | | | | | | |
| Flange ratings | JIS 10K | ANSI Class 150 | DIN PN10 | JIS20K | ANSI Class 300 | DIN PN16 | DIN PN40 | JIS F12 (JIS 75M) | |
| Size mm (inch) | | | | | | | | | |
| 50 (2.0) | 45.0 to 56.8 (458.9 to 579.2) (398.3 to 502.7) | 45.0 to 56.8 (458.9 to 579.2) (398.3 to 502.7) | — | 22.5 to 25.9 (229.4 to 264.1) (199.1 to 229.2) | 22.5 to 25.9 (229.4 to 264.1) (199.1 to 229.2) | — | 50.0 to 57.5 (509.9 to 586.3) (442.5 to 508.9) | — | |
| 65 (2.5) | 61.3 to 70.5 (625.1 to 718.9) (542.5 to 624.0) | 61.3 to 70.5 (625.1 to 718.9) (542.5 to 624.0) | — | 30.8 to 35.4 (314.1 to 361.0) (272.6 to 313.3) | 30.8 to 35.4 (314.1 to 361.0) (272.6 to 313.3) | 56.1 to 70.8 (572.1 to 722.0) (496.5 to 626.6) | — | — | |
| 80 (3.0) | 35.0 to 40.3 (356.9 to 410.9) (309.8 to 356.7) | 76.0 to 80.9 (775.0 to 825.0) (672.6 to 716.0) | — | 39.9 to 45.9 (406.9 to 468.1) (353.1 to 406.2) | 39.9 to 45.9 (406.9 to 468.1) (353.1 to 406.2) | 39.9 to 45.9 (406.9 to 468.1) (353.1 to 406.2) | — | 68.4 to 78.7 (697.5 to 802.5) (605.4 to 696.5) | |
| 100 (4.0) | 46.1 to 53 (470.1 to 540.5) (408.0 to 469.1) | 46.1 to 53 (470.1 to 540.5) (408.0 to 469.1) | — | 52.9 to 60.8 (539.4 to 620.0) (468.2 to 538.1) | 52.9 to 60.8 (539.4 to 620.0) (468.2 to 538.1) | 52.9 to 60.8 (539.4 to 620.0) (468.2 to 538.1) | — | 88.6 to 101.9 (903.5 to 1039) (784.1 to 901.9) | |
| 125 (5.0) | 73.7 to 84.8 (751.5 to 864.7) (652.3 to 750.5) | 73.7 to 84.8 (751.5 to 864.7) (652.3 to 750.5) | — | 80.5 to 92.6 (820.9 to 944.3) (712.5 to 819.5) | 80.5 to 92.6 (820.9 to 944.3) (712.5 to 819.5) | 80.5 to 92.6 (820.9 to 944.3) (712.5 to 819.5) | — | 75.1 to 86.4 (765.8 to 881.0) (664.7 to 764.7) | |
| 150 (6.0) | 85.4 to 98.2 (870.8 to 1001) (755.8 to 869.1) | 85.4 to 98.2 (870.8 to 1001) (755.8 to 869.1) | — | 61.0 to 70.2 (622.0 to 715.8) (539.9 to 621.3) | 61.0 to 70.2 (622.0 to 715.8) (539.9 to 621.3) | 91.2 to 96.3 (930.0 to 982.0) (807.2 to 852.3) | — | 86.3 to 99.2 (880.0 to 1012) (763.8 to 878.0) | |
| 200 (8.0) | 78.8 to 90.6 (803.5 to 923.9) (697.4 to 801.8) | 113.6 to 135.8 (1158 to 1385) (1005 to 1202) | 113.6 to 135.8 (1158 to 1385) (1005 to 1202) | 87.5 to 100.6 (892.3 to 1026) (774.4 to 890.3) | 87.5 to 100.6 (892.3 to 1026) (774.4 to 890.3) | 87.5 to 100.6 (892.3 to 1026) (774.4 to 890.3) | — | 88.6 to 101.9 (903.5 to 1039) (784.1 to 901.9) | |
| 250 (10) | 119.4 to 137.3 (1218 to 1400) (1057 to 1215) | 119.4 to 137.3 (1218 to 1400) (1057 to 1215) | — | — | — | — | — | 158.1 to 181.8 (1612 to 1854) (1399 to 1609) | |
| 300 (12) | 83.0 to 99.2 (846.4 to 1012) (734.6 to 878) | 105.2 to 121.0 (1073 to 1234) (931.1 to 1071) | 105.2 to 121.0 (1073 to 1234) (931.1 to 1071) | — | — | — | — | 146.6 to 168.6 (1495 to 1719) (1297 to 1492) | |

| Tightening torque values for Ceramics lining type | | | | | | | | | Unit: N·m (kgf·cm) (in·lbf) |
|---|---|--|--|--|--|--|--|--|---|
| Gasket types within flowtube | Fluororesin with ceramic fillers (Valqua #7020) gasket (standard), or fluororesin with carbon gasket (optional code GF) | | | | | | | | |
| Gasket types for user's flange | Non-asbestos gasket, PTFE-sheathed non-asbestos gasket (optional codes BCF and BSF), or the equivalent in hardness | | | | | | | | |
| Flange ratings | JIS 10K | ANSI Class 150 | DIN PN10 | JIS20K | ANSI Class 300 | DIN PN16 | DIN PN40 | JIS F12 (JIS 75M) | |
| Size mm (inch) | | | | | | | | | |
| 50 (2.0) | 29.9 to 49.8 (304.9 to 507.8) (264.6 to 440.8) | 29.9 to 49.8 (304.9 to 507.8) (264.6 to 440.8) | — | 30.5 to 50.9 (311.0 to 519.0) (269.9 to 450.5) | 30.5 to 50.9 (311.0 to 519.0) (269.9 to 450.5) | — | 32.7 to 54.5 (333.4 to 555.7) (289.4 to 482.4) | — | |
| 80 (3.0) | 37.1 to 61.8 (378.3 to 630.2) (328.4 to 547.0) | 37.1 to 61.8 (378.3 to 630.2) (328.4 to 547.0) | — | 37.6 to 62.7 (383.4 to 639.4) (332.8 to 554.9) | 37.6 to 62.7 (383.4 to 639.4) (332.8 to 554.9) | 37.6 to 62.7 (383.4 to 639.4) (332.8 to 554.9) | — | 56.3 to 93.8 (574.1 to 956.5) (498.3 to 830.2) | |
| 100 (4.0) | 48.9 to 81.5 (498.6 to 831.1) (432.8 to 721.3) | 48.9 to 81.5 (498.6 to 831.1) (432.8 to 721.3) | — | 49.9 to 83.1 (508.8 to 847.4) (441.6 to 735.5) | 49.9 to 83.1 (508.8 to 847.4) (441.6 to 735.5) | 49.9 to 83.1 (508.8 to 847.4) (441.6 to 735.5) | — | 74.2 to 123.7 (756.6 to 1261) (656.7 to 1095) | |
| 150 (6.0) | 101.4 to 169.0 (1034 to 1723) (897.5 to 1496) | 101.4 to 169.0 (1034 to 1723) (897.5 to 1496) | — | 104.4 to 174.0 (1065 to 1774) (924.0 to 1540) | 104.4 to 174.0 (1065 to 1774) (924.0 to 1540) | 104.4 to 174.0 (1065 to 1774) (924.0 to 1540) | — | 82.2 to 137.0 (838.2 to 1397) (727.5 to 1213) | |
| 200 (8.0) | 142.3 to 237.2 (1451 to 2419) (1259 to 2099) | 142.3 to 237.2 (1451 to 2419) (1259 to 2099) | 142.3 to 237.2 (1451 to 2419) (1259 to 2099) | 98.5 to 164.2 (1004 to 1674) (871.8 to 1453) | 98.5 to 164.2 (1004 to 1674) (871.8 to 1453) | 98.5 to 164.2 (1004 to 1674) (871.8 to 1453) | — | 86.7 to 144.6 (884.1 to 1475) (767.3 to 1280) | |

T0308.EPS

Table 3.3.8 Wafer Type Tightening Torque Values for PVC Piping

| Tightening torque values for PFA lining type | | | | | | | | | Unit: $\frac{\text{N}\cdot\text{m}}{\{\text{kgf}\cdot\text{cm}\} \{\text{in}\cdot\text{lb}\cdot\text{ft}\}}$ |
|--|--|--|--|--|--|--|---|--|--|
| Gasket types within flowtube | Fluororubber gasket (optional codes GA, GC, and GD) | | | | | | | | |
| Gasket types for user's flange | Fluororubber gasket, chloroprene rubber gasket (optional codes BSC and BCC), or the equivalent in hardness | | | | | | | | |
| Flange ratings | JIS 10K | ANSI Class 150 | DIN PN10 | JIS20K | ANSI Class 300 | DIN PN16 | DIN PN40 | JIS F12 (JIS 75M) | |
| Size mm (inch) | | | | | | | | | |
| 50 (2.0) | 9.9 to 16.5 {101.0 to 168.3} [87.6 to 146.0] | 9.9 to 16.5 {101.0 to 168.3} [87.6 to 146.0] | — | 10.6 to 17.6 {108.1 to 179.5} [93.8 to 155.8] | 10.6 to 17.6 {108.1 to 179.5} [93.8 to 155.8] | — | 9.5 to 15.9 {96.9 to 162.1} [84.1 to 140.7] | — | |
| 65 (2.5) | 14.2 to 23.7 {144.8 to 241.7} [125.7 to 209.8] | 14.2 to 23.7 {144.8 to 241.7} [125.7 to 209.8] | — | 15.5 to 25.9 {158.1 to 264.1} [137.2 to 229.2] | 15.5 to 25.9 {158.1 to 264.1} [137.2 to 229.2] | 28.2 to 51.8 {287.6 to 528.2} [249.6 to 458.4] | — | — | |
| 80 (3.0) | 8.0 to 13.3 {81.6 to 135.6} [70.8 to 117.7] | 17.4 to 26.7 {177.4 to 272.3} [154.0 to 236.3] | — | 9.7 to 16.1 {98.9 to 164.2} [85.8 to 142.5] | 9.7 to 16.1 {98.9 to 164.2} [85.8 to 142.5] | 9.7 to 16.1 {98.9 to 164.2} [85.8 to 142.5] | — | 15.4 to 25.6 {157.0 to 261.0} [136.3 to 226.6] | |
| 100 (4.0) | 11.3 to 18.8 {115.2 to 191.7} [100.0 to 166.4] | 11.3 to 18.8 {115.2 to 191.7} [100.0 to 166.4] | — | 14.2 to 23.6 {144.8 to 240.7} [125.7 to 208.9] | 14.2 to 23.6 {144.8 to 240.7} [125.7 to 208.9] | 14.2 to 23.6 {144.8 to 240.7} [125.7 to 208.9] | — | 21.1 to 35.1 {215.2 to 357.9} [186.7 to 310.6] | |
| 125 (5.0) | 18.8 to 31.3 {191.7 to 319.2} [166.4 to 277.0] | 18.8 to 31.3 {191.7 to 319.2} [166.4 to 277.0] | — | 22.3 to 37.2 {227.4 to 379.3} [197.4 to 329.2] | 22.3 to 37.2 {227.4 to 379.3} [197.4 to 329.2] | 22.3 to 37.2 {227.4 to 379.3} [197.4 to 329.2] | — | 18.5 to 30.8 {188.6 to 314.1} [163.7 to 272.6] | |
| 150 (6.0) | 22.5 to 37.6 {229.4 to 383.4} [199.1 to 332.8] | 22.5 to 37.6 {229.4 to 383.4} [199.1 to 332.8] | — | 27.2 to 45.3 {277.4 to 461.9} [240.7 to 400.9] | 27.2 to 45.3 {277.4 to 461.9} [240.7 to 400.9] | 27.2 to 45.3 {277.4 to 461.9} [240.7 to 400.9] | — | 21.8 to 36.3 {222.3 to 370.2} [192.9 to 321.3] | |
| 200 (8.0) | 22.1 to 36.9 {225.4 to 376.3} [195.6 to 326.6] | 31.9 to 55.3 {325.3 to 563.9} [282.3 to 489.4] | 31.9 to 55.3 {325.3 to 563.9} [282.3 to 489.4] | 27.3 to 45.3 {278.4 to 461.9} [241.6 to 400.9] | 27.3 to 45.3 {278.4 to 461.9} [241.6 to 400.9] | 27.3 to 45.3 {278.4 to 461.9} [241.6 to 400.9] | — | 23.8 to 39.6 {242.7 to 403.8} [210.6 to 350.5] | |

| Tightening torque values for Ceramics lining type | | | | | | | | | Unit: $\frac{\text{N}\cdot\text{m}}{\{\text{kgf}\cdot\text{cm}\} \{\text{in}\cdot\text{lb}\cdot\text{ft}\}}$ |
|---|--|--|--|--|--|--|---|--|--|
| Gasket types within flowtube | Fluororubber gasket (optional codes GA, GC, and GD) | | | | | | | | |
| Gasket types for user's flange | Fluororubber gasket, chloroprene rubber gasket (optional codes BSC and BCC), or the equivalent in hardness | | | | | | | | |
| Flange ratings | JIS 10K | ANSI Class 150 | DIN PN10 | JIS20K | ANSI Class 300 | DIN PN16 | DIN PN40 | JIS F12 (JIS 75M) | |
| Size mm (inch) | | | | | | | | | |
| 50 (2.0) | 4.5 to 7.4 {45.89 to 75.46} [39.83 to 65.49] | 4.5 to 7.4 {45.89 to 75.46} [39.83 to 65.49] | — | 4.8 to 7.9 {48.95 to 80.56} [42.48 to 69.92] | 4.8 to 7.9 {48.95 to 80.56} [42.48 to 69.92] | — | 4.3 to 7.1 {43.85 to 72.4} [38.06 to 62.84] | — | |
| 80 (3.0) | 4.4 to 7.3 {44.87 to 74.44} [38.94 to 64.61] | 4.4 to 7.3 {44.87 to 74.44} [38.94 to 64.61] | — | 4.8 to 7.9 {48.95 to 80.56} [42.48 to 69.92] | 4.8 to 7.9 {48.95 to 80.56} [42.48 to 69.92] | 4.8 to 7.9 {48.95 to 80.56} [42.48 to 69.92] | — | 8.6 to 14.4 {87.7 to 146.8} [76.12 to 127.4] | |
| 100 (4.0) | 6.4 to 10.7 {65.26 to 109.1} [56.64 to 94.7] | 6.4 to 10.7 {65.26 to 109.1} [56.64 to 94.7] | — | 7.2 to 11.9 {73.42 to 121.3} [63.72 to 105.3] | 7.2 to 11.9 {73.42 to 121.3} [63.72 to 105.3] | 7.2 to 11.9 {73.42 to 121.3} [63.72 to 105.3] | — | 12.2 to 20.3 {124.4 to 207.0} [108.0 to 179.7] | |
| 150 (6.0) | 15.1 to 25.2 {154.0 to 257.0} [133.6 to 223.0] | 15.1 to 25.2 {154.0 to 257.0} [133.6 to 223.0] | — | 17.6 to 29.3 {179.5 to 298.8} [155.8 to 259.3] | 17.6 to 29.3 {179.5 to 298.8} [155.8 to 259.3] | 17.6 to 29.3 {179.5 to 298.8} [155.8 to 259.3] | — | 14.9 to 24.8 {151.9 to 252.9} [131.9 to 219.5] | |
| 200 (8.0) | 23.4 to 39.0 {238.6 to 397.7} [207.1 to 345.2] | 23.4 to 39.0 {238.6 to 397.7} [207.1 to 345.2] | 23.4 to 39.0 {238.6 to 397.7} [207.1 to 345.2] | 18.6 to 31.6 {189.7 to 322.2} [164.6 to 279.7] | 18.6 to 31.6 {189.7 to 322.2} [164.6 to 279.7] | 18.6 to 31.6 {189.7 to 322.2} [164.6 to 279.7] | — | 17.1 to 28.6 {174.4 to 291.6} [151.3 to 253.1] | |

T0309.EPS

Table 3.3.9 Wafer Type Tightening Torque Values for Metal Piping and Permeable Fluids

| Tightening torque values for PFA lining type | | | | | | | | |
|--|---|--|--|--|--|--|---|--|
| | | | | | | | | Unit: $\frac{\text{N}\cdot\text{m}}{(\text{kgf}\cdot\text{cm})}$ (in-lbf) |
| Gasket types within flowtube | No gasket (standard) | | | | | | | |
| Gasket types for user's flange | PTFE-sheathed non-asbestos gasket (optional codes BCF and BSF), or the equivalent in hardness | | | | | | | |
| Flange ratings Size mm (inch) | JIS 10K | ANSI Class 150 | DIN PN10 | JIS20K | ANSI Class 300 | DIN PN16 | DIN PN40 | JIS F12 (JIS 75M) |
| 50 (2.0) | 66.2 to 76.1 {675.1 to 776.0} {585.9 to 673.5} | 66.2 to 76.1 {675.1 to 776.0} {585.9 to 673.5} | — | 33.1 to 38.0 {337.5 to 387.5} {292.9 to 336.3} | 33.1 to 38.0 {337.5 to 387.5} {292.9 to 336.3} | — | 71.2 to 118.6 {726.0 to 1209} {630.1 to 1050} | — |
| 65 (2.5) | 89.5 to 102.9 {912.6 to 1049} {792.1 to 910.7} | 89.5 to 102.9 {912.6 to 1049} {792.1 to 910.7} | — | 44.9 to 51.6 {457.9 to 526.2} {397.4 to 456.7} | 44.9 to 51.6 {457.9 to 526.2} {397.4 to 456.7} | 81.8 to 103.2 {834.1 to 1052} {724.0 to 913.4} | — | — |
| 80 (3.0) | 51.3 to 59.0 {523.1 to 601.6} {454.0 to 522.2} | 111.3 to 118.4 {1135 to 1207} {985.0 to 1048} | — | 58.1 to 66.8 {592.5 to 681.2} {514.2 to 591.2} | 58.1 to 66.8 {592.5 to 681.2} {514.2 to 591.2} | 58.1 to 66.8 {592.5 to 681.2} {514.2 to 591.2} | — | 100.8 to 115.9 {1028 to 1182} {892.1 to 1026} |
| 100 (4.0) | 66.7 to 76.7 {680.2 to 782.1} {590.3 to 678.8} | 66.7 to 76.7 {680.2 to 782.1} {590.3 to 678.8} | — | 76.1 to 87.5 {776.0 to 892.3} {673.5 to 774.4} | 76.1 to 87.5 {776.0 to 892.3} {673.5 to 774.4} | 76.1 to 87.5 {776.0 to 892.3} {673.5 to 774.4} | — | 129.8 to 149.3 {1324 to 1522} {1149 to 1321} |
| 125 (5.0) | 106.1 to 122.0 {1082 to 1244} {939.0 to 1080} | 106.1 to 122.0 {1082 to 1244} {939.0 to 1080} | — | 114.5 to 131.7 {1168 to 1343} {1013 to 1166} | 114.5 to 131.7 {1168 to 1343} {1013 to 1166} | 114.5 to 131.7 {1168 to 1343} {1013 to 1166} | — | 109.6 to 126.0 {1118 to 1285} {970.0 to 1115} |
| 150 (6.0) | 122.2 to 140.5 {1246 to 1433} {1082 to 1243} | 122.2 to 140.5 {1246 to 1433} {1082 to 1243} | — | 86.8 to 99.8 {885.1 to 1018} {768.2 to 883.3} | 86.8 to 99.8 {885.1 to 1018} {768.2 to 883.3} | 129.8 to 136.9 {1324 to 1396} {1149 to 1212} | — | 125.6 to 144.4 {1281 to 1472} {1112 to 1278} |
| 200 (8.0) | 111.6 to 128.3 {1138 to 1308} {987.7 to 1136} | 161.0 to 192.3 {1642 to 1961} {1425 to 1702} | 161.0 to 192.3 {1642 to 1961} {1425 to 1702} | 122.0 to 140.3 {1244 to 1431} {1080 to 1242} | 122.0 to 140.3 {1244 to 1431} {1080 to 1242} | 122.0 to 140.3 {1244 to 1431} {1080 to 1242} | — | 128.0 to 147.2 {1305 to 1501} {1133 to 1303} |
| 250 (10) | 167.7 to 192.9 {1710 to 1967} {1484 to 1707} | 167.7 to 192.9 {1710 to 1967} {1484 to 1707} | 167.7 to 192.9 {1710 to 1967} {1484 to 1707} | — | — | — | — | 227.6 to 261.7 {2321 to 2669} {2014 to 2316} |
| 300 (12) | 115.2 to 137.6 {1175 to 1403} {1020 to 1218} | 146.0 to 167.9 {1489 to 1712} {1292 to 1486} | 146.0 to 167.9 {1489 to 1712} {1292 to 1486} | — | — | — | — | 209.1 to 240.5 {2132 to 2452} {1851 to 2129} |

| Tightening torque values for Ceramics lining type | | | | | | | | |
|---|---|--|--|--|--|--|--|--|
| | | | | | | | | Unit: $\frac{\text{N}\cdot\text{m}}{(\text{kgf}\cdot\text{cm})}$ (in-lbf) |
| Gasket types within flowtube | Fluororesin with ceramic fillers (Valqua #7020) gasket (standard), or fluororesin with carbon gasket (optional code GF) | | | | | | | |
| Gasket types for user's flange | PTFE-sheathed non-asbestos gasket (optional codes BCF and BSF), or the equivalent in hardness | | | | | | | |
| Flange ratings Size mm (inch) | JIS 10K | ANSI Class 150 | DIN PN10 | JIS20K | ANSI Class 300 | DIN PN16 | DIN PN40 | JIS F12 (JIS 75M) |
| 50 (2.0) | 29.9 to 49.8 {304.9 to 507.8} {264.6 to 440.8} | 29.9 to 49.8 {304.9 to 507.8} {264.6 to 440.8} | — | 30.5 to 50.9 {311.0 to 519.0} {269.9 to 450.5} | 30.5 to 50.9 {311.0 to 519.0} {269.9 to 450.5} | — | 32.7 to 54.5 {333.4 to 555.7} {289.4 to 482.4} | — |
| 80 (3.0) | 48.5 to 80.8 {494.6 to 823.9} {429.3 to 715.1} | 48.5 to 80.8 {494.6 to 823.9} {429.3 to 715.1} | — | 46.6 to 77.6 {475.2 to 791.3} {412.4 to 686.8} | 46.6 to 77.6 {475.2 to 791.3} {412.4 to 686.8} | 46.6 to 77.6 {475.2 to 791.3} {412.4 to 686.8} | — | 56.3 to 93.8 {574.1 to 956.5} {498.3 to 830.2} |
| 100 (4.0) | 60.5 to 100.9 {616.9 to 1029} {535.5 to 893.0} | 60.5 to 100.9 {616.9 to 1029} {535.5 to 893.0} | — | 61.5 to 102.5 {627.1 to 1045} {544.3 to 907.2} | 61.5 to 102.5 {627.1 to 1045} {544.3 to 907.2} | 61.5 to 102.5 {627.1 to 1045} {544.3 to 907.2} | — | 74.2 to 123.7 {756.6 to 1261} {656.7 to 1095} |
| 150 (6.0) | 125.0 to 208.3 {1275 to 2124} {1106 to 1844} | 125.0 to 208.3 {1275 to 2124} {1106 to 1844} | — | 128.0 to 213.3 {1305 to 2175} {1133 to 1888} | 128.0 to 213.3 {1305 to 2175} {1133 to 1888} | 128.0 to 213.3 {1305 to 2175} {1133 to 1888} | — | 82.2 to 137.0 {838.2 to 1397} {727.5 to 1213} |
| 200 (8.0) | 174.7 to 291.2 {1781 to 2969} {1546 to 2577} | 174.7 to 291.2 {1781 to 2969} {1546 to 2577} | 174.7 to 291.2 {1781 to 2969} {1546 to 2577} | 120.1 to 200.2 {1225 to 2041} {1063 to 1772} | 120.1 to 200.2 {1225 to 2041} {1063 to 1772} | 120.1 to 200.2 {1225 to 2041} {1063 to 1772} | — | 86.7 to 144.6 {884.1 to 1475} {767.3 to 1280} |

T0310.EPS

Table 3.3.10 Centering Device Identification (AXF Standard Models, PFA/Polyurethane Rubber/Natural Soft Rubber/EPDM Rubber lining)

| Flange ratings Size mm (inch) | JIS | | | ANSI | | DIN | | |
|----------------------------------|-----|-----|-----------|------|-----|------|------|------|
| | 10K | 20K | F12 (75M) | 150 | 300 | PN10 | PN16 | PN40 |
| 50 (2.0) | B | B | — | B | F | — | — | F |
| 65 (2.5) | B | B | — | B | G | — | F | — |
| 80 (3.0) | B | F | H | F | C | — | G | — |
| 100 (4.0) | B | F | H | C | H | — | F | — |
| 125 (5.0) | B | C | C | G | D | — | F | — |
| 150 (6.0) | C | D | D | C | E | — | C | — |
| 200 (8.0) | C | D | D | D | E | C | C | — |
| 250 (10) | C | — | D | N | — | C | C | — |
| 300 (12) | C | — | D | P | — | C | C | — |

*: Each centering device is engraved with a character as identification.

T0311.EPS

Table 3.3.11 Centering Device Identification (AXF Standard Models, Ceramics lining)

| Flange ratings Size mm (inch) | JIS | | | ANSI | | DIN | | |
|----------------------------------|-----|-----|----------|------|-----|------|------|------|
| | 10K | 20K | F12(75M) | 150 | 300 | PN10 | PN16 | PN40 |
| 50 (2.0) | B | B | — | B | F | — | — | F |
| 80 (3.0) | B | F | H | F | C | — | G | — |
| 100 (4.0) | B | F | H | C | H | — | F | — |
| 150 (6.0) | B | C | G | B | D | — | B | — |
| 200 (8.0) | B | C | C | G | J | B | B | — |

*: Each centering device is engraved with a character as identification.

T0312-1.EPS

Table 3.3.12 Centering Device Identification (Replacement Models, PFA/Polyurethane Rubber lining)

| Size mm (inch) | Flange ratings | JIS | | | ANSI | | DIN | | |
|-------------------|-------------------|-----|-----|----------|------|-----|------|------|------|
| | | 10K | 20K | F12(75M) | 150 | 300 | PN10 | PN16 | PN40 |
| 50 (2.0) | | B | B | — | B | F | — | — | F |
| 80 (3.0) | | B | F | H | F | C | — | G | — |
| 100 (4.0) | | B | F | H | C | H | — | F | — |
| 150 (6.0) | | C | D | D | C | E | — | C | — |
| 200 (8.0) | | C | D | D | D | E | C | C | — |

*: Each centering device is engraved with a character as identification.

T0312-2.EPS

Table 3.3.13 Inner Diameter of Grounding Ring, Outer Diameter for Effective Sealing

Be sure to choose a gasket with an inner and outer diameter that does not protrude inside the piping.

If the inner diameter of the gasket is too large, or outer diameter of the gasket is too small, fluid leakage may result.

AXF Standard:

Size 2.5 to 400 mm

Unit : mm (in.)

| Lining Size | PFA/Polyurethane Rubber/ Natural Soft Rubber/ EPDM Rubber | | | | Ceramics | |
|----------------|---|---------------|--|-------------|---|---|
| | Inner diameter of Grounding ring [øA] | | Outer diameter for effective sealing [øB] | | Inner diameter of Grounding ring [øA] | Outer diameter for effective sealing [øB] |
| | Water | Flange | Water | Flange | | |
| 2.5 (0.1) | 15 (0.59) [12 (0.47)] *1 | | 38 (1.50) | 30 (1.18) | - | - |
| 5 (0.2) | 15 (0.59) [12 (0.47)] *1 | | 38 (1.50) | 30 (1.18) | - | - |
| 10 (0.4) | 15 (0.59) [12 (0.47)] *1 | | 38 (1.50) | 30 (1.18) | - | - |
| 15 (0.5) | 15 (0.59) | | 38 (1.50) | 34 (1.34) | 15 (0.59) | 33 (1.30) |
| 25 (1.0) | 28 (1.10) | | 53 (2.09) | 53 (2.09) | 27 (1.06) | 50 (1.97) |
| 32 (1.25) | 34 (1.34) | | 58 (2.28) | 58 (2.28) | - | - |
| 40 (1.5) | 41 (1.61) | | 71 (2.80) | 71 (2.80) | 40 (1.57) | 68 (2.68) |
| 50 (2.0) | 53 (2.09) | | 84 (3.31) | 84 (3.31) | 52 (2.05) | 82 (3.23) |
| 65 (2.5) | 66 (2.60) | | 103 (4.06) | 103 (4.06) | - | - |
| 80 (3.0) | 77 (3.03) | | 114 (4.49) | 114 (4.49) | 81 (3.19) | 112 (4.41) |
| 100 (4.0) | 102 (4.02) | | 140 (5.51) | 140 (5.51) | 98 (3.86) | 134 (5.28) |
| 125 (5.0) | 128 (5.04) | | 165 (6.50) | 165 (6.50) | - | - |
| 150 (6.0) | 146.1 (5.75) | | 190 (7.48) | 190 (7.48) | 144 (5.67) | 188 (7.40) |
| 200 (8.0) | 193.6 (7.62) | | 240 (9.45) | 240 (9.45) | 192 (7.56) | 240 (9.45) |
| 250 (10) | 243.7 (9.60) | 243 (9.57) | 300 (11.81) | 315 (12.40) | - | - |
| 300 (12) | 294.7 (11.60) | 291.3 (11.47) | 348 (13.70) | 360 (14.17) | - | - |
| 350 (14) | - | 323.4 (12.73) | - | 405 (15.94) | - | - |
| 400 (16) | - | 373.5 (14.70) | - | 465 (18.31) | - | - |

T0313-01.EPS

Size 500 to 2600 mm

Unit : mm (in.)

| Lining Size | Polyurethane Rubber | |
|----------------|--|--|
| | Inner diameter of Grounding ring [øA] | Outer diameter for effective sealing [øB] |
| 500 (20) | 468 (18.42) [485 (19.09)] *2 | 570 (22.44) |
| 600 (24) | 563 (22.16) [589 (23.18)] *2 | 675 (26.57) |
| 700 (28) | 665 (26.18) [689 (27.12)] *2 | 785 (30.91) |
| 800 (32) | 765 (30.11) [788 (31.02)] *2 | 890 (35.04) |
| 900 (36) | 855 (33.66) [888 (34.96)] *2 | 990 (38.98) |
| 1000 (40) | 942 (37.08) [990 (38.97)] *2 | 1095 (43.11) |
| 1100 (44) | 1085 (42.71) | 1230 (48.43) |
| 1200 (48) | 1185 (46.65) | 1334 (52.52) |
| 1350 (54) | 1335 (52.55) | 1490 (58.66) |
| 1500 (60) | 1485 (58.46) | 1646 (64.80) |
| 1600 (64) | 1585 (62.40) | 1756 (69.13) |
| 1800 (72) | 1785 (70.27) | 1948 (76.69) |
| 2000 (80) | 1985 (78.14) | 2160 (85.04) |
| 2200 (88) | 2185 (86.02) | 2370 (93.31) |
| 2400 (96) | 2385 (93.89) | 2580 (101.57) |
| 2600 (104) | 2585 (101.77) | 2770 (109.06) |

T0313-02.EPS

Replacement Model for earlier ADMAG or ADMAG AE:

Unit : mm (in.)


| Lining Size | PFA/Polyurethane Rubber | | |
|----------------|--|--|-------------|
| | Inner diameter of Grounding ring [øA] | Outer diameter for effective sealing [øB] | |
| | | Wafer | Flange |
| 2.5 (0.1) | 15 (0.59) | 38 (1.50) | - |
| 5 (0.2) | 15 (0.59) | 38 (1.50) | - |
| 10 (0.4) | 15 (0.59) | 38 (1.50) | - |
| 15 (0.5) | 15 (0.59) | 38 (1.50) | - |
| 25 (1.0) | 27 (1.06) | 56 (2.20) | - |
| 40 (1.5) | 40 (1.57) | 71 (2.80) | - |
| 50 (2.0) | 52 (2.05) | 85 (3.35) | - |
| 80 (3.0) | 81 (3.19) | 115 (4.53) | - |
| 100 (4.0) | 98 (3.86) | 144 (5.57) | - |
| 150 (6.0) | 140.7 (5.6) | 190 (7.48) | 205 (8.07) |
| 200 (8.0) | 188.9 (7.5) | 240 (9.45) | 255 (10.04) |
| 250 (10) | 243 (9.57) | - | 315 (12.40) |

T0313-03.EPS

*1: The I.D. of the process connection code: DD4, DJ1, DJ2 is values in brackets [].

*2: The I.D. of the process connection code: CG1 is values in brackets [].

Size of Inner Diameter of Grounding ring and Outer Diameter for Effective Sealing :

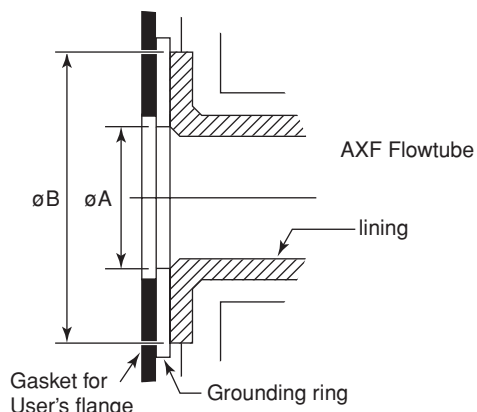

3.3.4 Nominal Diameter 2.5 mm (0.1 in.) to 400 mm (16 in.), Flange Type



IMPORTANT

Use bolts and nuts in compliance with the flange ratings. Be sure to choose a gasket with inner and outer diameters that does not protrude inside the piping (refer to Table 3.3.13). If the inner diameter of the gasket is too large, or outer diameter of the gasket is too small, fluid leakage may result.

(1) Mounting Direction

Mount the flowmeter so that the flow direction of the fluid to be measured is in line with the direction of the arrow mark on the flowmeter.



IMPORTANT

If it is impossible to match the direction of the arrow mark, the direction of the electrical connection can be changed. Refer to Section 5.1 to do this properly.

In case the fluid being measured flows against the arrow direction, refer to the parameter **J20: Flow Direction** in the user's manual of the AXFA11 Magnetic Flowmeter Remote Converter (IM 01E20C01-01E) or the AXFA14 Magnetic Flowmeter Remote Converter/AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

(2) Tightening Nuts


Tighten the bolts according to the torque values for the metal piping in Table 3.3.14. For PVC piping, select an optional code of GA, GC, or GD, use rubber gaskets and tighten the nuts to the torque values for the PVC piping in Table 3.3.15.

For permeable fluids (such as nitric acid, hydrofluoric acid, or sodium hydrate at high temperatures), tighten the nuts according to the torque values in Table 3.3.16.



CAUTION

For a flowmeter with fluorocarbon PFA lining, it is possible that the nuts may loosen as time passes, so tighten them regularly. Be sure to tighten the nuts according to the prescribed torque values. Tighten them diagonally with the same torque values, step by step up to the prescribed torque value.

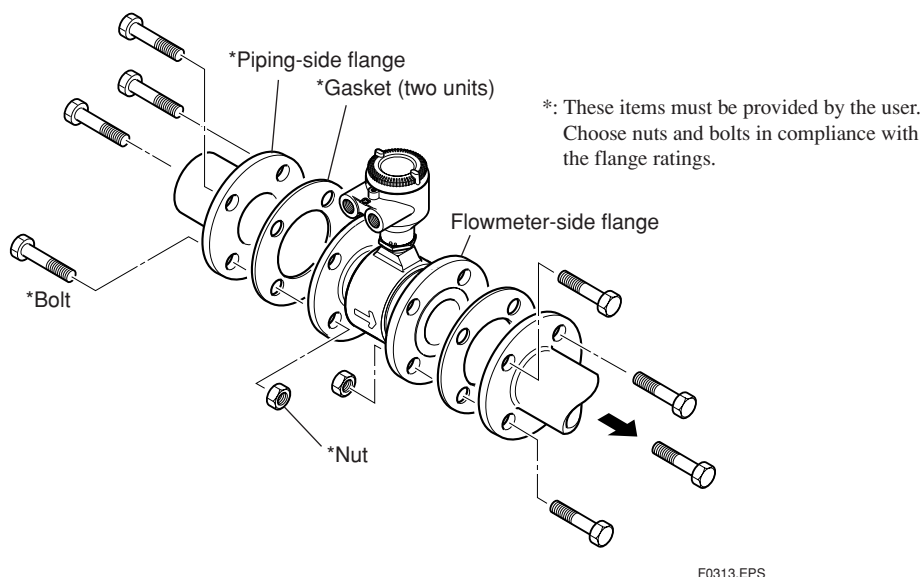

F0313.EPS

Figure 3.3.5 Mounting Procedure for Flange Type (size: 2.5 mm (0.1 in.) to 400 mm (16 in.))

Table 3.3.14 Flange Type Tightening Torque Values for Metal Piping

| Tightening torque values for PFA/Polyurethane Rubber/Natural Soft Rubber/EPDM Rubber lining type | | | | | | | | Unit: N·m {kgf·cm} {in·lbf} |
|--|---|--|--|--|--|--|--|---|
| Gasket types within flowtube | No gasket (standard) | | | | | | | |
| Gasket types for user's flange | Non-asbestos gasket, PTFE-sheathed non-asbestos gasket, or the equivalent in hardness | | | | | | | |
| Size mm (inch) / Flange ratings | JIS 10K | ANSI Class 150 | DIN PN10 | JIS20K | ANSI Class 300 | DIN PN16 | DIN PN40 | JIS F12 (JIS 75M) |
| 2.5 (0.1) (with 10-mm flanges) | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | — | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | — | 3.8 to 6.4 {38.75 to 65.26} {33.63 to 56.64} | — |
| 2.5 (0.1) (with 15-mm flanges) | 4.6 to 7.7 {46.91 to 78.52} {40.71 to 68.15} | 4.6 to 7.7 {46.91 to 78.52} {40.71 to 68.15} | — | 4.7 to 7.8 {47.93 to 79.54} {41.6 to 69.03} | 4.7 to 7.8 {47.93 to 79.54} {41.6 to 69.03} | — | 4.7 to 7.9 {47.93 to 80.56} {41.6 to 69.92} | — |
| 5 (0.2) (with 10-mm flanges) | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | — | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | — | 3.8 to 6.4 {38.75 to 65.26} {33.63 to 56.64} | — |
| 5 (0.2) (with 15-mm flanges) | 4.6 to 7.7 {46.91 to 78.52} {40.71 to 68.15} | 4.6 to 7.7 {46.91 to 78.52} {40.71 to 68.15} | — | 4.7 to 7.8 {47.93 to 79.54} {41.6 to 69.03} | 4.7 to 7.8 {47.93 to 79.54} {41.6 to 69.03} | — | 4.7 to 7.9 {47.93 to 80.56} {41.6 to 69.92} | — |
| 10 (0.4) (with 10-mm flanges) | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | — | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | 3.8 to 6.3 {38.75 to 64.24} {33.63 to 55.76} | — | 3.8 to 6.4 {38.75 to 65.26} {33.63 to 56.64} | — |
| 10 (0.4) (with 15-mm flanges) | 4.6 to 7.7 {46.91 to 78.52} {40.71 to 68.15} | 4.6 to 7.7 {46.91 to 78.52} {40.71 to 68.15} | — | 4.7 to 7.8 {47.93 to 79.54} {41.6 to 69.03} | 4.7 to 7.8 {47.93 to 79.54} {41.6 to 69.03} | — | 4.7 to 7.9 {47.93 to 80.56} {41.6 to 69.92} | — |
| 15 (0.5) | 4.6 to 7.7 {46.91 to 78.52} {40.71 to 68.15} | 4.6 to 7.7 {46.91 to 78.52} {40.71 to 68.15} | — | 4.7 to 7.8 {47.93 to 79.54} {41.6 to 69.03} | 4.7 to 7.8 {47.93 to 79.54} {41.6 to 69.03} | — | 4.7 to 7.9 {47.93 to 80.56} {41.6 to 69.92} | — |
| 25 (1.0) | 13.1 to 15.1 {133.6 to 154.0} {113.9 to 133.6} | 13.1 to 15.1 {133.6 to 154.0} {113.9 to 133.6} | — | 13.2 to 15.2 {134.6 to 155.0} {116.8 to 134.5} | 13.2 to 15.2 {134.6 to 155.0} {116.8 to 134.5} | — | 11.9 to 13.7 {121.3 to 139.7} {105.3 to 121.3} | — |
| 32 (1.25) | 14.4 to 15.6 {146.8 to 159.1} {127.4 to 138.1} | 14.4 to 15.6 {146.8 to 159.1} {127.4 to 138.1} | — | 14.6 to 16.8 {148.9 to 171.3} {129.2 to 148.7} | 14.6 to 16.8 {148.9 to 171.3} {129.2 to 148.7} | — | 15.0 to 17.3 {153.0 to 176.4} {132.8 to 153.1} | — |
| 40 (1.5) | 21.9 to 25.2 {223.3 to 257.0} {193.8 to 223.0} | 21.9 to 25.2 {223.3 to 257.0} {193.8 to 223.0} | — | 22.2 to 25.5 {226.4 to 260.0} {196.5 to 225.7} | 22.2 to 25.5 {226.4 to 260.0} {196.5 to 225.7} | — | 23.2 to 26.7 {236.6 to 272.3} {205.3 to 236.3} | — |
| 50 (2.0) | 28.0 to 32.2 {285.5 to 328.3} {247.8 to 285.0} | 28.0 to 32.2 {285.5 to 328.3} {247.8 to 285.0} | — | 27.8 to 32.0 {283.5 to 326.3} {246.0 to 283.2} | 27.8 to 32.0 {283.5 to 326.3} {246.0 to 283.2} | — | 28.8 to 33.1 {293.7 to 337.5} {254.9 to 293.0} | — |
| 65 (2.5) | 41.6 to 47.8 {424.2 to 487.4} {368.2 to 423.0} | 41.6 to 47.8 {424.2 to 487.4} {368.2 to 423.0} | — | 19.5 to 28.5 {198.8 to 290.6} {172.6 to 252.2} | 19.5 to 28.5 {198.8 to 290.6} {172.6 to 252.2} | 41.4 to 47.6 {422.2 to 485.4} {366.4 to 421.3} | — | — |
| 80 (3.0) | 23.2 to 26.7 {236.6 to 272.3} {205.3 to 236.3} | 52.7 to 53.6 {536.9 to 546.2} {466.0 to 474.1} | — | 26.1 to 30.0 {266.1 to 305.9} {231.0 to 265.5} | 26.1 to 30.0 {266.1 to 305.9} {231.0 to 265.5} | 26.1 to 30.0 {266.1 to 305.9} {231.0 to 265.5} | — | 46.0 to 52.9 {469.1 to 539.4} {407.1 to 468.2} |
| 100 (4.0) | 30.9 to 35.5 {315.1 to 362.0} {273.5 to 314.2} | 30.9 to 35.5 {315.1 to 362.0} {273.5 to 314.2} | — | 34.8 to 40.0 {354.9 to 407.9} {308.0 to 354.0} | 34.8 to 40.0 {354.9 to 407.9} {308.0 to 354.0} | 34.8 to 40.0 {354.9 to 407.9} {308.0 to 354.0} | — | 60.9 to 70.0 {621.0 to 713.8} {539.0 to 619.5} |
| 125 (5.0) | 45.6 to 52.4 {465.0 to 534.3} {403.6 to 463.8} | 45.6 to 52.4 {465.0 to 534.3} {403.6 to 463.8} | — | 48.6 to 55.9 {495.6 to 570.0} {430.1 to 494.7} | 48.6 to 55.9 {495.6 to 570.0} {430.1 to 494.7} | 48.6 to 55.9 {495.6 to 570.0} {430.1 to 494.7} | — | 48.1 to 55.3 {490.5 to 563.9} {425.7 to 489.4} |
| 150 (6.0) | 64.5 to 74.2 {657.7 to 756.6} {570.8 to 656.7} | 64.5 to 74.2 {657.7 to 756.6} {570.8 to 656.7} | — | 44.8 to 51.5 {456.8 to 525.2} {396.5 to 455.8} | 44.8 to 51.5 {456.8 to 525.2} {396.5 to 455.8} | 66.7 to 80.8 {680.2 to 823.9} {590.3 to 715.1} | — | 67.5 to 77.6 {688.3 to 791.3} {597.4 to 686.8} |
| 200 (8.0) | 59.2 to 68.1 {603.7 to 694.4} {523.9 to 602.7} | 100.3 to 102.1 {1023 to 1041} {887.8 to 903.3} | 100.3 to 102.1 {1023 to 1041} {887.8 to 903.3} | 63.6 to 73.1 {648.5 to 745.4} {562.9 to 647.0} | 63.6 to 73.1 {648.5 to 745.4} {562.9 to 647.0} | 63.6 to 73.1 {648.5 to 745.4} {562.9 to 647.0} | — | 69.9 to 80.4 {712.8 to 819.9} {618.6 to 711.6} |
| 250 (10) | 144.0 to 165.6 {1468 to 1689} {1274 to 1466} | 144.0 to 165.6 {1468 to 1689} {1274 to 1466} | 144.0 to 165.6 {1468 to 1689} {1274 to 1466} | 156.3 to 179.7 {1594 to 1832} {1383 to 1590} | 127.2 to 148.8 {1297 to 1517} {1126 to 1317} | 156.3 to 179.7 {1594 to 1832} {1383 to 1590} | — | 190.5 to 219.1 {1943 to 2234} {1686 to 1939} |
| 300 (12) | 119.3 to 137.2 {1217 to 1399} {1056 to 1214} | 163.1 to 197.4 {1663 to 2013} {1443 to 1747} | 163.1 to 197.4 {1663 to 2013} {1443 to 1747} | 123.1 to 136.3 {1255 to 1390} {1089 to 1206} | 152.3 to 169.4 {1553 to 1727} {1348 to 1499} | 173.3 to 199.3 {1767 to 2032} {1534 to 1764} | — | 168.0 to 193.2 {1713 to 1970} {1487 to 1710} |
| 350 (14) | 164.7 to 189.4 {1679 to 1931} {1458 to 1676} | 256.4 to 293.3 {2615 to 2991} {2269 to 2596} | 164.7 to 189.4 {1679 to 1931} {1458 to 1676} | — | — | — | — | 238.6 to 274.4 {2433 to 2798} {2112 to 2429} |
| 400 (16) | 225.2 to 258.9 {2296 to 2640} {1993 to 2291} | 225.2 to 258.9 {2296 to 2640} {1993 to 2291} | 225.2 to 258.9 {2296 to 2640} {1993 to 2291} | — | — | — | — | 305.8 to 351.7 {3118 to 3586} {2706 to 3113} |

T0314.EPS

Table 3.3.15 Flange Type Tightening Torque Values for PVC Piping

| Tightening torque values for PFA lining type | | | | | | | | Unit: N·m {kgf·cm} [in·lb] |
|--|---|--|--|--|--|--|--|--|
| Gasket types within flowtube | Fluororubber gasket (optional codes GA, GC, and GD) | | | | | | | |
| Gasket types for user's flange | Fluororubber gasket, chloroprene rubber gasket, or the equivalent in hardness | | | | | | | |
| Flange ratings Size mm (inch) | JIS 10K | ANSI Class 150 | DIN PN10 | JIS20K | ANSI Class 300 | DIN PN16 | DIN PN40 | JIS F12 (JIS 75M) |
| 2.5 (0.1) (with 10-mm flanges) | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | — | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | — | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | — |
| 2.5 (0.1) (with 15-mm flanges) | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — |
| 5 (0.2) (with 10-mm flanges) | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | — | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | — | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | — |
| 5 (0.2) (with 15-mm flanges) | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — |
| 10 (0.4) (with 10-mm flanges) | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | — | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | — | 0.8 to 1.3 {8.158 to 13.26} [7.08 to 11.51] | — |
| 10 (0.4) (with 15-mm flanges) | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — |
| 15 (0.5) | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — | 0.9 to 1.6 {9.177 to 16.32} [7.966 to 14.16] | — |
| 25 (1.0) | 2.7 to 4.5 {27.53 to 45.89} [23.9 to 39.83] | 2.7 to 4.5 {27.53 to 45.89} [23.9 to 39.83] | — | 2.7 to 4.5 {27.53 to 45.89} [23.9 to 39.83] | 2.7 to 4.5 {27.53 to 45.89} [23.9 to 39.83] | — | 2.3 to 3.9 {23.45 to 39.77} [20.36 to 34.52] | — |
| 32 (1.25) | 3.0 to 4.9 {30.59 to 49.97} [26.55 to 43.37] | 3.0 to 4.9 {30.59 to 49.97} [26.55 to 43.37] | — | 3.0 to 5.0 {30.59 to 50.99} [26.55 to 44.25] | 3.0 to 5.0 {30.59 to 50.99} [26.55 to 44.25] | — | 2.9 to 4.9 {29.57 to 49.97} [25.67 to 43.37] | — |
| 40 (1.5) | 4.5 to 7.6 {45.89 to 77.5} [39.83 to 67.26] | 4.5 to 7.6 {45.89 to 77.5} [39.83 to 67.26] | — | 4.7 to 7.8 {47.93 to 79.54} [41.6 to 69.03] | 4.7 to 7.8 {47.93 to 79.54} [41.6 to 69.03] | — | 4.4 to 7.4 {44.87 to 75.46} [38.94 to 65.49] | — |
| 50 (2.0) | 5.9 to 9.8 {60.16 to 99.93} [52.22 to 86.74] | 5.9 to 9.8 {60.16 to 99.93} [52.22 to 86.74] | — | 2.9 to 4.8 {29.57 to 48.95} [25.67 to 42.48] | 2.9 to 4.8 {29.57 to 48.95} [25.67 to 42.48] | — | 5.5 to 9.2 {56.08 to 93.81} [48.68 to 81.43] | — |
| 65 (2.5) | 9.0 to 15.0 {91.8 to 153.0} [79.7 to 132.8] | 9.0 to 15.0 {91.8 to 153.0} [79.7 to 132.8] | — | 2.1 to 4.4 {21.4 to 44.9} [18.6 to 38.9] | 2.1 to 4.4 {21.4 to 44.9} [18.6 to 38.9] | 4.4 to 7.3 {44.9 to 74.4} [38.9 to 64.6] | — | — |
| 80 (3.0) | 4.9 to 8.1 {50.0 to 82.6} [43.4 to 71.7] | 11.1 to 16.3 {113.2 to 166.2} [98.2 to 144.3] | — | 5.5 to 9.1 {56.1 to 92.8} [48.7 to 80.5] | 5.5 to 9.1 {56.1 to 92.8} [48.7 to 80.5] | 5.5 to 9.1 {56.1 to 92.8} [48.7 to 80.5] | — | 9.7 to 12.2 {98.9 to 124.4} [85.8 to 108.0] |
| 100 (4.0) | 6.7 to 11.2 {68.3 to 114.2} [59.3 to 99.1] | 6.7 to 11.2 {68.3 to 114.2} [59.3 to 99.1] | — | 7.5 to 12.6 {76.5 to 128.5} [66.4 to 111.5] | 7.5 to 12.6 {76.5 to 128.5} [66.4 to 111.5] | 7.5 to 12.6 {76.5 to 128.5} [66.4 to 111.5] | — | 13.3 to 22.2 {135.6 to 226.4} [117.7 to 196.5] |
| 125 (5.0) | 9.9 to 16.5 {101.0 to 168.3} [87.6 to 146.0] | 9.9 to 16.5 {101.0 to 168.3} [87.6 to 146.0] | — | 10.7 to 17.8 {109.1 to 181.5} [94.7 to 157.5] | 10.7 to 17.8 {109.1 to 181.5} [94.7 to 157.5] | 10.7 to 17.8 {109.1 to 181.5} [94.7 to 157.5] | — | 10.5 to 17.6 {107.1 to 179.5} [92.9 to 155.8] |
| 150 (6.0) | 14.4 to 24.0 {146.8 to 244.7} [127.4 to 212.4] | 14.4 to 24.0 {146.8 to 244.7} [127.4 to 212.4] | — | 9.8 to 16.3 {99.9 to 166.2} [86.7 to 144.3] | 9.8 to 16.3 {99.9 to 166.2} [86.7 to 144.3] | 14.6 to 25.6 {148.9 to 261.0} [129.2 to 226.6] | — | 15.2 to 25.3 {155.0 to 258.0} [134.5 to 223.9] |
| 200 (8.0) | 13.4 to 22.3 {136.6 to 227.4} [118.6 to 197.4] | 22.7 to 33.4 {231.5 to 340.6} [200.9 to 295.6] | 22.7 to 33.4 {231.5 to 340.6} [200.9 to 295.6] | 14.6 to 24.3 {148.9 to 247.8} [129.2 to 215.1] | 14.6 to 24.3 {148.9 to 247.8} [129.2 to 215.1] | 14.6 to 24.3 {148.9 to 247.8} [129.2 to 215.1] | — | 16.1 to 26.9 {164.2 to 274.3} [142.5 to 223.1] |

T0315.EPS

Table 3.3.16 Flange Type Tightening Torque Values for Metal Piping and Permeable Fluids

| Tightening torque values for PFA lining type | | | | | | | | |
|--|---|--|--|--|--|--|--|--|
| | | | | | | | | Unit: $\frac{\text{N}\cdot\text{m}}{\{\text{kgf}\cdot\text{cm}\} \{\text{in}\cdot\text{lb}\}}$ |
| Gasket types within flowtube | No gasket (standard) | | | | | | | |
| Gasket types for user's flange | Non-asbestos gasket, PTFE-sheathed non-asbestos gasket, or the equivalent in hardness | | | | | | | |
| Flange ratings | JIS 10K | ANSI Class 150 | DIN PN10 | JIS20K | ANSI Class 300 | DIN PN16 | DIN PN40 | JIS F12 (JIS 75M) |
| Size mm (inch) | | | | | | | | |
| 2.5 (0.1) (with 10-mm flanges) | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | — | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | — | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | — |
| 2.5 (0.1) (with 15-mm flanges) | 6.9 to 7.9 {70.36 to 80.56} {61.07 to 69.92} | 6.9 to 7.9 {70.36 to 80.56} {61.07 to 69.92} | — | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | — | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | — |
| 5 (0.2) (with 10-mm flanges) | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | — | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | — | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | — |
| 5 (0.2) (with 15-mm flanges) | 6.9 to 7.9 {70.36 to 80.56} {61.07 to 69.92} | 6.9 to 7.9 {70.36 to 80.56} {61.07 to 69.92} | — | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | — | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | — |
| 10 (0.4) (with 10-mm flanges) | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | — | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | — | 5.7 to 6.6 {58.12 to 67.3} {50.45 to 58.41} | — |
| 10 (0.4) (with 15-mm flanges) | 6.9 to 7.9 {70.36 to 80.56} {61.07 to 69.92} | 6.9 to 7.9 {70.36 to 80.56} {61.07 to 69.92} | — | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | — | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | — |
| 15 (0.5) | 6.9 to 7.9 {70.36 to 80.56} {61.07 to 69.92} | 6.9 to 7.9 {70.36 to 80.56} {61.07 to 69.92} | — | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | — | 7.0 to 8.1 {71.38 to 82.6} {61.95 to 71.69} | — |
| 25 (1.0) | 19.6 to 22.5 {199.9 to 229.4} {173.5 to 199.1} | 19.6 to 22.5 {199.9 to 229.4} {173.5 to 199.1} | — | 19.7 to 22.7 {200.9 to 231.5} {174.4 to 200.9} | 19.7 to 22.7 {200.9 to 231.5} {174.4 to 200.9} | — | 17.5 to 20.1 {178.5 to 205.0} {154.9 to 177.9} | — |
| 32 (1.25) | 21.5 to 24.7 {219.2 to 251.9} {190.3 to 218.6} | 21.5 to 24.7 {219.2 to 251.9} {190.3 to 218.6} | — | 21.6 to 24.8 {220.3 to 252.9} {191.2 to 219.5} | 21.6 to 24.8 {220.3 to 252.9} {191.2 to 219.5} | — | 22.1 to 25.4 {225.4 to 259.0} {195.6 to 224.8} | — |
| 40 (1.5) | 32.5 to 37.4 {331.4 to 381.4} {287.6 to 331.0} | 32.5 to 37.4 {331.4 to 381.4} {287.6 to 331.0} | — | 32.8 to 37.7 {334.5 to 384.4} {290.3 to 333.7} | 32.8 to 37.7 {334.5 to 384.4} {290.3 to 333.7} | — | 33.8 to 38.9 {344.7 to 396.7} {299.2 to 344.3} | — |
| 50 (2.0) | 41.3 to 47.5 {421.1 to 484.4} {365.5 to 420.4} | 41.3 to 47.5 {421.1 to 484.4} {365.5 to 420.4} | — | 20.6 to 23.7 {210.1 to 241.7} {182.3 to 209.8} | 20.6 to 23.7 {210.1 to 241.7} {182.3 to 209.8} | — | 42.2 to 48.5 {430.3 to 494.6} {373.5 to 429.3} | — |
| 65 (2.5) | 61.2 to 70.4 {624.1 to 717.9} {541.6 to 623.1} | 61.2 to 70.4 {624.1 to 717.9} {541.6 to 623.1} | — | 14.3 to 21.0 {145.8 to 214.1} {126.6 to 185.9} | 14.3 to 21.0 {145.8 to 214.1} {126.6 to 185.9} | 30.5 to 35.1 {311.0 to 357.9} {269.9 to 310.6} | — | — |
| 80 (3.0) | 34.2 to 39.3 {348.7 to 400.7} {302.7 to 347.8} | 34.2 to 39.3 {348.7 to 400.7} {302.7 to 347.8} | — | 38.5 to 44.3 {392.6 to 451.7} {340.7 to 392.1} | 38.5 to 44.3 {392.6 to 451.7} {340.7 to 392.1} | 38.5 to 44.3 {392.6 to 451.7} {340.7 to 392.1} | — | 68.1 to 78.3 {694.4 to 798.4} {602.7 to 693.0} |
| 100 (4.0) | 45.2 to 52.0 {460.9 to 530.3} {400.0 to 460.2} | 45.2 to 52.0 {460.9 to 530.3} {400.0 to 460.2} | — | 51.0 to 58.7 {520.1 to 598.6} {451.4 to 519.5} | 51.0 to 58.7 {520.1 to 598.6} {451.4 to 519.5} | 51.0 to 58.7 {520.1 to 598.6} {451.4 to 519.5} | — | 89.6 to 103.0 {913.7 to 1050} {793.0 to 911.6} |
| 125 (5.0) | 66.8 to 76.8 {681.2 to 783.1} {591.2 to 679.7} | 66.8 to 76.8 {681.2 to 783.1} {591.2 to 679.7} | — | 70.8 to 81.4 {722.0 to 830.1} {626.6 to 720.4} | 70.8 to 81.4 {722.0 to 830.1} {626.6 to 720.4} | 70.8 to 81.4 {722.0 to 830.1} {626.6 to 720.4} | — | 70.7 to 81.3 {720.9 to 829.0} {625.7 to 719.5} |
| 150 (6.0) | 93.9 to 108.8 {957.5 to 1109} {831.1 to 962.9} | 93.9 to 108.8 {957.5 to 1109} {831.1 to 962.9} | — | 65.4 to 75.2 {666.9 to 766.8} {578.8 to 665.5} | 65.4 to 75.2 {666.9 to 766.8} {578.8 to 665.5} | 97.3 to 118.0 {992.2 to 1203} {861.1 to 1044} | — | 98.8 to 113.6 {1007 to 1158} {874.4 to 1005} |
| 200 (8.0) | 85.8 to 98.7 {874.9 to 1006} {759.4 to 873.5} | 145.4 to 147.9 {1483 to 1508} {1287 to 1309} | 145.4 to 147.9 {1483 to 1508} {1287 to 1309} | 91.5 to 105.2 {933.0 to 1073} {809.8 to 931.1} | 91.5 to 105.2 {933.0 to 1073} {809.8 to 931.1} | 91.5 to 105.2 {933.0 to 1073} {809.8 to 931.1} | — | 101.8 to 117.1 {1038 to 1194} {901.0 to 1036} |
| 250 (10) | 207.8 to 239.0 {2119 to 2437} {1839 to 2115} | 207.8 to 239.0 {2119 to 2437} {1839 to 2115} | 207.8 to 239.0 {2119 to 2437} {1839 to 2115} | 222.9 to 256.3 {2273 to 2614} {1973 to 2268} | 181.4 to 212.2 {1850 to 2164} {1605 to 1878} | 222.9 to 256.3 {2273 to 2614} {1973 to 2268} | — | 277.9 to 319.6 {2834 to 3259} {2460 to 2829} |
| 300 (12) | 171.0 to 196.7 {1744 to 2006} {1513 to 1741} | 233.7 to 283.0 {2383 to 2886} {2068 to 2505} | 233.7 to 283.0 {2383 to 2886} {2068 to 2505} | 130.7 to 144.8 {1333 to 1477} {1157 to 1282} | 161.8 to 180.0 {1650 to 1835} {1432 to 1593} | 184.1 to 211.7 {1877 to 2159} {1629 to 1874} | — | 243.8 to 280.4 {2486 to 2859} {2158 to 2482} |
| 350 (14) | 234.7 to 269.9 {2393 to 2752} {2077 to 2389} | 365.4 to 418.0 {3726 to 4262} {3234 to 3699} | 234.7 to 269.9 {2393 to 2752} {2077 to 2389} | — | — | — | — | 350.6 to 403.2 {3575 to 4112} {3103 to 3568} |
| 400 (16) | 320.0 to 368.0 {3263 to 3753} {2832 to 3257} | 320.0 to 368.0 {3263 to 3753} {2832 to 3257} | 320.0 to 368.0 {3263 to 3753} {2832 to 3257} | — | — | — | — | 448.3 to 515.5 {4571 to 5257} {3968 to 4562} |

T0316.EPS

3.3.5 Nominal Diameter 500 mm (20 in.) to 2600 mm (104 in.), Flange Type



IMPORTANT

Use bolts and nuts in compliance with the flange ratings. Be sure to choose a gasket with inner and outer diameters that does not protrude inside the piping (refer to Table 3.3.13). If the inner diameter of the gasket is too large, or outer diameter of the gasket is too small, fluid leakage may result.

(1) Mounting Direction

Mount the flowmeter so that the flow direction of the fluid to be measured is in line with the direction of the arrow mark on the flowmeter. It may be especially difficult to move large size flowtubes after bringing them into the pit. Check directions before bringing.



IMPORTANT

If it is impossible to match the direction of the arrow mark, the direction of the electrical connection can be changed (only for size 500 mm to 1000 mm). Refer to Section 5.1 to do this properly.

In case the fluid being measured flows against the arrow direction, refer to the parameter **J20: Flow Direction** in the user's manual of the AXFA11 Magnetic Flowmeter Remote Converter (IM 01E20C01-01E).

(2) Carrying Flowtube

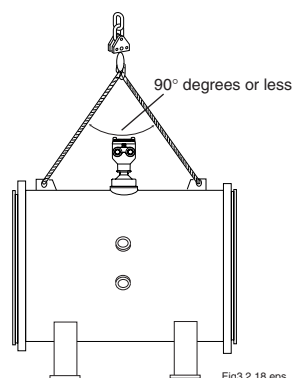


Figure 3.3.6 Lifting Flowtube



CAUTION

- When lifting the flowtube, use the lifting rings (eye bolts or shackle).
- To assure safety, keep lifting angle less than 90 degrees as shown in Figure 3.3.6
- If the size is 1600 mm (64 in.) or larger, use the eye bolts or eye nuts at all four of the locations simultaneously and lift the flowtube. Avoid lifting it from only one location or use only two locations and lift it at 45 degrees.
- Do not shock the installation foundation bracket when installing the flowmeter as the bracket may be damaged.

(3) Positioning Flowtube


Bring in the flowtube, place it in the bracket and use a jack to correct position it for height.



IMPORTANT

Apply the jack to near the flowtube support and insert a steel liner between the bracket and flowtube support. Never use wooden liner. In addition, adjust any misalignment when the flowtube is brought in, as the jack can adjust vertical misalignments, but not horizontal ones.

(4) Installation Foundation Dimensions (Size 500 mm (20 in.) to 1000 mm (40 in.))

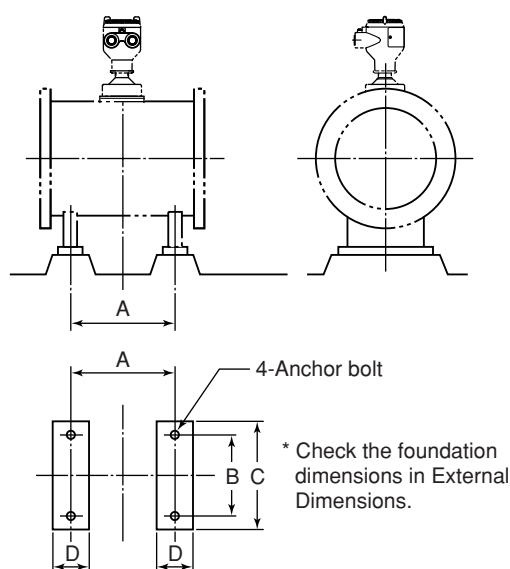

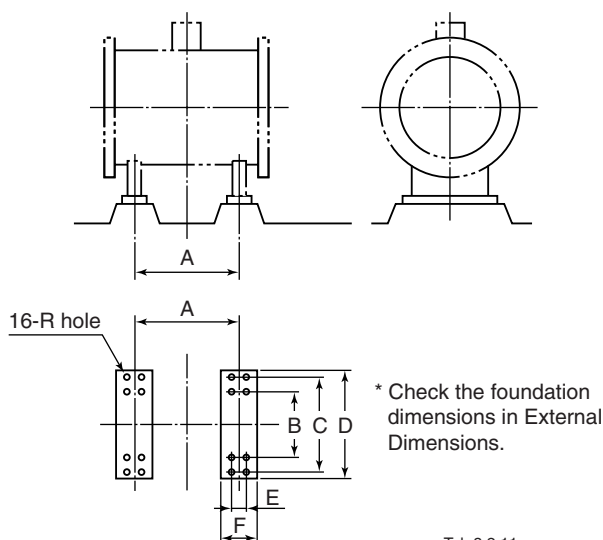
Tab.3.2.10a.eps

Table 3.3.17 Installation Foundation Dimensions (Size 500 mm (20 in.) to 1000 mm (40 in.)).

Unit: mm(approx. inch)

| Location Size mm(inch) | A | B | C | D |
|---------------------------|-----------|-----------|-----------|----------|
| 500 (20) | 350(13.8) | 350(13.8) | 420(16.5) | 125(4.9) |
| 600 (24) | 400(15.7) | 400(15.7) | 470(18.5) | 125(4.9) |
| 700 (28) | 450(17.7) | 500(19.7) | 570(22.4) | 125(4.9) |
| 800 (32) | 550(21.7) | 550(21.7) | 620(24.4) | 125(4.9) |
| 900 (36) | 700(27.6) | 650(25.6) | 720(28.3) | 125(4.9) |
| 1000 (40) | 800(31.5) | 700(27.6) | 770(30.3) | 125(4.9) |

Tab3.2.10b.eps

(5) Installation Foundation Dimensions(Size 1100 mm (44 in.) to 2600 mm (104 in.))

Tab.3.2.11a.eps

Table 3.3.18 Installation Foundation Dimensions (Size 1100 mm (44 in.) to 2600 mm (104 in.))

Unit: mm(approx. inch)

| Location Size mm (inch) | Dimensions | | | | | | |
|-------------------------------|-------------|-----------------|-----------------|--------------|---------------|----------------|--------------|
| | A | B ^{±2} | C ^{±3} | D | E | F | R |
| 1100(44) | 1,211(47.7) | 720(28.3) | 1,100(43.3) | 1,280(50.4) | | | |
| 1200(48) | 1,261(49.6) | 780(30.7) | 1,200(47.2) | 1,380(54.3) | 130 (5.12) | 200 (7.87) | 19 (0.75) |
| 1350(54) | 1,366(53.8) | 880(34.6) | 1,350(53.1) | 1,540(60.6) | | | |
| 1500(60) | 1,490(58.7) | 980(38.6) | 1,500(59.1) | 1,700(66.9) | | | |
| 1600(64) | 1,698(66.9) | 1,080(42.5) | 1,650(65.0) | 1,850(72.8) | | | |
| 1800(72) | 1,864(73.4) | 1,180(46.5) | 1,800(70.9) | 2,000(78.7) | 170 (6.69) | 250 (9.84) | |
| 2000(80) | 2,010(79.1) | 1,300(51.2) | 2,000(78.7) | 2,220(87.4) | | | 22 (0.87) |
| 2200(88) | 2,172(85.5) | 1,430(56.3) | 2,200(86.6) | 2,420(95.3) | | | |
| 2400(96) | 2,218(87.3) | 1,560(61.4) | 2,400(94.5) | 2,620(103.1) | 200 (7.87) | 300 (11.81) | |
| 2600(104) | 2,300(90.6) | 1,700(66.9) | 2,600(102.4) | 2,820(111.0) | | | |

Tab3.2.11b.eps

(6) Tightening Nuts

Pass the bolts from pipe line side, not flowtube side, and tighten the bolts according to the torque values for the metal piping in Table 3.3.19

Finish a brackets part with mortar.

**CAUTION**

- Be sure to tighten the nuts according to the prescribed toeque values. Tighten them diagonally with the same torque values, step by up to the prescribed torque value.
- Completely cover the brackets and liners with mortar.

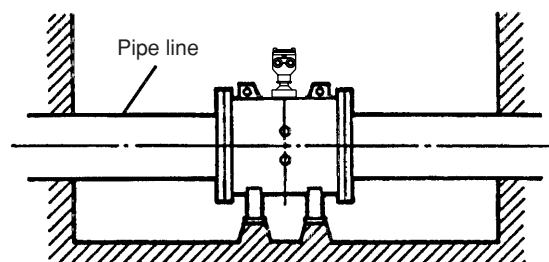
**Figure 3.3.7 Mounting Flowtube**

Table 3.3.19 Flange Type Tightening Torque Values for Material Piping

| | Tightening torque values for Polyurethane Rubber lining (N-m / {kgf-cm} / [in-lbf]) | | | |
|-------------------------------------|---|--|--|--|
| Gasket types within | Size 500 to 1000 mm: No gasket Size 1100 to 2600 mm: Butadiene-styrene-rubber+Natural rubber | | | |
| Gasket types for user's | Rubber gasket, or the equivalent in hardness | | | |
| Flange ratings Size mm (inch) | JIS 10K | ANSI Class150 | DIN PIN10 | JIS F12 (JIS 75M) |
| 500 (20) | 43 to 72 / {438.5 to 734.2} / [380.6 to 637.2] | 51 to 85 / {520.1 to 866.8} / [451.4 to 752.3] | 43 to 71 / {438.5 to 724.0} / [380.6 to 628.4] | 61 to 102 / {622.0 to 1040} / [539.9 to 902.7] |
| 600 (24) | 52 to 87 / {530.3 to 887.2} / [460.2 to 770.0] | 82 to 137 / {836.2 to 1397} / [725.7 to 1213] | 64 to 107 / {652.6 to 1091} / [566.4 to 947.0] | 65 to 108 / {662.8 to 1101} / [575.3 to 955.8] |
| 700 (28) | 69 to 116 / {703.6 to 1183} / [610.7 to 1027] | — | 71 to 118 / {724.0 to 1203} / [628.4 to 1044] | 84 to 141 / {856.6 to 1438} / [743.4 to 1248] |
| 800 (32) | 71 to 119 / {724.0 to 1213} / [628.4 to 1053] | — | 94 to 157 / {958.5 to 1601} / [831.9 to 1390] | 81 to 136 / {826.0 to 1387} / [716.9 to 1204] |
| 900 (36) | 93 to 155 / {948.3 to 1581} / [823.1 to 1372] | — | 101 to 168 / {1030 to 1713} / [893.9 to 1487] | 98 to 163 / {999.3 to 1662} / [867.3 to 1443] |
| 1000 (40) | 150 to 249 / {1530 to 2539} / [1328 to 2204] | — | 147 to 245 / {1499 to 2498} / [1301 to 2168] | 117 to 195 / {1193 to 1988} / [1035 to 1076] |
| 1100 (44) | — | — | — | 180 to 300 / {1835 to 3059} / [1593 to 2655] |
| 1200 (48) | — | — | — | 177 to 294 / {1805 to 2998} / [1567 to 2602] |
| 1350 (54) | — | — | — | 254 to 423 / {2590 to 4313} / [2248 to 3744] |
| 1500 (60) | — | — | — | 277 to 462 / {2825 to 4711} / [2542 to 4089] |
| 1600 (64) | — | — | — | 268 to 446 / {2733 to 4548} / [2372 to 3947] |
| 1800 (72) | — | — | — | 243 to 406 / {2478 to 4140} / [2151 to 3593] |
| 2000 (80) | — | — | — | 331 to 551 / {3375 to 5619} / [2929 to 4877] |
| 2200 (88) | — | — | — | 376 to 626 / {3834 to 6383} / [3328 to 5540] |
| 2400 (96) | — | — | — | 406 to 677 / {4140 to 6904} / [3593 to 5992] |
| 2600 (104) | — | — | — | 542 to 903 / {5527 to 9208} / [4797 to 7992] |

Tab.3.3.19.EPS

3.3.6 Sanitary Type

The sanitary type can be mounted to the piping using a clamp, a union, or a welded joint.



NOTE

This section describes the remote flowtube as an example. The same procedure also applies to the integral flowmeter.

Sanitary adapters are engraved with character as identification.

Table 3.3.20 Sanitary Adapter Identification

| Identification Character | Material for Adapter |
|--------------------------|----------------------|
| No mark | SUS304 |
| F | SUSF304 |
| L | SUS316L |
| FL | SUSF316L |

T3.3.20.EPS

(1) Mounting Direction

Mount the flowmeter so that the flow direction of the fluid to be measured is in line with the direction of the arrow mark on the flowmeter.



IMPORTANT

If it is impossible to match the direction of the arrow mark, the direction of the electrical connection can be changed. Refer to Section 5.1 to do this properly.

In case the fluid being measured flows against the arrow direction, refer to the parameter **J20: Flow Direction** in the user's manual of the AXFA11 Magnetic Flowmeter Remote Converter (IM 01E20C01-01E) or the AXFA14 Magnetic Flowmeter Remote Converter/AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

(2) Mounting Procedure

(a) Clamp type

(process connection codes: HAB, HDB, and HKB)

1) Welding ferrule

Weld a ferrule to the piping.



IMPORTANT

When welding the ferrule, pay attention to the edge preparation, level differences between the ferrule and the piping, and the welding current to avoid deforming the piping or causing stagnation portion of the fluid.

2) Installing gasket

Install a gasket for clamp to fit in the groove on the ferrule.

3) Positioning flowmeter

Position the flowmeter between the two ferrules.

4) Tightening clamp

Install a clamp to cover the tapered parts of the flowmeter-side adapter and the ferrule, and tighten the clamp screw.

5) Confirmation of adapter mounting screw


After installation of the magnetic flowmeter, be sure to retighten the adapter mounting screw according to Table 3.3.21 or Table 3.3.22.

Be sure to confirm that leakage from adapter connection point does not occur by filling the pipe of the flowtube with fluid.



NOTE

The ferrule, clamp, and gasket are not provided with the flowmeter, and must be provided by the user.

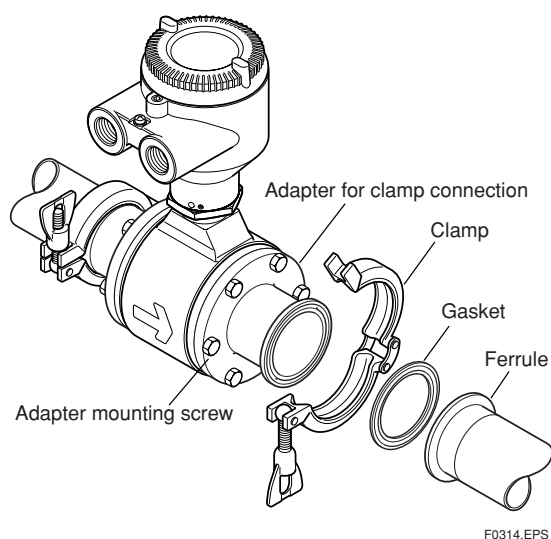

F0314.EPS

Figure 3.3.8 Mounting Procedure for Clamp Connection Type

(b) Union type

(process connection codes: JDB, JKB, and JSB)

1) Welding sleeve

Pass the piping through a nut and then weld a sleeve to the piping.

**IMPORTANT**

- Be sure to weld the sleeve after passing the piping through the nut.
- When welding the sleeve, pay attention to the edge preparation, level differences between the sleeve and the piping, and the welding current to avoid deforming the piping or causing stagnation of some of the fluid.

2) Installing gasket

Install a gasket for union to fit in the groove on the sleeve.

3) Positioning flowmeter

Move the nut closer to the piping temporarily and position the flowmeter between the two sleeves.

4) Tightening nut

Install the nut to cover the tapered parts of the flowmeter-side adapter and the sleeve, and tighten it using a wrench.

5) Confirmation of adapter mounting screw

After installation of the magnetic flowmeter, be sure to retighten the adapter mounting screw according to Table 3.3.21 or Table 3.3.22.

Be sure to confirm that leakage from adapter connection point does not occur by filling the pipe of the flowtube with fluid.

**NOTE**

The sleeve, nut, and gasket are not provided with the flowmeter, and must be provided by the user.

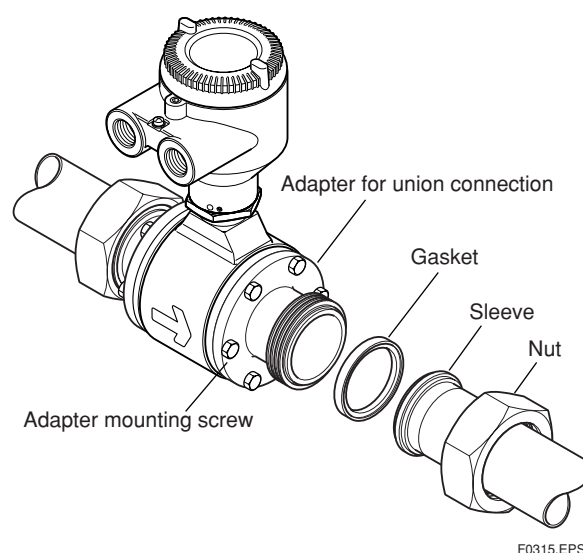


Figure 3.3.9 Mounting Procedure for Union Connection Type

(c) Butt weld adapter type

(process connection codes: KDB and KKB)

1) Removing adapter

Remove the butt weld adapter by loosening the mounting screws.

2) Welding ferrule or sleeve

Weld a ferrule, a sleeve, or an alternative (provided by the user) to the butt weld adapter.

**IMPORTANT**

- Be sure to weld the ferrule, the sleeve, or the alternative after removing the butt weld adapter from the flowmeter itself.
- When welding the ferrule, the sleeve, or the alternative, pay attention to the edge preparation, level differences between them and the piping, and the welding current to avoid deforming the piping or causing stagnation portion of the fluid.

3) Installing butt weld adapter

Install a gasket to fit in the groove of the butt weld adapter, and tighten the mounting screws.

**CAUTION**

- In case of standard gasket (EPDM rubber), tighten the adapter mounting screw according to the torque values in Table 3.3.21.
- In case that optional code GH (Silicon rubber) is selected, tighten the adapter mounting screw according to the torque values in Table 3.3.22.
- Tighten the adapter mounting screw in diagonal order step by step.
- After tightening of screw, confirm that gaskets protrude inside adapter. Protruding of gasket is necessary to keep the sanitary requirements.

Table 3.3.21 Tightening Torque Values of adapter for EPDM rubber gasket

| Tightening torque values (N-m / {kgf-cm} / [in-lbf]) | | |
|--|-------------|--|
| Size mm (inch) | Gasket type | EPDM rubber (standard) |
| 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5) | | 3.0 to 3.5 / {30.59 to 35.69} / [26.55 to 30.98] |
| 50 (2.0), 65 (2.5) | | 4.5 to 5.0 / {45.89 to 50.99} / [39.83 to 44.25] |
| 80 (3.0) | | 8.0 to 9.0 / {81.58 to 91.78} / [70.81 to 79.65] |
| 100 (4.0), 125 (5.0) | | 10 to 11 / {102.0 to 112.2} / [88.50 to 97.35] |

T0502.EPS

Table 3.3.22 Tightening Torque Values of adapter for silicon rubber gasket

| Tightening torque values (N-m / {kgf-cm} / [in-lbf]) | | |
|--|-------------|--|
| Size mm (inch) | Gasket type | Silicon rubber (optional code GH) |
| 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5) | | 2.0 to 2.5 / {20.39 to 25.49} / [17.70 to 22.13] |
| 50 (2.0), 65 (2.5), 80 (3.0) | | 4.0 to 4.5 / {40.79 to 45.89} / [35.40 to 39.83] |
| 100 (4.0), 125 (5.0) | | 6.0 to 6.5 / {61.18 to 66.28} / [53.10 to 57.53] |

T0503.EPS


4) Mounting flowmeter to piping

Connect the flowmeter to the piping in a manner appropriate to the ferrule, the sleeve, or the alternative that has been welded to the adapter.

5) Confirmation of adapter mounting screw

After installation of the magnetic flowmeter, be sure to retighten the adapter mounting screw according to Table 3.3.21 or Table 3.3.22.

Be sure to confirm that leakage from adapter connection point does not occur by filling the pipe of the flowtube with fluid.

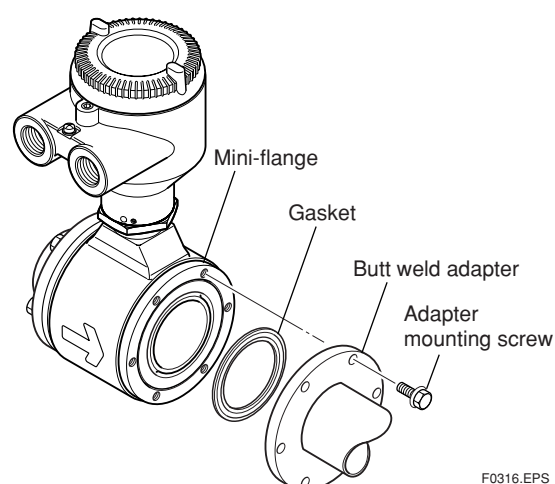

F0316.EPS

Figure 3.3.10 Mounting Procedure for Weld Joint Adapter Type

(3) Maintenance of Sanitary Type

Refer to Section 5.3

4. WIRING

4.1 Wiring the Integral Flowmeter

This section describes the wiring of the integral flowmeter.



WARNING

The wiring of the magnetic flowmeter must be performed by expert engineer or skilled personnel. No operator shall be permitted to perform procedures relating to wiring.



CAUTION

Once all wiring is complete, check the connections before applying power to the instrument. Improper arrangements or wiring may cause a unit malfunction or damage.

4.1.1 Wiring Precautions

Be sure to observe the following precautions when wiring:



CAUTION

- In cases where the ambient temperature exceeds 50°C (122°F), use external heat-resistant wiring with a maximum allowable temperature of 70°C (158°F) or above.
- Do not connect cables outdoors in wet weather in order to prevent damage from condensation and to protect the insulation, e.g. inside the terminal box of the flowmeter.
- All the cable ends must be provided with round crimp-on terminals and be securely wired.
- The signal cables must be routed in separate steel conduit tubes 16 (JIS C 8305) or flexible conduit tubes 15 (JIS C 8309).
- Always route the power and output signal cables in separate steel conduit tubes, except when the power supply voltage is 24 V and four-core cables are used for wiring. Keep conduits or flexible tubes watertight using sealing tape.

- When waterproof glands or union equipped waterproof glands are used, avoid tightening the glands with an excessive torque.
- In case of 24 V power supply version, it comes with a plug. Use this plug to cover the unused wiring port when wiring the instrument with only one, four-core cable.
- Be sure to turn the power off before opening the terminal box cover.
- Before turning the power on, tighten the terminal box cover securely.
- The terminal box cover is locked by the special screw. In case of opening the terminal box cover, use the hexagonal wrench attached. For handling the locking screw, refer to Figure 4.1.5.
- Be sure to lock the cover by the special screw using the hexagonal wrench attached after installing the cover. For handling the locking screw, refer to Figure 4.1.15.
- Explosion protected types must be wired in accordance with specific requirement (and, in certain countries, legal regulations) in order to preserve the effectiveness of their explosion protected features.

4.1.2 Power Cable/Output Cable

JIS C3401 control cable equivalent

JIS C3312 power cable equivalent

14 AWG Belden 8720 equivalent

Outer Diameter:

With no gland option:

6.5 to 12 mm (0.26 to 0.47 in.)

With gland options EG, EU and EW:

10.5 or 11.5 mm (0.41 to 0.45 in.)

With gland options EP:

6 to 12 mm (0.24 to 0.47 in.)

Nominal Cross Section:

Single wire; 0.5 to 2.5 mm²

Stranded wire; 0.5 to 1.5 mm²

In case of power cable, Green/Yellow covered conductor shall be used only for connection to PROTECTIVE CONDUCTOR TERMINALS. Conform to IEC227, IEC245 or equivalent national authorization.

**NOTE**

- For power cables, always use a crimp terminal with an insulation cover.
- Use crimp tools from the manufacturer of the crimp terminal you want to use to connect the crimp terminal and cable.
- Use crimp tools that are appropriate for the diameter of the cable to be connected.

4.1.3 Wiring Ports

This instrument is of watertight construction as stipulated in JIS C0920. It is shipped with a wiring bracket (waterproof gland or waterproof gland with union) or a plastic gland attached, only in cases where an optional specification is selected for the wiring port. In case of the explosion proof type, refer to Chapter 8.

**IMPORTANT**

The wiring port is sealed with a cap (not waterproof). Do not remove the cap from the unused wiring port. If waterproof property is necessary, please use waterproof glands.


(1) When waterproof property is unnecessary (When there are no particular optional specifications)

The wiring port is sealed with a cap (not water-proof) that must be removed before wiring. At this time, handle the wiring port in accordance with the JIS C0920 mentioned above. Do not remove the cap from the unused wiring port.

(2) When waterproof property is necessary (Wiring using waterproof glands)

**IMPORTANT**


To prevent water or condensation from entering the converter housing, waterproof glands are recommended. Do not over-tighten the glands or damage to the cables may result. Tightness of the gland can be checked by confirming that the cable is held firmly in place.

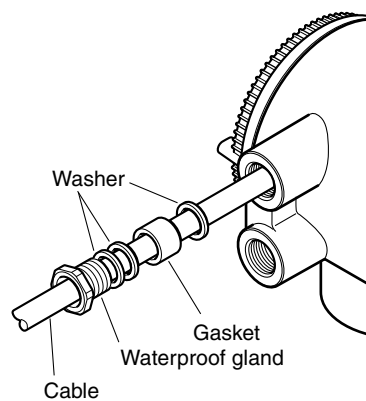

F0401.EPS


Figure 4.1.1 Waterproof Gland (Optional code EG)

For working on the electric wire tubes or the flexible tubes (PF1/2), remove the waterproof gland and attach them directly to the wiring port.

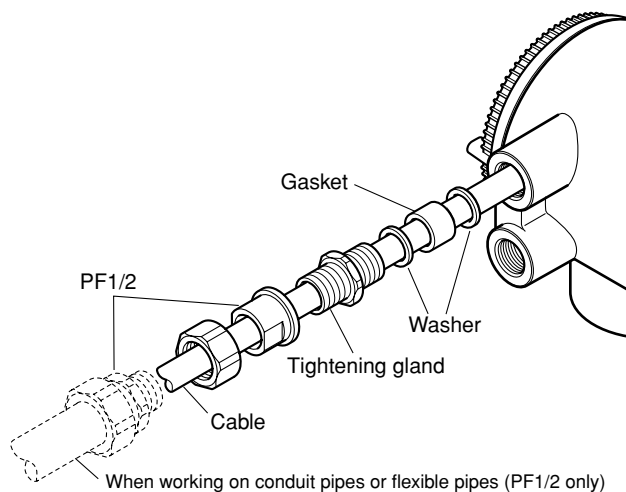

F0402.EPS

Figure 4.1.2 Waterproof Gland with Union Joint (Optional code EU)

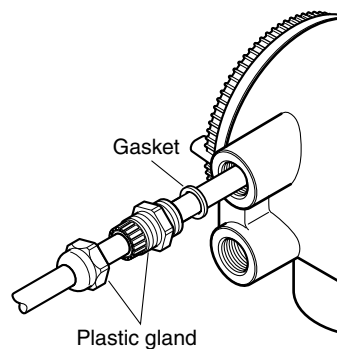

F0403.EPS

Figure 4.1.3 Plastic Gland (Optional code EP)

(3) Conduit Wiring

When wiring the conduits, pass the conduit through the wiring connection port, and utilize the waterproof gland to prevent water from flowing in. Place the conduit pipe on an angle as shown in Figure 4.1.4. Install a drain valve at the low end of the vertical pipe, and open the valve regularly.

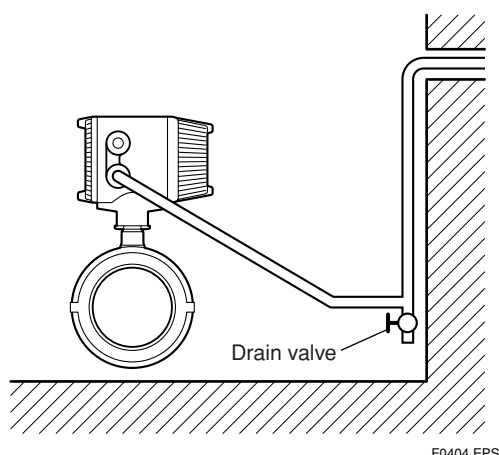


Figure 4.1.4 Conduit Wiring

4.1.4 Wiring Connections

(1) Removing Cover

Loosen cover locking screw 2 clockwise using a hexagonal wrench (nominal size 3) to unlock the cover. (Upon shipment from the manufacturing plant, the cover is unlocked.) Hold the flowmeter with your hand and remove the cover by turning it in the direction of the arrow as shown below.

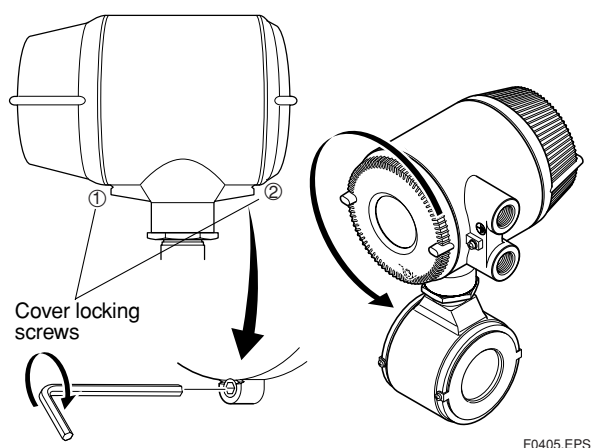


Figure 4.1.5 Removing the Terminal Box Cover

(2) Terminal Configuration

When the cover is removed, the connection terminals will be visible.

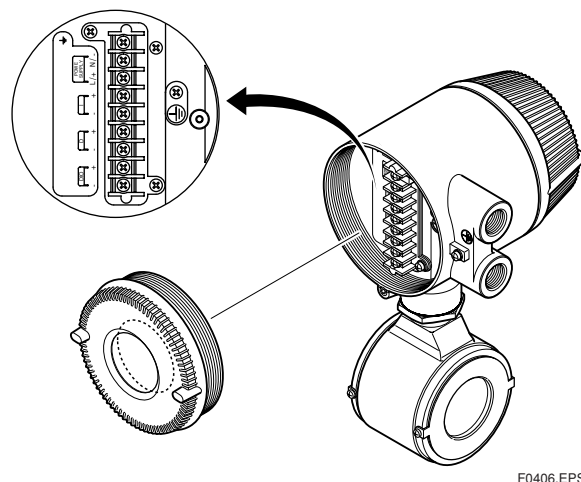


Figure 4.1.6 Terminal Configuration

The description of the terminal symbols is shown in Table 4.1.1.

For FOUNDATION Fieldbus protocol, please refer to IM 01E20F02-01E.

For PROFIBUS PA protocol, please refer to IM 01E20F12-01E.

Table 4.1.1 Terminal Symbols

| Terminal Symbols | Description |
|--|---|
| | Functional grounding |
| $\begin{matrix} N/- \\ L/+ \end{matrix}$ | Power supply |
| $\begin{matrix} I+ \\ I- \end{matrix}$ | Current output 4 to 20mA DC |
| $\begin{matrix} DO+ \\ DO- \end{matrix}$ | Pulse output/Alarm output/ Status output |
| $\begin{matrix} DIO+ \\ DIO- \end{matrix}$ | Alarm output/Status output Status input |
| | Protective grounding (Outside of the terminal) |

T0401.EPS

(3) Precautions for Wiring of Power Supply Cables

When connecting to the power supply, observe the points below. Failure to comply with these warnings may result in an electric shock or damage to the instrument.



WARNING

- Ensure that the power supply is OFF in order to prevent electric shocks.
- Ensure the protective grounding terminal is grounded before turning the power on.
- Use insulating sleeve crimp terminals (for 4-mm screws) for the power supply wiring and protective grounding wiring.

- Install an external switch or circuit breaker as a means to turn the power off (capacitance; 15A, conforming to IEC947-1 and IEC947-3). Locate this switch either near the instrument or in other places facilitating easy operation. Affix a “Power Off Equipment” label to this external switch or circuit breaker.

Wiring Procedure

1. Turn the instrument's power off.
2. Wire the power supply cable and the functional grounding cable to the power supply terminals.

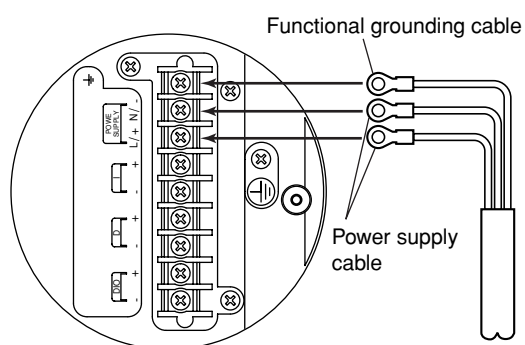


Figure 4.1.7 Electric Cable Wiring

(4) DC Power Connection

When using DC power as the power supply for the converter, give attention to the following points.

1) Connecting Power Supply



IMPORTANT

Do not connect power supply with reversed polarities.

- L/+ terminal: connect +
- N/- terminal: connect -



IMPORTANT


Do not connect power supply with 100 to 240 V AC or 100 to 120 V DC in the case of a 24 V power supply version (power supply code 2). It will give a damage to the converter.

2) Required Power Supply Voltages



IMPORTANT

When using a 24 V power supply, the specification for the supply voltage is 24 V (–15% to +20%), but the input voltage of the converter drops due to cable resistance therefore it must be used within the following ranges.

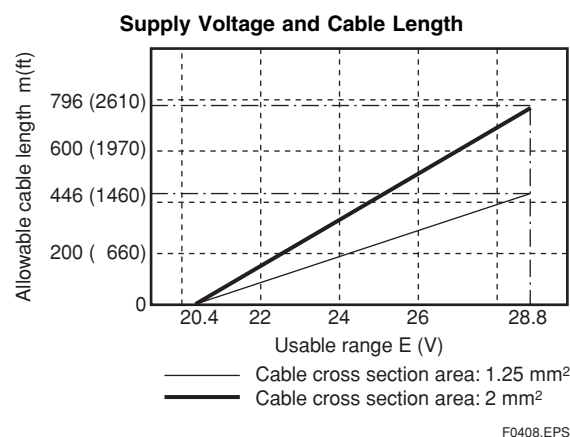

3) Setting Power Supply Frequency



IMPORTANT

Set the local commercial power frequency in order to eliminate the effect of induction noise from the power supply.

Refer to “Chapter 6: Parameter Description” in the user’s manual of the AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

Parameter No.: J30 and J31

(5) Grounding



CAUTION

Be sure to connect the protective grounding of the AXF integral flowmeter with a cable of 2mm² or larger cross section in order to avoid electrical shock to the operators and maintenance engineers and to prevent the influence of external noise.

Connect the grounding wire to the \oplus mark.


The grounding should satisfy Class D requirements (ground resistance, 100 Ω or less).


In case of TIIS Flameproof type, the grounding should satisfy Class C requirements (ground resistance, 10 Ω or less) or class A requirements (ground resistance, 10 Ω or less).

For explosion proof type except TIIS, follow the domestic electrical requirements as regulated in each country.

IMPORTANT

When optional code A (lighting protector) is selected, the ground should satisfy Class C requirements (ground resistance, 10 Ω or less).

- The protective grounding terminals  are located on the inside and outside of the terminal area. Either terminal may be used.
- Use 600 V vinyl insulation wires as the grounding wires.

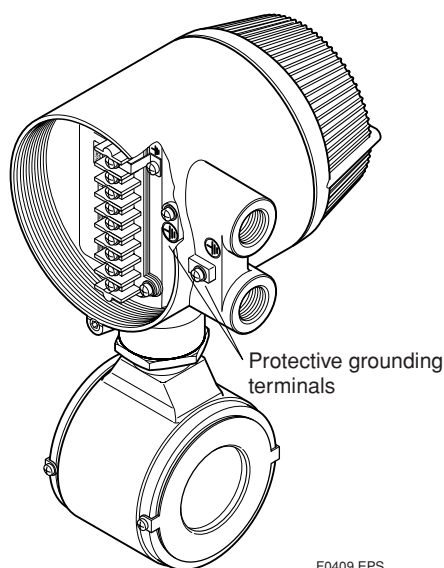



F0409.EPS

Figure 4.1.8 Protective Grounding Terminal Location

IMPORTANT

Improper grounding can have an adverse effect on the flow measurement. Ensure that the instrument is properly grounded.

The electromotive force of the magnetic flowmeter is minute and it is easily affected by noise, and the reference electric potential is the same as that of the measuring fluid. Therefore, the reference electric potential (terminal potential) of the flowtube and converter also need to be the same as that of the measuring fluid. Moreover, the potential must be the same as the ground. The magnetic flowmeter is equipped with an grounding ring that makes a connection with the charge of the measured fluid for grounding and protects the lining. Be sure to ground the flowmeter according to Figure 4.1.9.

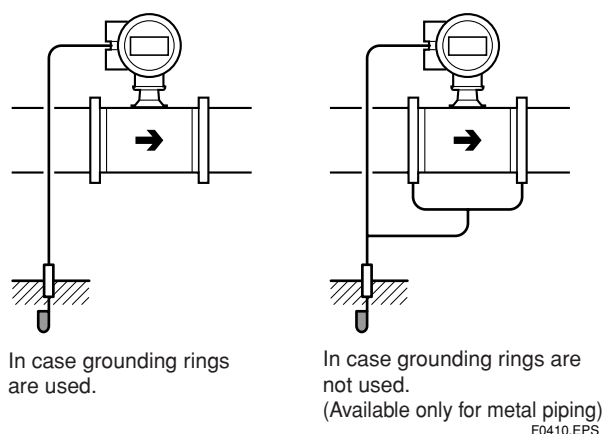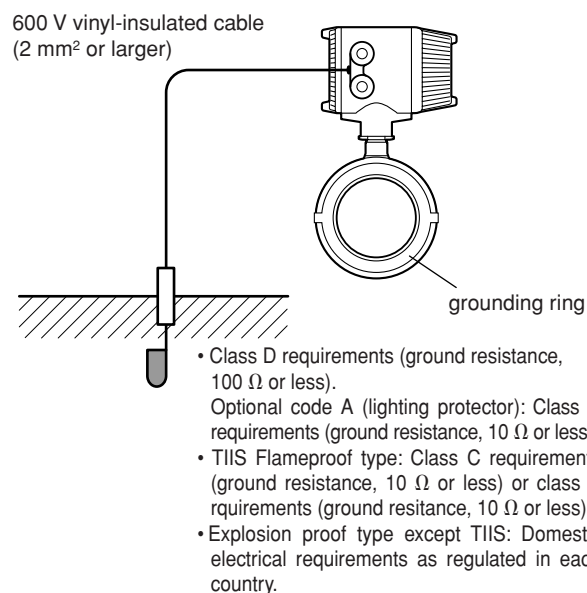

F0410.EPS

Figure 4.1.9 Grounding

(6) Connecting to External Instruments

WARNING

Before wiring with external instruments, be sure to turn off the magnetic flowmeter and any external instruments.

Connect the AXF integral flowmeter terminal to external instruments, giving attention to the following points.

For FOUNDATION Fieldbus protocol, please refer to IM 01E20F02-01E.

For PROFIBUS PA protocol, please refer to IM 01E20F12-01E.

● 4 to 20 mA DC Current Output

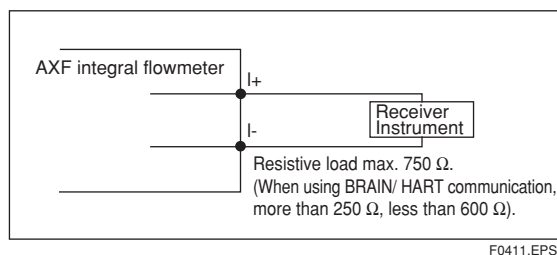


Figure 4.1.10 4 to 20 mA DC Output Connection

● Pulse Output



IMPORTANT

- As this is a transistor contact (insulated type), give attention to proper voltage and polarity when wiring.
- Do not apply a voltage larger than 30V DC or a current larger than 0.2A in order to prevent damage to the instrument.
- When input filter constant of the electronic counter is large in relation to the pulse width, the signal will decrease and the count will not be accurate.
- If the input impedance of the electronic counter is large, an induction noise from the power supply may result in inaccurate counts. Use a shield cable or sufficiently reduce the input impedance of the electronic counter within the electromagnetic flowmeter pulse output specification range.
- The active pulse output (Optional code EM) cannot be used in conjunction with the standard pulse output.
- When the active pulse output (Optional code EM) is selected, do not be short-circuit between the DO+ and DO- terminals to avoid damaging the instrument.
- When the active pulse output (Optional code EM) is selected, the range of pulse rate must be set to 2 pps maximum.

- To avoid communication (BRAIN/ HART) failure, it is recommended to use the shield cable.



NOTE

For pulse output from the DO terminals, parameters must be set. Refer to "Parameter Description" in the user's manual of the AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

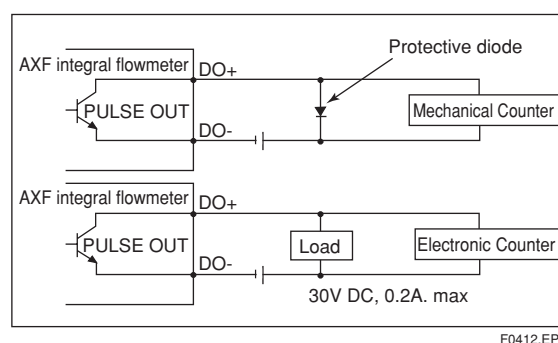


Figure 4.1.11 Pulse Output Connection

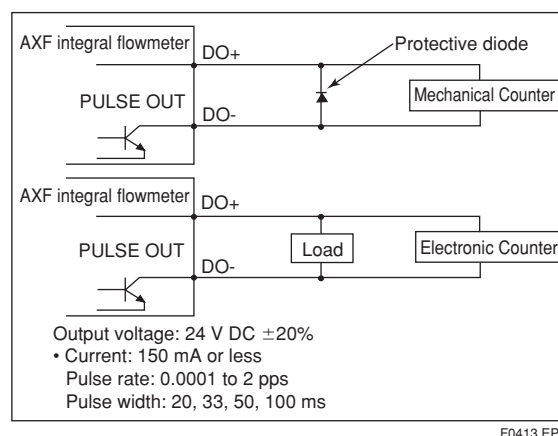


Figure 4.1.12 Active Pulse Output Connection (Optional code EM)

● Status Input



IMPORTANT

Status inputs are designed for use with no-voltage (dry) contacts. Be careful not to connect the status to any signal source carrying voltage. Applying voltage may damage the input circuit.

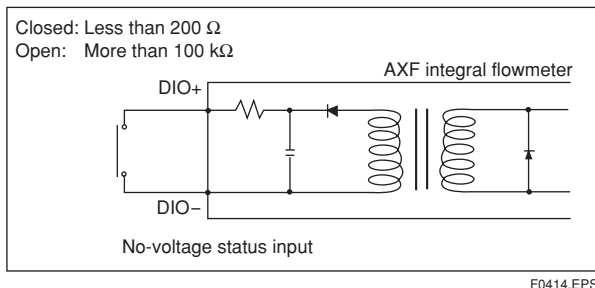


Figure 4.1.13 Status Input Connection



NOTE

For status input to the DIO terminals, parameters must be set. Refer to “Parameter Description” in the user’s manual of the AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

● Status Output / Alarm Output



IMPORTANT

Since this is an isolated transistor output, be careful of voltage and polarity when wiring. Do not apply a voltage larger than 30V DC or a current larger than 0.2A in order to prevent damage to the instrument.

This output cannot switch an AC load. To switch an AC load, an intermediate relay must be inserted as shown in Figure 4.1.14.

*The alarm output operates from open (normal) to closed (alarm occurrence) in the default value (as setup upon plant shipment). Changes can be made via the parameter settings.

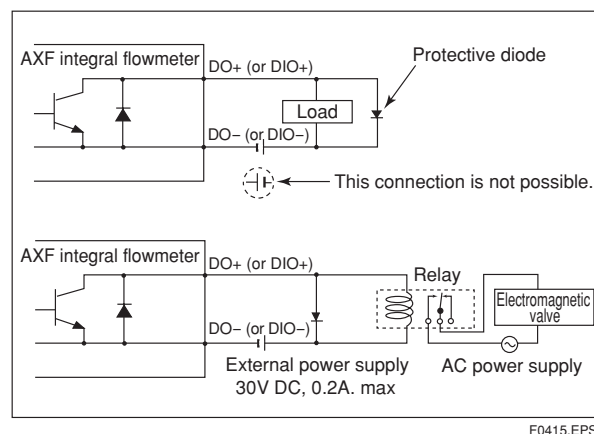


Figure 4.1.14 Status Output/Alarm Output Connection



NOTE

For status and alarm outputs from the DO or DIO terminals, parameters must be set. Refer to “Parameter Description” in the user’s manual of the AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

(7) Installing the Cover

Install the cover to the flowmeter by turning it in the direction of the arrow as shown below. Tighten cover locking screw 2 counterclockwise using a hexagonal wrench (nominal size 3) to lock the cover.

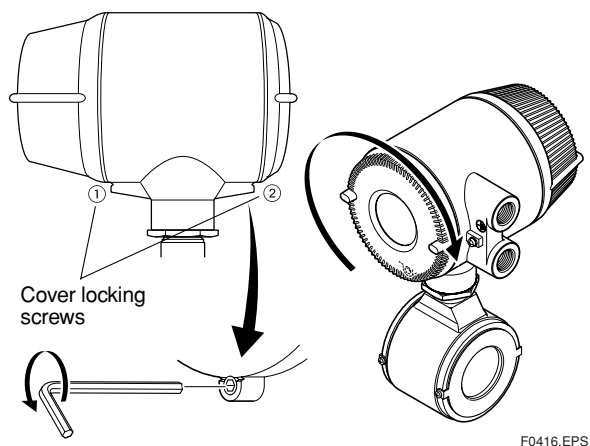


Figure 4.1.15 Installing the Terminal Box Cover

4.2 Wiring the Remote Flowtube

This section describes the wiring of the remote flowtube only. For information relating to the wiring of the converter, refer to the user's manual of the AXFA11 Magnetic Flowmeter Remote Converter (IM 01E20C01-01E) or the AXFA14 Magnetic Flowmeter Remote Converter (IM 01E20C02-01E).



WARNING

The wiring of the magnetic flowmeter must be performed by expert engineer or skilled personnel. No operator shall be permitted to perform procedures relating to wiring.



CAUTION

Once all wiring is complete, check the connections before applying power to the instrument. Improper arrangements or wiring may cause a unit malfunction or damage.

4.2.1 Wiring Precautions

Be sure to observe the following precautions when wiring:




CAUTION

- In cases where the ambient temperature exceeds 50°C (122°F), use external heat-resistant wiring with a maximum allowable temperature of 70°C (158°F) or above.
- Do not connect cables outdoors in wet weather in order to prevent damage from condensation and to protect the insulation, e.g. inside the terminal box of the flowtube.
- Do not splice the cable between the flowtube terminal and the converter if it is too short. Replace the short cable with a cable that is the appropriate length.
- All the cable ends must be provided with round crimp-on terminals and be securely wired.
- The signal cables must be routed in separate steel conduit tubes 16 (JIS C 8305) or flexible conduit tubes 15 (JIS C 8309).
- Keep conduits or flexible tubes watertight using sealing tape.

- Ground the remote flowtube and the converter separately.
- Cover each shield of the signal cable with vinyl tube or vinyl tape to avoid contact between two shields or between a shield and a case.
- When waterproof glands or union equipped waterproof glands are used, avoid tightening the glands with an excessive torque.
- Be sure to turn the power off before opening the terminal box cover.
- Before turning the power on, tighten the terminal box cover securely.
- The terminal box cover of size 2.5 mm to 1000 mm is locked by the special screw. In case of opening the terminal box cover, use the hexagonal wrench attached. For handling the locking screw, refer to Figure 4.2.8.
- Be sure to lock the cover of size 2.5 mm to 1000 mm by the special screw using the hexagonal wrench attached after installing the cover. For handling the locking screw, refer to Figure 4.2.20.
- Explosion protected types must be wired in accordance with specific requirement (and, in certain countries, legal regulations) in order to preserve the effectiveness of their explosion protected features.
- When submersible type or optional code DHC is selected, waterproof glands, signal and excitation cables are attached.
In order to preserve the effectiveness of waterproof features, the terminal box cover and waterproof glands must not be detached from flowmeter.

4.2.2 Cables

(1) Dedicated Signal Cable (AXFC)

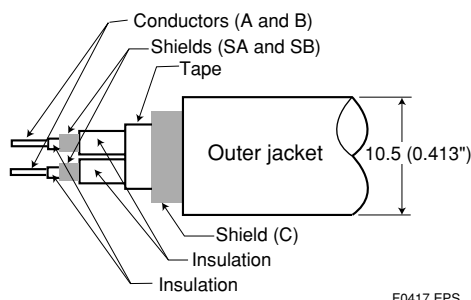

F0417.EPS

Figure 4.2.1 Dedicated Signal Cable AXFC

The flow signal is transmitted via this dedicated cable. The cable is constructed with double shielding over the two conductors, and heat-resistant vinyl is used for the outer jacket material.

Finished diameter: 10.5 mm (0.413")

Maximum length:

Combination with the AXFA11 converter:
200 m (660 ft)


Combination with the AXFA14 converter:
100 m (330 ft)

Maximum temperature: 80°C (176°F)



IMPORTANT

If the cable is longer than required, cut off any extra length rather than coiling it up, and terminate the conductors as shown in Figure 4.2.2. Avoid using junction terminal boards to extend the cable length, as this will interrupt the shielding.

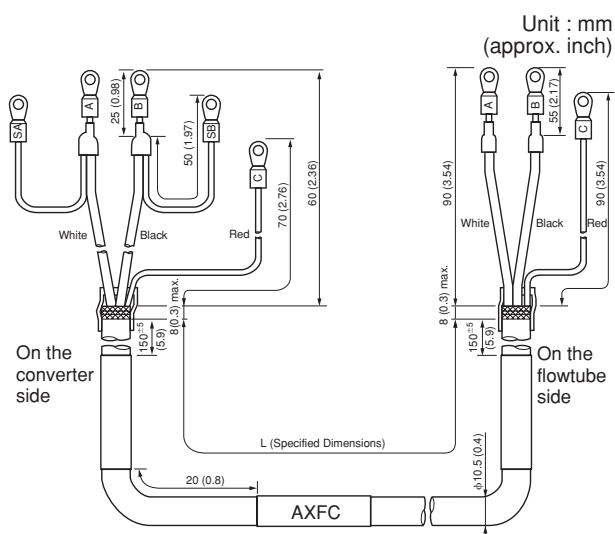

F0418.EPS

Figure 4.2.2 Treatment of Dedicated Signal Cables



CAUTION

- As crimp terminals A, B, SA, SB and C have their own electrical potentials, securely insulate them so as not to come in contact with one another.
- To prevent a shield from coming in contact with another shield or the case, cover each shield with a vinyl tube or wrap it in vinyl tape.



NOTE

Conductors A and B carry the signal from the electrodes, and C is at the potential of the liquid (signal common). Shields SA and SB are kept at the same potentials as the individual electrodes (these are actively driven shields). This is done to reduce the effect of the distributed capacitance of the cable at long cable length. Note that, since the signals from the individual electrodes are impedance converted inside the converter, errors will result if they come in contact with any other component. Great care must be taken in the cable end treatment.

(2) Excitation Cable

JIS C3401 control cable equivalent

JIS C3312 power cable equivalent

14 AWG Belder 8720 equivalent

Outer Diameter:

With no gland option:

6.5 to 12 mm (0.26 to 0.47 in.)

With gland options EG, EU and EW:

10.5 or 11.5 mm (0.41 to 0.45 in.)

With gland options EP:

6 to 12 mm (0.24 to 0.47 in.)

Nominal Cross Section:

Single wire; 0.5 to 2.5 mm²

Stranded wire; 0.5 to 1.5 mm²

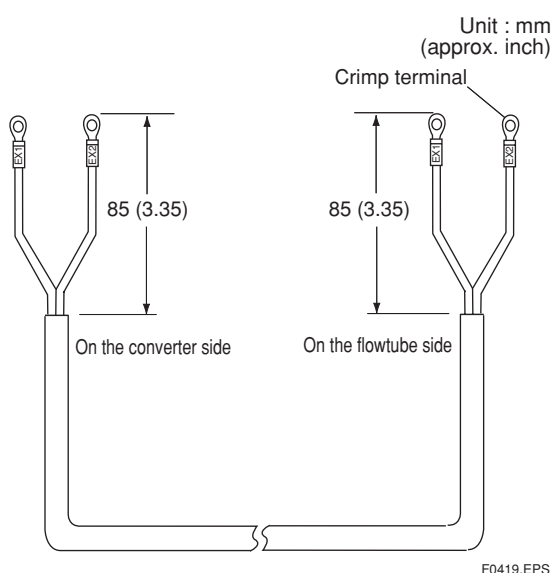


Figure 4.2.3 End Treatment of Excitation Cable

**NOTE**

- For excitation cables, always use a crimp terminal with an insulation cover.
- Use crimp tools from the manufacturer of the crimp terminal you want to use to connect the crimp terminal and cable.
- Use crimp tools that are appropriate for the diameter of the cable to be connected.

4.2.3 Wiring Ports

This instrument is of watertight construction as stipulated in JIS C0920. It is shipped with a wiring bracket (waterproof gland or waterproof gland with union) or a plastic gland attached, only in cases where an optional specification is selected for the wiring port. In case of the explosion proof type, refer to chapter 8.

**IMPORTANT**

The wiring port is sealed with a cap (not waterproof). Do not remove the cap from the unused wiring port. If waterproof property is necessary, please use waterproof glands.

(1) When waterproof property is unnecessary (When there are no particular optional specifications)

The wiring port is sealed with a cap (not water-proof) that must be removed before wiring. At this time, handle the wiring port in accordance with the JIS C0920 mentioned above. Do not remove the cap from the unused wiring port.

(2) When waterproof property is necessary (Wiring using waterproof glands)

**IMPORTANT**

To prevent water or condensation from entering the converter housing, waterproof glands are recommended. Do not over-tighten the glands or damage to the cables may result. Tightness of the gland can be checked by confirming that the cable is held firmly in place.

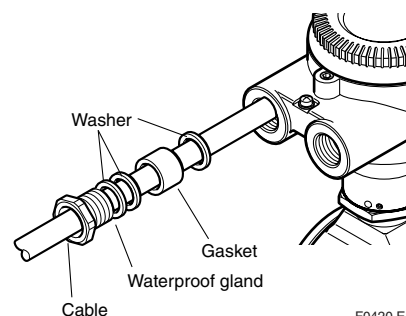


Figure 4.2.4 Waterproof Gland (Optional code EG)


For working on the electric wire tubes or the flexible tubes (PF1/2), remove the waterproof gland and attach them directly to the wiring port.

4.2.4 Wiring Connections




WARNING

Before wiring, be sure that the power supply for AXFA11 or AXFA14 converter has been turned off to prevent an electrical shock.

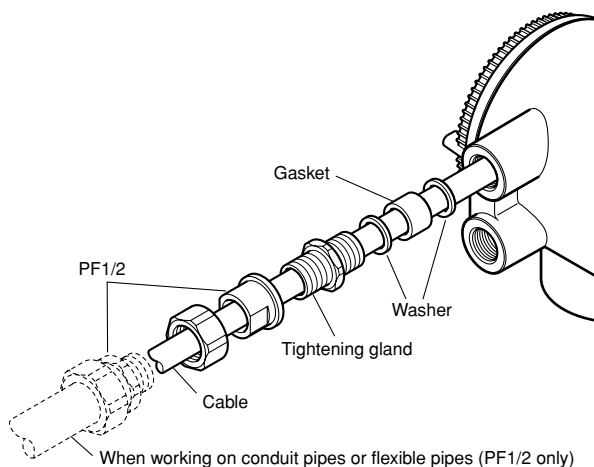

F0421.EPS

Figure 4.2.5 Waterproof Gland with Union Joint (Optional code EU)

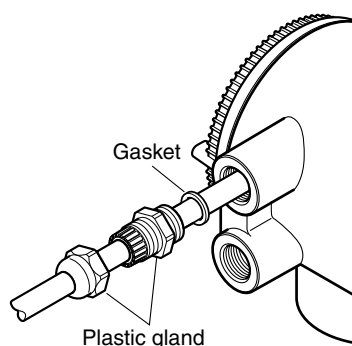


F0422.EPS

Figure 4.2.6 Plastic Gland (Optional code EP)

(3) Conduit Wiring

When wiring the conduits, pass the conduit through the wiring connection port, and utilize the waterproof gland to prevent water from flowing in. Place the conduit pipe on an angle as shown in Figure 4.2.7. Install a drain valve at the low end of the vertical pipe, and open the valve regularly.

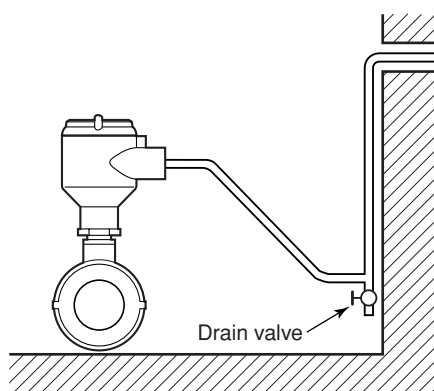


F0423.EPS

Figure 4.2.7 Conduit Wiring

(1) Removing Cover (Size 2.5 to 1000 mm (0.1 to 40 in.))

Loosen the cover locking screw clockwise using a hexagonal wrench (nominal size 3) to unlock the cover. (Upon shipment from the manufacturing plant, the cover is unlocked.) Hold the flowtube with your hand and remove the cover by turning it in the direction of the arrow as shown below.

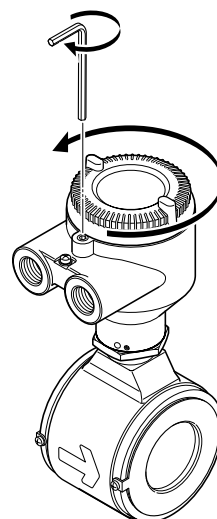


F0424.EPS

Figure 4.2.8 Removing the Terminal Box Cover (Remote Flowtube)

(2) Terminal Configuration

When the cover is removed, the connection terminals will be visible.

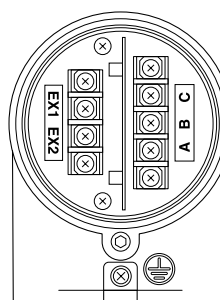

| Terminal Symbols | Description |
|------------------|--|
| A B C | Flow signal output |
| EX1 EX2 | |
| ⊕ | |
| ⊕ | Excitation current input |
| ⊕ | Protective grounding (Outside of the terminal) |

F0425.EPS

Figure 4.2.9 Terminal Configuration (General-Purpose Use, Submersible Type, Sanitary Type, Size 2.5 to 400 mm (0.1 to 16 in.))

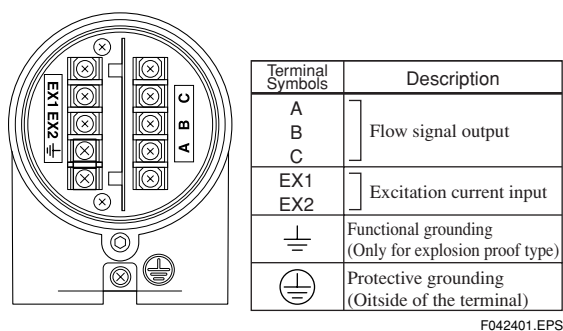


Figure 4.2.10 Terminal Configuration (Explosion proof Type, Size 2.5 to 400 mm (0.1 to 16 in.))

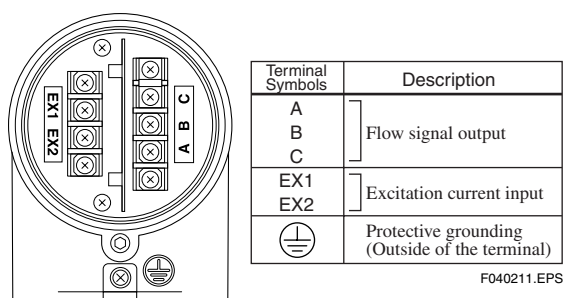


Figure 4.2.11 Terminal Configuration (General-purpose Use, Submersible Type, Size 500 to 1000 mm (20 to 40 in.))

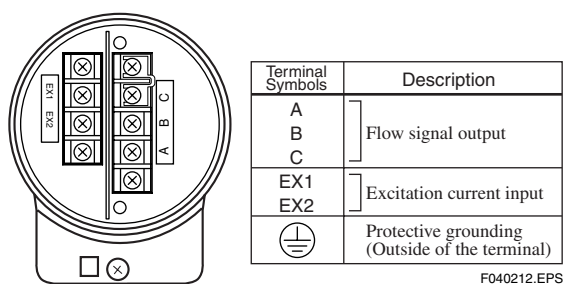


Figure 4.2.12 Terminal Configuration (General-purpose Use, submersible Type, Size 1100 to 2600 mm (44 to 104 in.))

(3) Wiring the Remote Flowtube (General-Purpose Use, Submersible Type, Sanitary Type, Size 2.5 to 400 mm (0.1 to 16 in.)) with Converters

1) Connection with the AXFA11 converter

Connect wiring as shown in the figure below.

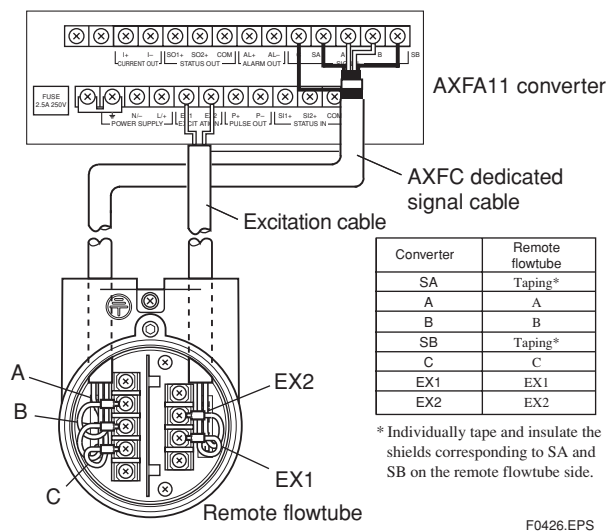


Figure 4.2.13 Wiring Diagram

2) Connection with the AXFA14 converter

Connect wiring as shown in the figure below.

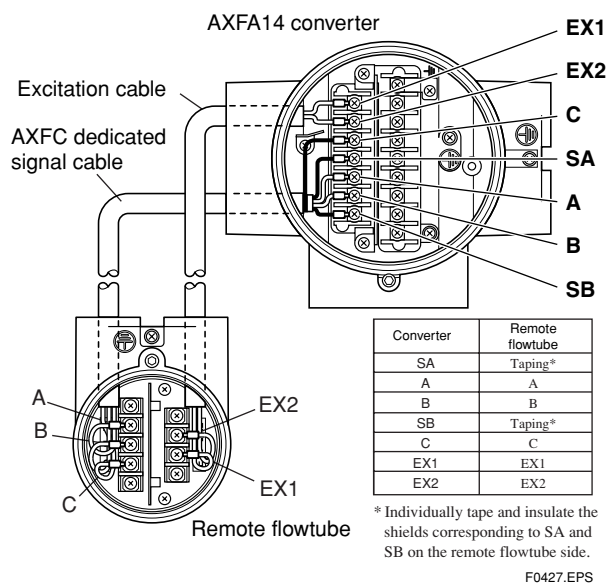


Figure 4.2.14 Wiring Diagram

(4) Wiring the Remote Flowtube (Explosion Proof Type) with Converters



IMPORTANT

In case of TIIS Flameproof type, a remote flowtube is available for combined use with AXFA14 converter only.

1) Connection with the AXFA11 converter

In case of explosion proof type for ATEX, FM, CSA and IECEx certification, connect wiring as shown in the figure below.

In case of the explosion proof type, the protective grounding \perp of remote flowtube must be connected to a suitable IS grounding system. In that case, \perp (functional grounding terminal) need not be connected.

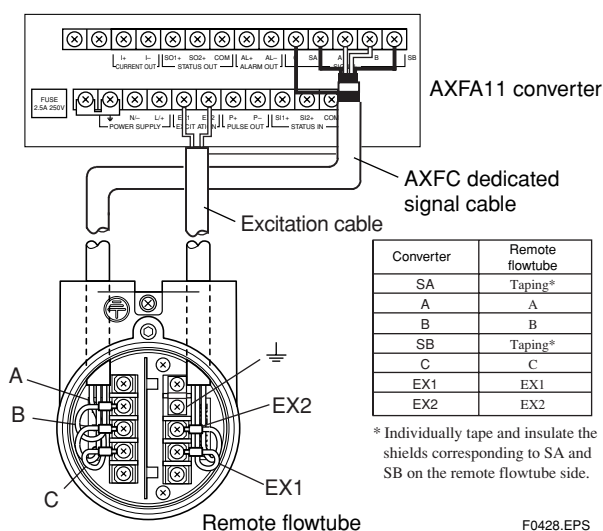


Figure 4.2.15 Wiring Diagram

2) Connection with the AXFA14 converter

In case of explosion proof type for ATEX, FM, CSA, IECEx and TIIS certification, connect wiring as shown in the figure below.

In case of the explosion proof type, the protective grounding \perp of remote flowtube must be connected to a suitable IS grounding system. In that case, \perp (functional grounding terminal) need not be connected.

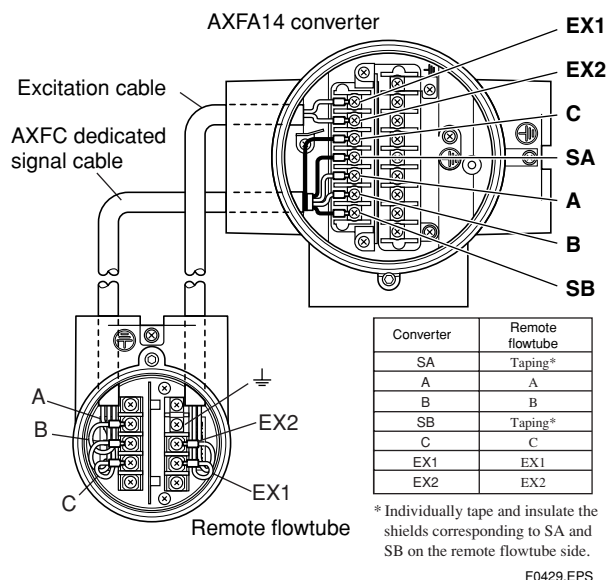


Figure 4.2.16 Wiring Diagram

(5) Wiring the Remote Flowtube (General-Purpose Use, Submersible Type, Size 500 to 1000 mm (20 to 40 in.)) with Converters

1) Connection with the AXFA11 converter

Connect wiring as shown in the figure below.

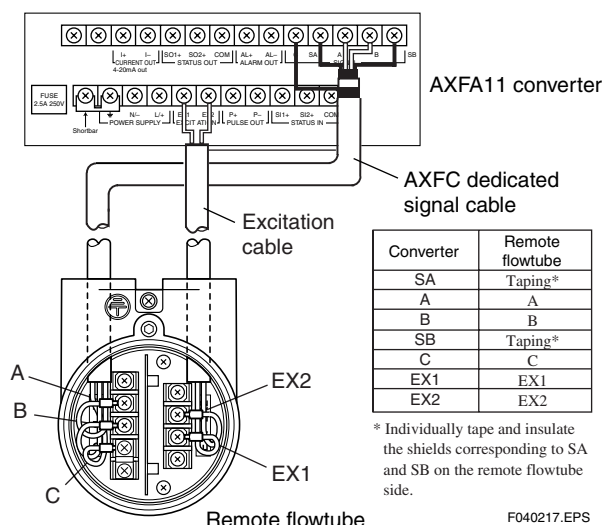


Figure 4.2.17 Wiring Diagram



IMPORTANT

A remote flowtube (size 500 to 1000 mm) cannot be combined with AXFA14 converter.

(6) Wiring the Remote Flowtube (General-Purpose Use, Submersible Type, Size 1100 to 2600 mm (44 to 104 in.)) with Converters

1) Connection with the AXFA11 converter

Connect wiring as shown in the figure below.

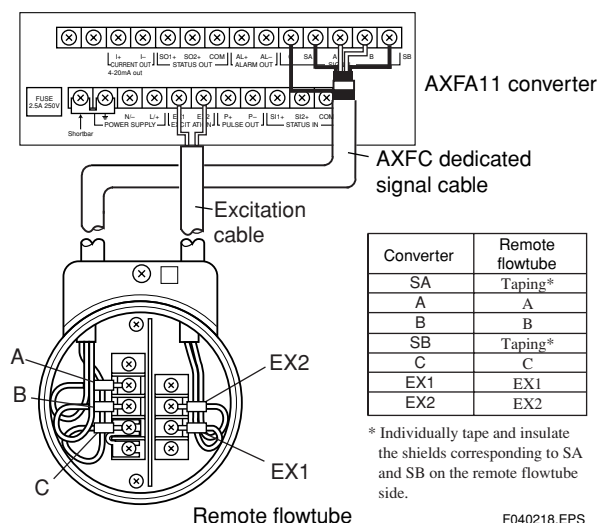


Figure 4.2.18 Wiring Diagram



IMPORTANT

A remote flowtube (size 1100 to 2600 mm) cannot be combined with AXFA14 converter.

(7) Grounding



CAUTION

Be sure to connect the protective grounding of the AXF remote flowtube with a cable of 2mm² or larger cross section in order to avoid electrical shock to the operators and maintenance engineers and to prevent the influence of external noise.

Connect the grounding wire to the mark.

The grounding should satisfy Class D requirements (ground resistance, 100 Ω or less).

In case of TIIS Flameproof type, the grounding should satisfy Class C requirements (ground resistance, 10 Ω or less) or class A requirements (ground resistance, 10 Ω or less).

For explosion proof type except TIIS, follow the domestic electrical requirements as regulated in each country.




IMPORTANT

Improper grounding can have an adverse affect on the flow measurement. Ensure that the instrument is properly grounded.


The electromotive force of the magnetic flowmeter is minute and it is easy to be affected by noise. And also that reference electric potential is the same as the measuring fluid potential. Therefore, the reference electric potential (terminal potential) of the flowtube and the converter also need to be the same as the measuring fluid. Moreover, that the potential must be the same with ground. The magnetic flowmeter is equipped with an grounding ring that makes a connection with the charge of the measured fluid for grounding and protects the lining.

Be sure to ground according to Figure 4.2.19.


600 V vinyl insulated
electric cable
(2 mm² or larger)

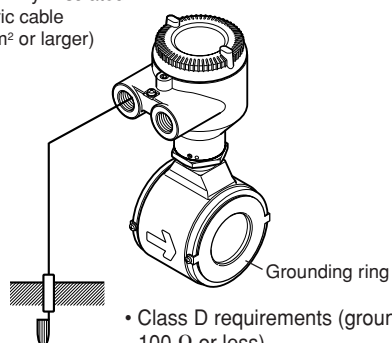

- Class D requirements (ground resistance, 100 Ω or less).
- TIIS Flameproof type: Class C requirements (ground resistance, 10 Ω or less) or Class A requirements (ground resistance, 10 Ω or less)
- Explosion proof type except TIIS: Domestic electrical requirements as regulated in each country.

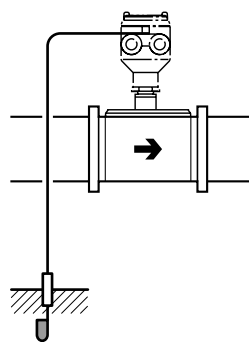

In case grounding rings
are used.

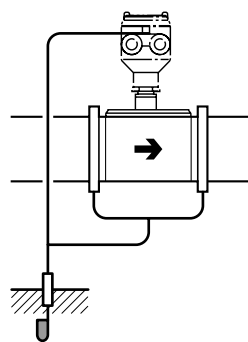


In case grounding rings are
not used.
(Available only for metal piping)

F0430.EPS

Figure 4.2.19 Protective Grounding Terminal Location

(8) Installing the Cover (Size 2.5 to 1000 mm (0.1 to 40 in.))

Install the cover to the flowtube by turning it in the direction of the arrow as shown below. Tighten the cover locking screw counterclockwise using a hexagonal wrench (nominal size 3) to lock the cover.

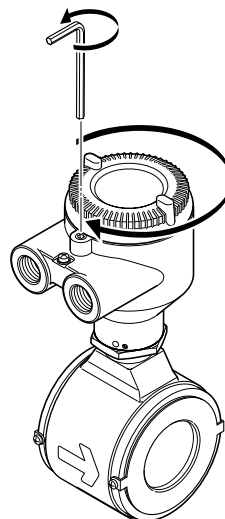

F0431.EPS

Figure 4.2.20 Installing the Terminal Box Cover (Remote Flowtube)

5. MAINTENANCE




WARNING

- Maintenance work must be carried out by the trained personnel having knowledge of safety standard and not by operators.
- When opening the cover, wait for more than 10 minutes after turning off the power. Furthermore, opening of the cover must also be carried out by the trained personnel having knowledge of safety standard.



CAUTION

- Explosion protected type must be, as a rule, removed to a non-hazardous area for maintenance and be disassembled and reassembled to the original state.
- The cover is locked by the special screw. In case of opening the cover, use the hexagonal wrench attached.
- Be sure to lock the cover by the special screw using the hexagonal wrench attached after installing the cover.

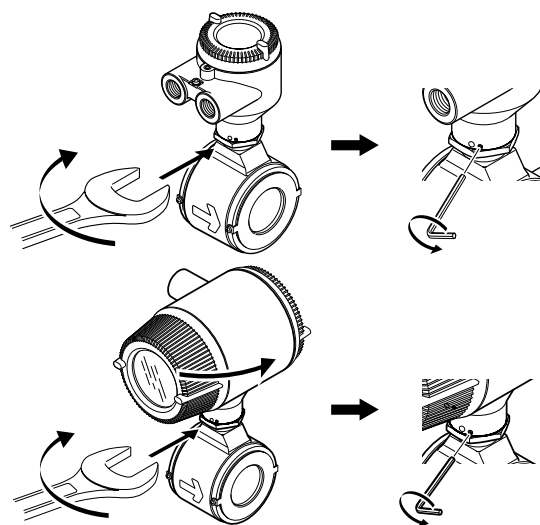

F0501.EPS


- (4) Using the hexagonal wrench, loosen the screw in the neck.
- (5) Turn the converter or the terminal box in the desired direction.



NOTE

The converter and the terminal box can be turned -140 degree to $+180$ degree from the arrow mark indicating the flow direction. Do not exceed these angle.

- (6) Using the hexagonal wrench, retighten the neck screw.

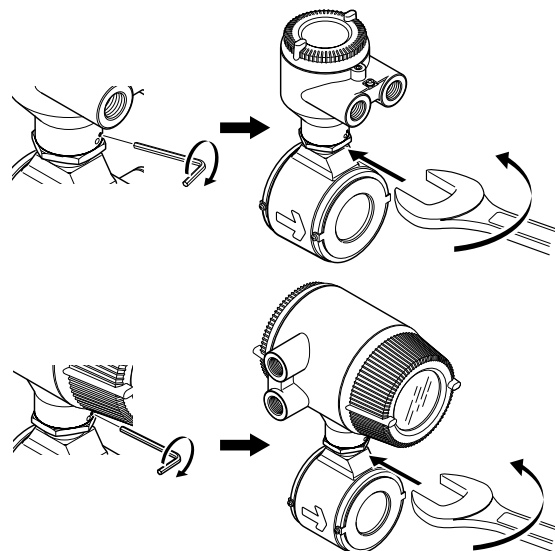

F0502.EPS

- (7) Using the wrench, retighten the hexagonal nut at the neck. After that, check that the converter or terminal box is fixed.

5.1 Changing Direction of Electrical Connection



IMPORTANT

The following types can not be changed direction of electrical connection after delivery.


- Submersible Type.
- Optional code DHC (for district heating and cooling or condensation-proof).
- Size of 1100 mm (44 in.) or larger.

- (1) The following tools are required to change the direction of the electrical connection:
 - Hexagonal wrench (nominal size 1.5): Comes with the instrument.
 - Wrench
- (2) Turn off the power to the flowmeter.
- (3) Using the wrench, loosen the hexagonal nut at the neck of the instrument.

5.2 Removing, Cleaning, and Installing Replaceable Electrodes (General-Purpose Use Type Only)

5.2.1 Removing Replaceable Electrodes

- (1) The following tools are required to replace the electrodes:
 - Special tool for removing and installing electrodes (F9807SK): Optional
 - Torque wrench or torque driver (nominal size 12)
 - Phillips screwdriver

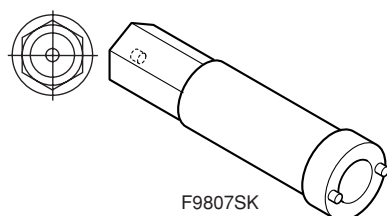

F0503.EPS


- (2) Turn off the power to the flowmeter.
- (3) Drain the fluid from the interior of the flowtube.



WARNING


- Never fail to drain the fluid from the interior of the flowtube.
- If the fluid is at a high temperature, the instrument itself may also be hot. Be careful not to get burned when removing the electrodes.
- When the process fluid is hazardous to humans, exercise caution to avoid coming into contact with it, and avoid inhaling any residual gas.

- (4) Using end A of the tool, open the electrode cover.

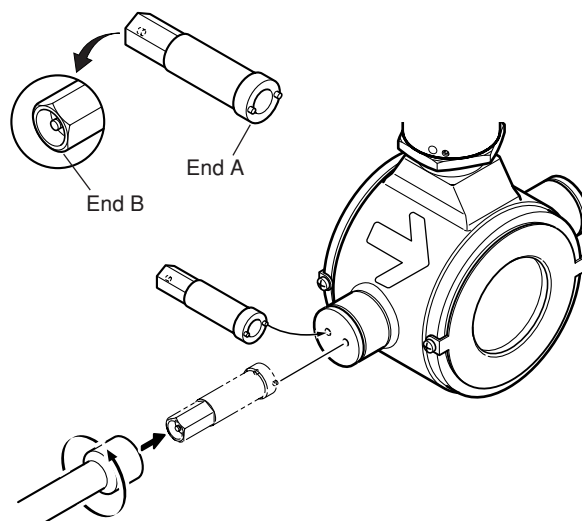

F0504.EPS

- (5) Hold down the electrode lead wire and terminal lug and remove the mounting screw using the Phillips screwdriver.

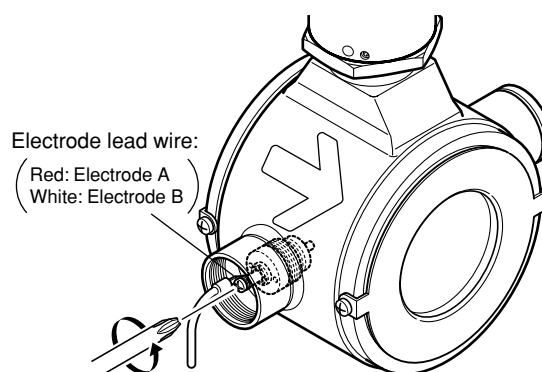


F0505.EPS




NOTE

Always hold down the lead wire and terminal lug when removing the mounting screw.

- (6) Move aside the electrode lead wire and avoiding the screw, insert end A of the tool to the electrode and loosen the electrode holder using the torque driver.

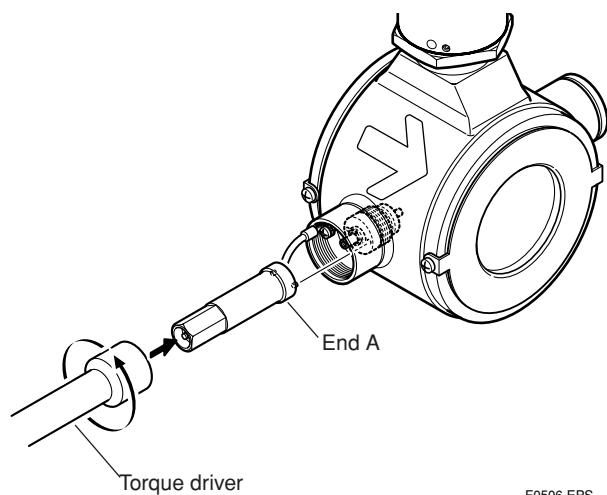


- (7) Screw end B of the tool into the screw block of the electrode, and pull the tool straight out to remove the electrode holder.

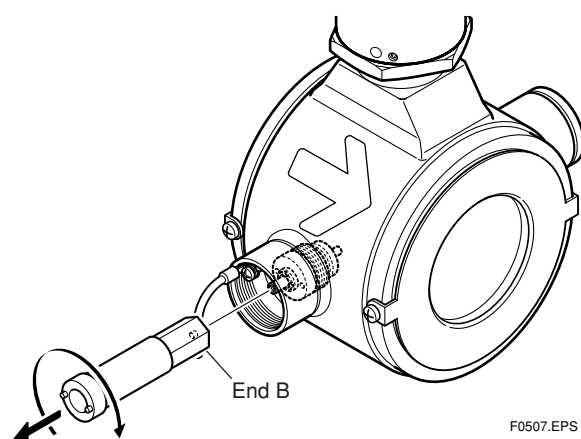

5.2.2 Cleaning Replaceable Electrodes


- (1) Clean the electrode surface (wetted part) with alcohol or other cleaning agents.

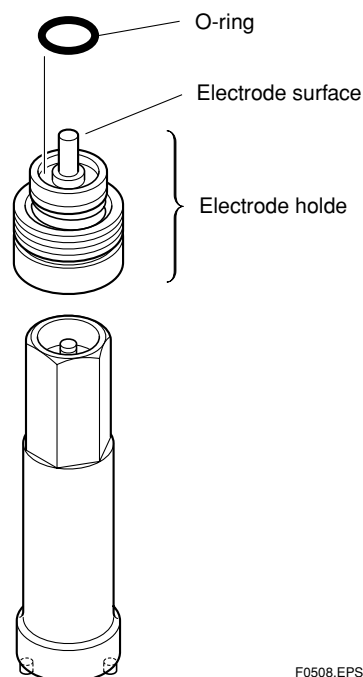

NOTE

The screw threads are coated with an anti-seizing compound. Do not let the compound come in contact with the electrode.

- (2) Clean the surface of the lining seal with an alcohol moistened swab.

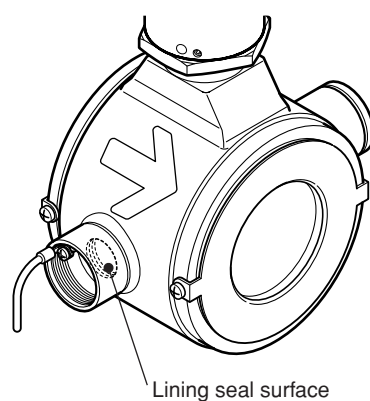

5.2.3 Installing Replaceable Electrodes



NOTE

It is recommended to replace the O-ring when reinstalling the replaceable electrode. Use the O-ring specified by Yokogawa (G9303SE: material is fluororubber).




NOTE

Precautions for storage of O-rings:

- Keep them in a cool, dark place.
- Wrap them well.
- Do not use O-rings after one year since their purchase.


- (1) Push the electrode holder with end B of the tool screwed into it, straight into the flowtube.

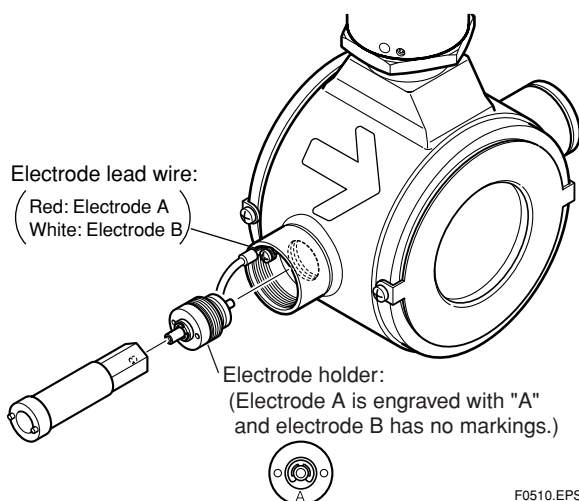

NOTE

- Check that the O-ring has not come off.
- Do not interchange electrodes A and B when installing them. Install electrode A to the electrode boss with the red lead wire and electrode B to the one with the white lead wire.

- (2) Using end A of the tool, tighten the electrode holder.

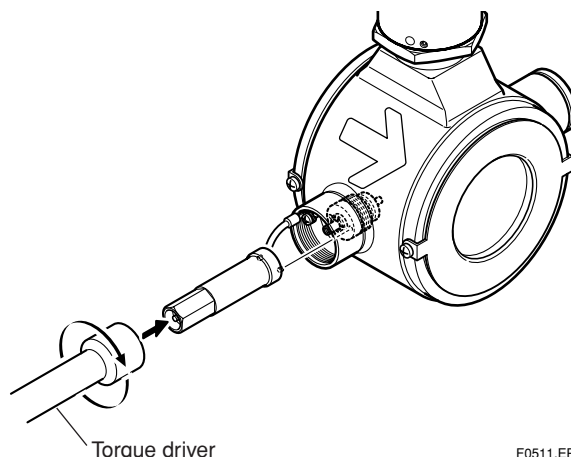

NOTE

Using the torque wrench or torque driver, tighten the electrode holder to the following torque values:

PFA lining:

8.0 N·m \pm 1 N·m (80 kgf·cm \pm 10 kgf·cm)

Polyurethane rubber lining:


3.0 N·m \pm 0.5 N·m (30 kgf·cm \pm 5 kgf·cm)



WARNING

If the electrode holder was not tightened to its specified torque value, fluid leakage from the electrode may result. Should fluid spill over the electrode block, wipe it dry and check that the O-ring has not come off.


- (3) Fill the interior of the flowtube with the fluid and check that there is no leakage from the electrode.
- (4) Hold down the lead wire and terminal lug and screw the mounting screw into the electrode using the Phillips screwdriver.

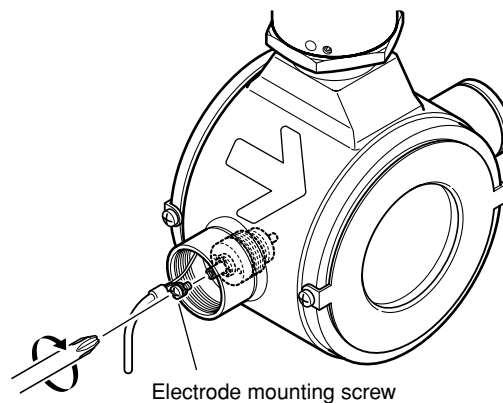

**NOTE**

Always hold down the lead wire and terminal lug when adjusting the mounting screw.

- (5) Put the lead wire in the electrode boss, and install the electrode cover to the boss and tighten it using end A of the tool.

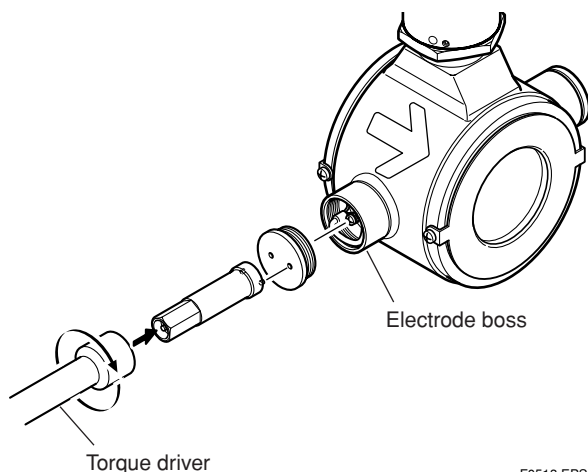

F0513.EPS

- (6) Turn on the power to the flowmeter and start normal operation.

5.3 Removing and Installing Adapters for Sanitary Types

**CAUTION**


- This section describes how to remove and install a butt weld adapter as an example. Apply the same procedure to clamp and union adapters.
- Turn off the power of the magnetic flowmeter, and confirm that there is no fluid inside the pipe before removing the instrument from the pipe line.
- When installation, refer to section 3.3.6.

1) Removing the butt weld adapter

Remove the butt weld adapter by loosening the mounting screws.

2) Installing the butt weld adapter

Install a gasket to fit in the groove of the butt weld adapter, and tighten in the adapter with the mounting screws.

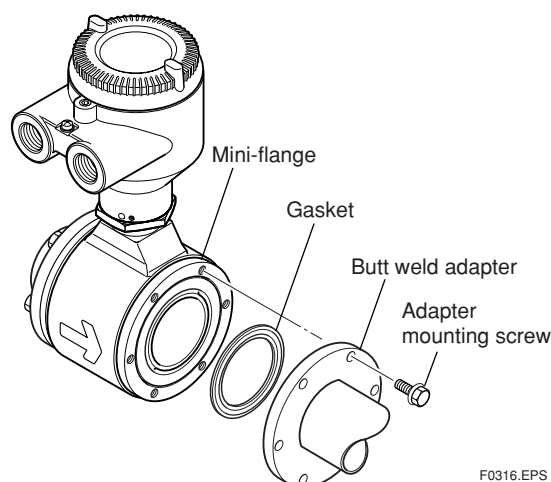

F0316.EPS

Figure 5.3.1 Removing and Installing a Butt Weld Adapter

**CAUTION**

- In case of standard gasket (EPDM rubber), tighten the adapter mounting screw according to the torque values in Table 5.3.1.
- In case that optional code GH (Silicon rubber) is selected, tighten the adapter mounting screw according to the torque values in Table 5.3.2.
- Tighten the adapter mounting screw in diagonal order step by step.
- After tightening of screw, confirm that gaskets protrude inside adapter. Protruding of gasket is necessary to keep the sanitary requirements.

Table 5.3.1 Tightening Torque Values of adapter for EPDM rubber gasket

| Tightening torque values (N·m / {kgf·cm} / [in·lbf]) | |
|--|--|
| Gasket type | EPDM rubber (standard) |
| Size mm (inch) | |
| 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5) | 3.0 to 3.5 / {30.59 to 35.69} / [26.55 to 30.98] |
| 50 (2.0), 65 (2.5) | 4.5 to 5.0 / {45.89 to 50.99} / [39.83 to 44.25] |
| 80 (3.0) | 8.0 to 9.0 / {81.58 to 91.78} / [70.81 to 79.65] |
| 100 (4.0), 125 (5.0) | 10 to 11 / {102.0 to 112.2} / [88.50 to 97.35] |

T0502.EPS

Table 5.3.2 Tightening Torque Values of adapter for silicon rubber gasket

| Tightening torque values (N·m / {kgf·cm} / [in·lbf]) | |
|--|--|
| Gasket type | Silicon rubber (optional code GH) |
| Size mm (inch) | |
| 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5) | 2.0 to 2.5 / {20.39 to 25.49} / [17.70 to 22.13] |
| 50 (2.0), 65 (2.5), 80 (3.0) | 4.0 to 4.5 / {40.79 to 45.89} / [35.40 to 39.83] |
| 100 (4.0), 125 (5.0) | 6.0 to 6.5 / {61.18 to 66.28} / [53.10 to 57.53] |

T0503.EPS

**CAUTION**

- The lining of sanitary type uses fluorocarbon PFA. For the property of fluorocarbon PFA, it is possible that the adapter mounting screws may loosen as time passes, so retighten them regularly.
- Be sure to retighten the adapter mounting screws according to the prescribed torque values in Table 5.3.1 or Table 5.3.2. Retighten them diagonally with the same torque values, step by step up to the prescribed torque value.
- In case of leakage from adapter connection point, retighten the adapter mounting screws. If leakage doesn't stop even if they are retightened, replace the gasket between mini-flange of flowmeter and adapter.
- It is recommended to replace the gasket periodically,
- It is necessary to decide the period between changes with consideration for the frequency of cleaning cycles, the cleaning temperature and the fluid temperature.
- Use the gasket specified by Yokogawa in Table 5.3.3

Table 5.3.3 Parts number of gasket

| Gasket type Size mm (inch) | EPDM rubber (standard) | Silicon rubber (optional code GH) |
|-------------------------------------|---------------------------|---|
| 15 (0.5) | F9811QA | F9811QB |
| 25 (1.0) | B1002EG | B1010EG |
| 32 (1.25) | B1003EG | B1011EG |
| 40 (1.5) | B1004EG | B1012EG |
| 50 (2.0) | B1005EG | B1013EG |
| 65 (2.5) | B1006EG | B1014EG |
| 80 (3.0) | B1007EG | B1015EG |
| 100 (4.0) | B1008EG | B1016EG |
| 125 (5.0) | F9811QC | F9811QD |

T0504.EPS

5.4 Maintenance for Converter (Integral Flowmeter Only)



WARNING

- Maintenance work must be carried out by the trained personnel having knowledge of safety standard and not by operators.
- When opening the cover, wait for more than 10 minutes after turning off the power. Furthermore, opening of the cover must also be carried out by the trained personnel having knowledge of safety standard.



IMPORTANT

- As a rule, maintenance of this flowmeter should be implemented in a maintenance service shop where the necessary tools are provided.
- The amplifier assembly contains sensitive parts that may be damaged by static electricity. Exercise care so as not to directly touch the electronic parts or circuit patterns on the board, for example, by preventing static electrification by using grounded wrist straps when handling the assembly.

5.4.1 Fuse Replacement



CAUTION

Please contact Yokogawa's service office for fuse replacement. Also be sure to use the fuse that was supplied by Yokogawa's sales or service offices.

5.4.2 Changing the Direction of the Display Unit

5.4.2.1 Removing the Cover

- (1) Turn off the power.
- (2) Loosen cover locking screw 1 clockwise using a hexagonal wrench (nominal size 3) to unlock the cover. (Upon shipment from the manufacturing plant, the cover is locked.) Hold the flowmeter with your hand and remove the cover by turning it in the direction of the arrow as shown below.

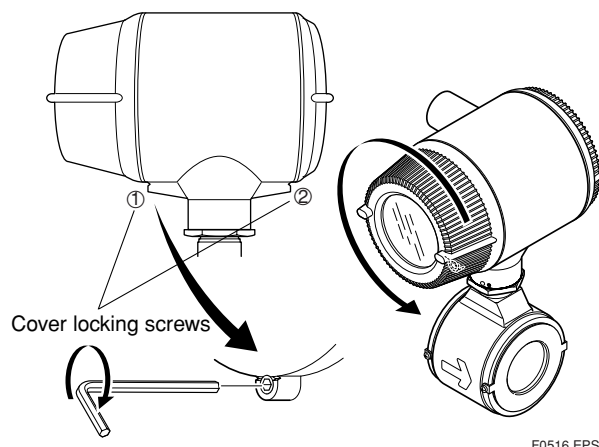


Figure 5.4.1 Removing the Display Cover

5.4.2.2 Changing the Display Unit Direction 90 Degrees

- (1) Hold the display unit with your hand and remove the two mounting screws.
- (2) Turn the display unit 90 degrees clockwise and confirm the assembling position, taking care of the connector and wire of the display unit. At this time, do not remove the connector.
- (3) Secure the display unit using its two mounting screws.

5.5 Setting of Switches (Integral Flowmeter Only)



IMPORTANT

- Removing and installing cover are necessary for setting switches. Perform removing and installing of the cover as described in section 5.4.2.1 and 5.4.2.3.
- To preserve the safety, do not touch the electrical circuit and the cables except setting switches.

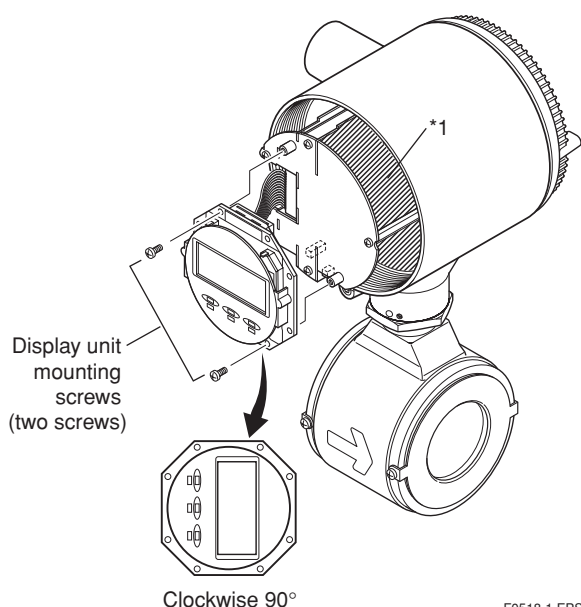


Figure 5.4.2 Changing the Display Unit Direction 90 Degrees



IMPORTANT

- *1: To preserve the safety, do not touch the electrical circuit and cable of shaded area.

5.4.2.3 Installing the Cover

- (1) Taking care not to entangle the cables, install the cover to the flowmeter by turning it in the direction of the arrow as shown below.
- (2) Tighten cover locking screw 1 counterclockwise using a hexagonal wrench (nominal size 3) to lock the cover.

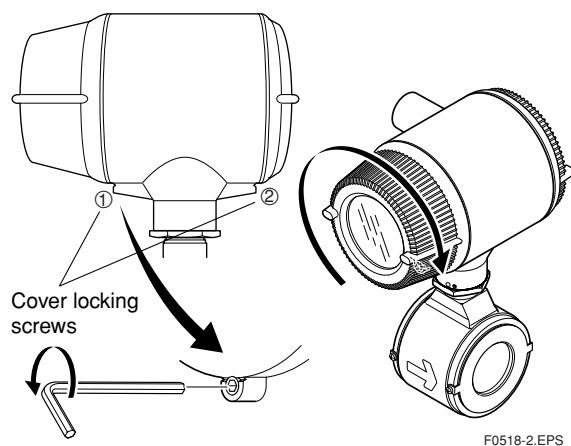


Figure 5.4.3 Installing the Display Cover

5.5.1 Setting of Burnout Switch

The burnout function sets the direction of current output in situations where the CPU has become damaged. Upon shipment from the manufacturing plant, the burnout direction is set to High (i.e., 25 mA); however, in cases where the optional code C1 has been specified, the output direction will be set to Low (i.e., 0 mA).

Modification of the burnout direction must be carried out using the setting switch from the amplifier's CPU board (i.e., Switch 1) (See Figure 5.5.1).

Table 5.5.1 Output Setting Pins for Burnout


| Position of Pin | Burnout Direction | Burnout Output | Remarks |
|-----------------|-------------------|----------------|---------------------------------|
| Low High | High | 25 mA | Set to High before shipment |
| Low High | Low | 0 mA | Set to Low for optional code C1 |

T0501.EPS



NOTE

- On the amplifier's CPU board, the burnout setting switch (i.e., Switch 1) and the write protect switch (i.e., Switch 2) are located adjacent to each other. Accordingly, special care should be taken when making switch settings.
- In the case of Fieldbus communication type, burnout setting switch is not applied.

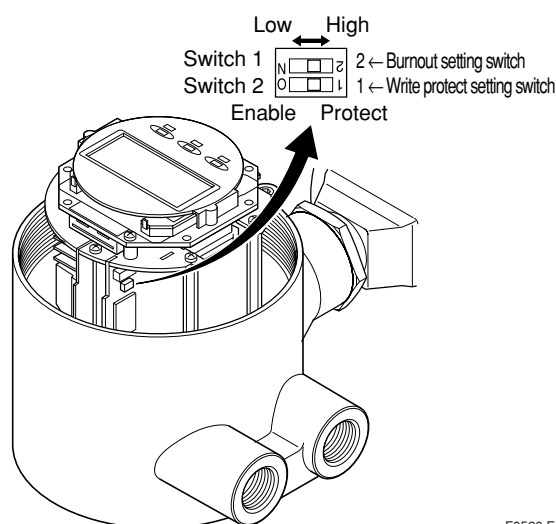

F0520.EPS

Figure 5.5.1 Switch Configuration

5.5.2 Setting of Write Protect Switch

By setting the write protect function to “Protect” it is possible to prevent the overwriting of parameters. Write protection can be carried out using either the hardware switch on the CPU board (i.e., Switch 2) or software parameter settings. If either of these items is set to “Protect,” the overwriting of parameters will be prohibited.



NOTE

- If the hardware switch is set to “Protect,” it will not be possible to overwrite parameters; furthermore, this condition will be maintained until the switch is set to “Enable.”
- In the case of Fieldbus communication type, write protect setting switch is always be set as “Enable”.

For more details regarding usage of the write protect function and the software’s parameter switches, refer to “Chapter 6: Parameter Description” in the user’s manual of the AXF Integral Flowmeter [Software Edition] (IM 01E20C02-01E).

5.6 Regular Inspection Items

- (1) **Inspection of moisture-proofing inside the terminal box: Once/year**
- (2) **Retightening of piping joint screws: About twice/year**
- (3) **Inspection of electrodes and lining (in case of adhesive and/or abrasive fluids, etc.)**

Determine the period of regular inspection as necessary.

5.7 Excitation Coil and Insulation Resistance Check (Remote Flowtube Only)



WARNING

- Before checking of the excitation coil and the insulation resistance, be sure that the power supply for AXFA11 or the AXFA14 converter has been turned off.
- Before checking, be sure to disconnect the cables from the terminals of the remote flowtube.

(1) Excitation Coil Check (Remote Flowtube Only)

Check that there is continuity between terminals EX1 and EX2 in the terminal box. If there is no continuity, the coils may be broken and replacement or repair of the flowtube is necessary. The coil resistance is designed to be 150 Ω or less. If it is not, this may be an abnormal condition. Consult Yokogawa’s sales or service offices.

(2) Insulation Resistance Check (Remote Flowtube Only)

Check the insulation resistances in the terminal box in accordance with the tables below. If any of them falls below the values listed in the tables, consult Yokogawa’s sales or service offices for investigation. If the insulation resistance cannot be restored, replacement or repair of the flowtube is needed. In case of submersible type flowmeters, undo the wiring connection on the converter side and measure resistance at the cable terminals.

Coil Circuit

Checking is possible even if the pipe is filled with fluid.

| Test Terminals | Test Voltage | Specification |
|-----------------------------|--|---------------|
| Between terminals EX1 and C | 500 V DC (Use an insulation tester or the equivalent.) | 1 MΩ or more |

T050601.EPS

Signal Circuit

Before testing, be sure to empty and dry the interior of the pipe, checking that there is no adhesive material. Also undo the wiring connection on the converter side before testing.


| Test Terminals | Test Voltage | Specification |
|--|--|-------------------------|
| Between terminals A and C Between terminals B and C | 500 V DC (Use an insulation tester or the equivalent.) | 100 MΩ or more for each |

T050602.EPS

5.8 Troubleshooting


Although magnetic flowmeters rarely require maintenance, failures may occur when the instrument is not operated correctly. This section describes troubleshooting procedures where the cause of the breakdown is identified through receiver indication.

5.8.1 No Indication

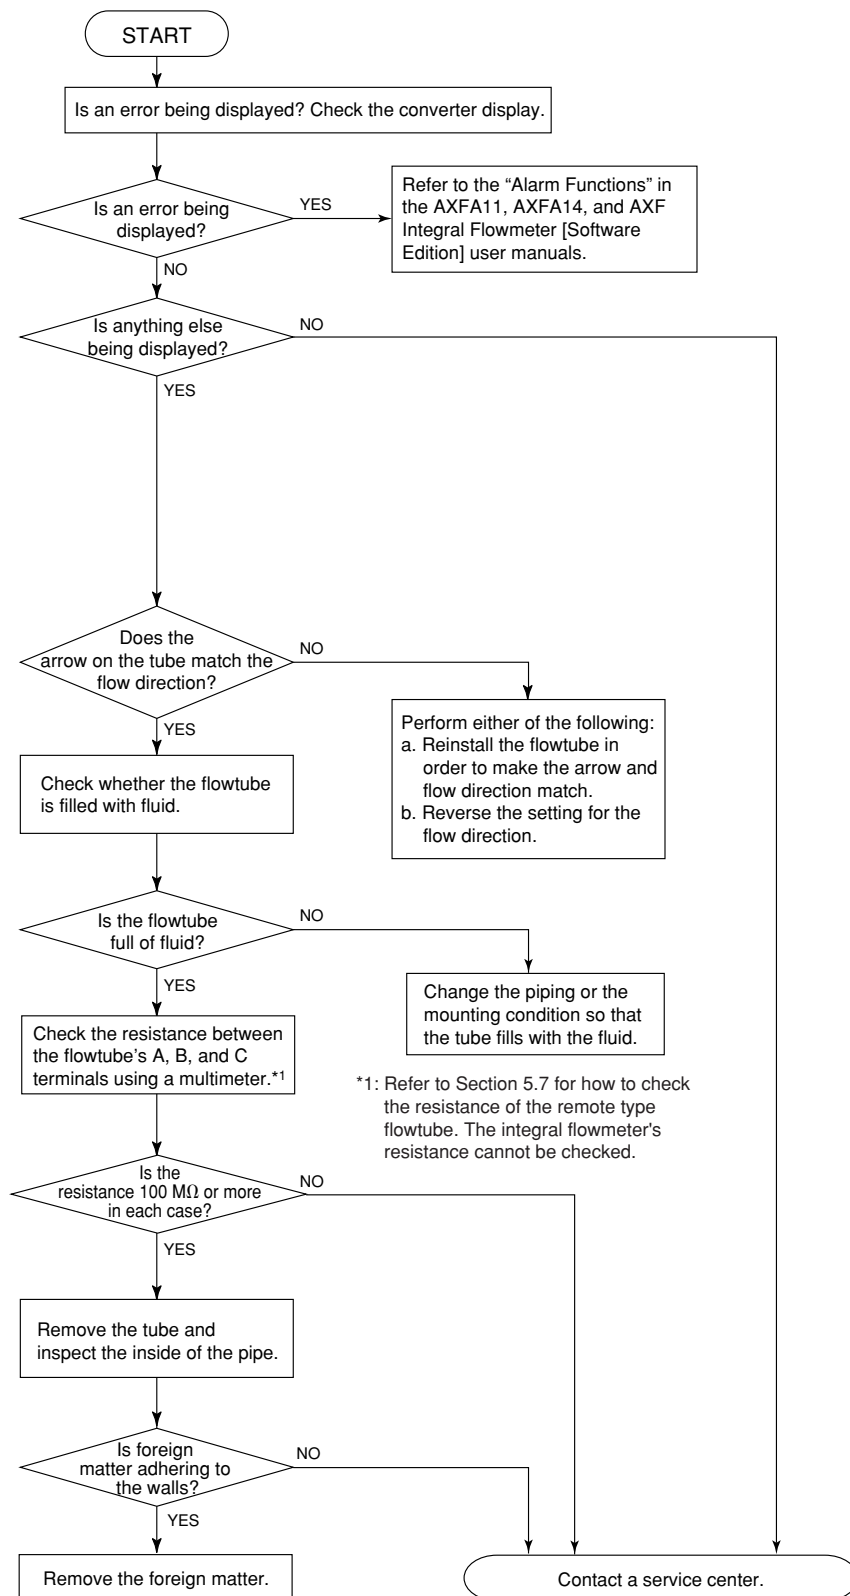


F0521.EPS

5.8.2 Unstable Zero

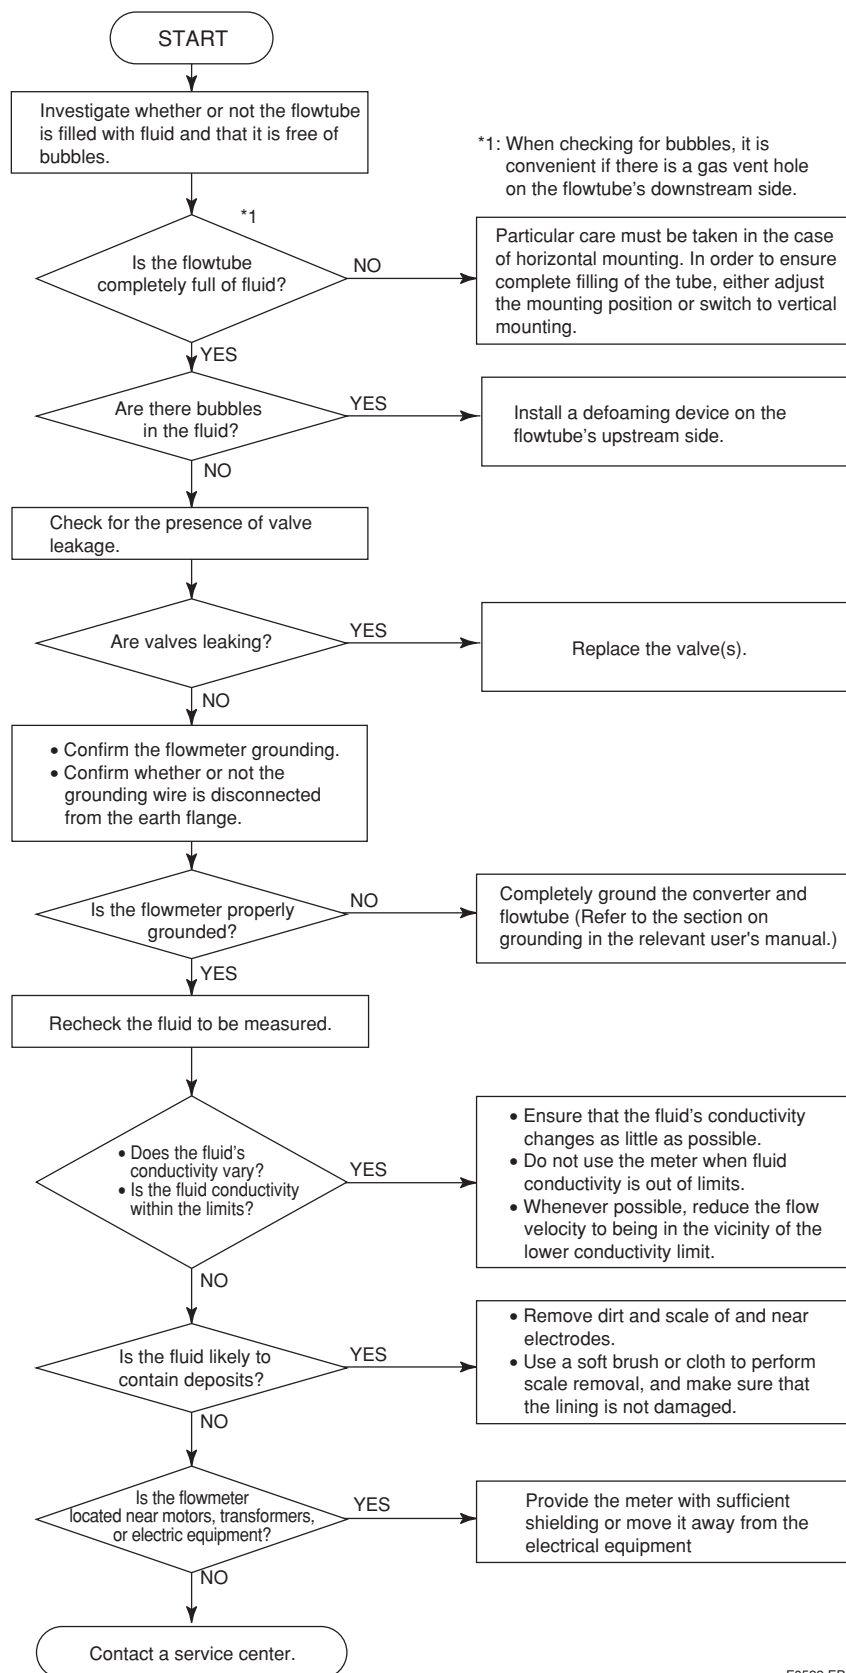

F0522.EPS

5.8.3 Disagreement Between Indication and Actual Flow

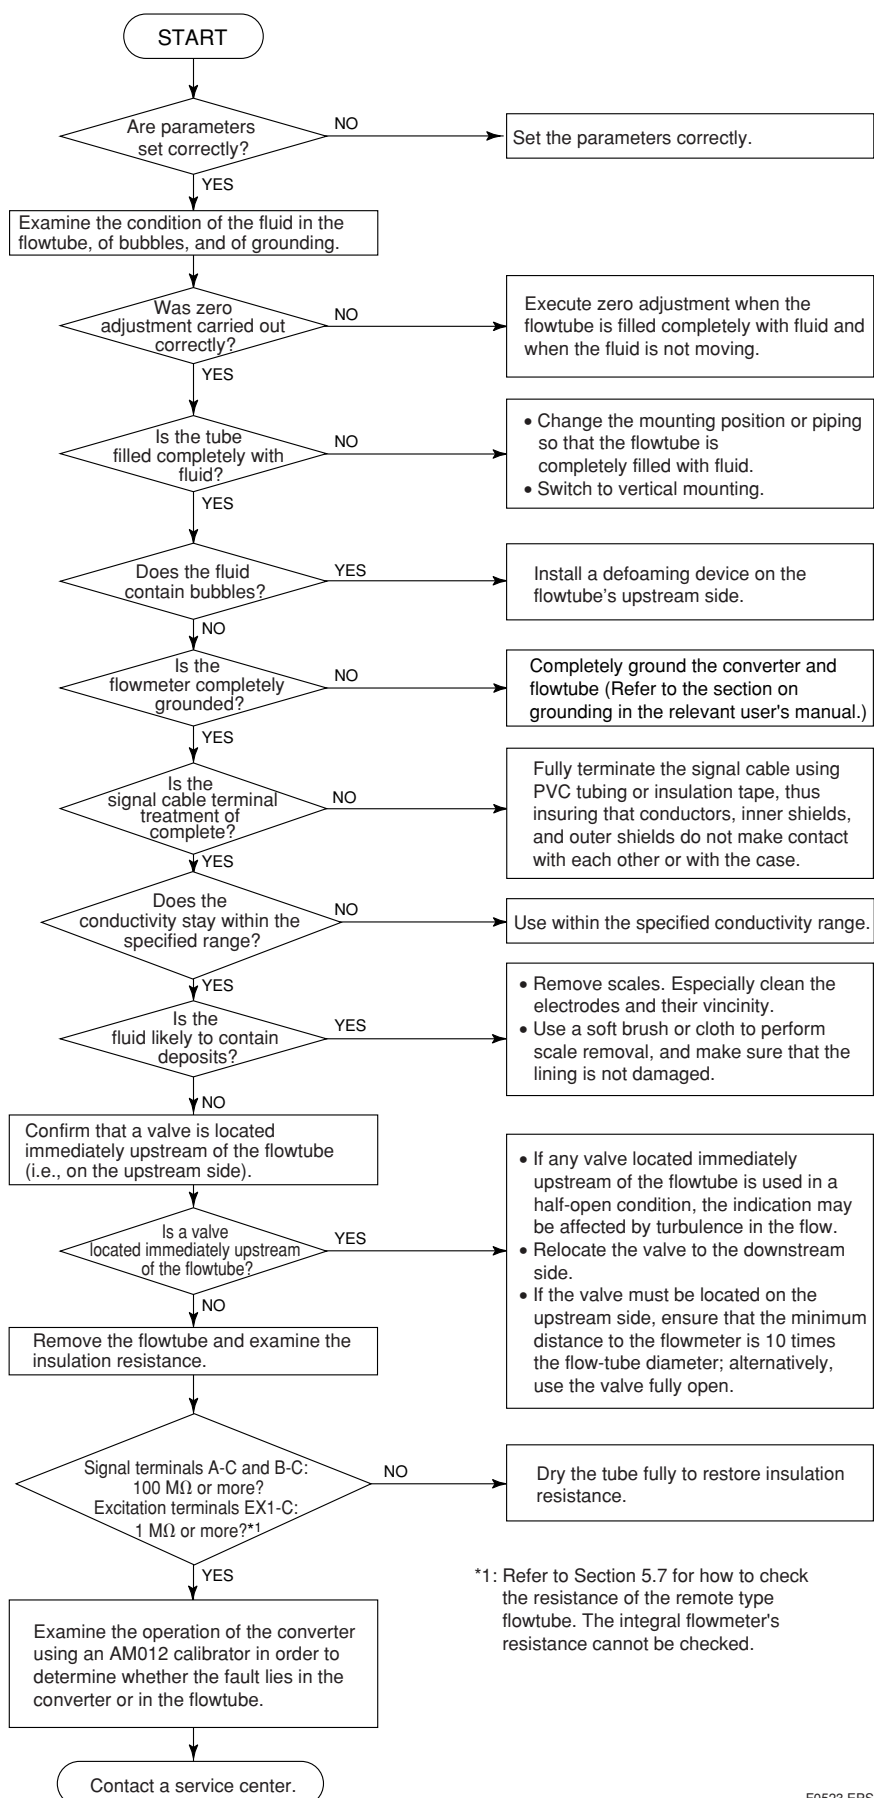

F0523.EPS

6. OUTLINE

■ STANDARD SPECIFICATIONS

Refer to IM 01E20F02-01E for FOUNDATION Fieldbus communication type and IM 01E20F12-01E for PROFIBUS PA communication type marked with “◇”

● Converter (Integral flowmeter)

The contents of (*1) and (*2) described in the converter specifications are follows.

- *1: Select two points from: one pulse output, one alarm output, one status input, or two status outputs.
- *2: For models without an indicator, the configuration tool (Such as HTT (handheld terminal) or FieldMate™, etc.) is necessary to set parameters.

Excitation Method:

- Standard dual frequency excitation:
Size 2.5 to 400 mm (0.1 to 16 in.)
- Enhanced dual frequency excitation:
Size 25 to 200 mm (1.0 to 8.0 in.)
(Optional code HF1 or HF2)

Input Signal (*1) “◇”:

One Status Input: Dry contact
Load Resistance: 200 Ω or less (ON), 100 kΩ or more (OFF)

Output Signals “◇”:

- One Current Output: 4 to 20 mA DC (load resistance: 750Ω maximum, including cable resistance)
- One Pulse Output (*1):
Transistor contact output (open collector)
Contact capacity: 30 V DC (OFF), 200 mA (ON)
Output rate: 0.0001 to 10,000 pps (pulse/second)
- One Alarm Output (*1):
Transistor contact output (open collector)
Contact capacity: 30 V DC (OFF), 200 mA (ON)
- Two Status Outputs (*1):
Transistor contact output (open collector)
Contact capacity: 30 V DC (OFF), 200 mA (ON)

Communication Signals “◇”:

BRAIN or HART communication signal
(Superimposed on the 4 to 20 mA DC signal)
Distance from Power Line: 15 cm (6 in.) or more
(Parallel wiring should be avoided.)

BRAIN:

Communication Distance:

Up to 1.5 km (0.93 miles), when polyethylene insulated PVC-sheathed cables (CEV cables) are used.
Communication distance varies depending on the type of cable and wiring used.

Load Resistance:

250 to 450Ω (including cable resistance)

Load Capacitance:

0.22 μF or less

Load Inductance:

3.3 mH or less

Input Impedance of Communicating Device:

10 kΩ or more (at 2.4 kHz)

HART:

Load Resistance:

250 to 600Ω (including cable resistance)

Note: HART is a registered trademark of the HART Communication Foundation.

Data Security During Power Failure:

Data (parameters, totalizer value, etc.) storage by EEPROM. No back-up battery required.

Indicator (*2):

Full dot-matrix LCD (32×132 pixels)

Lightning Protector:

The lightning protector is built into the current output and pulse/alarm/status input and output terminals. When optional code A is selected, the lightning protector is built into the power terminals.

Protection:

General-purpose Use/Sanitary Type/TIIS Flameproof type:

IP66, IP67

Explosion proof type except TIIS:

In case of explosion proof type except TIIS, refer to description of "Enclosure" in "HAZARDOUS AREA CLASSIFICATION".

Coating:

Case and Cover: Corrosion-resistant coating

Coating Color: Mint green coating (Munsell 5.6 BG 3.3/2.9 or its equivalent)

Converter Material:

Case and Cover : Aluminum alloy

Mounting/Shapes (Integral Flowmeter):

- Electrical Connection: ANSI 1/2 NPT female
ISO M20 ×1.5 female
JIS G1/2 (PF1/2) female
- Direction of Electrical Connection: The direction can be changed even after delivery.
- Terminal Connection: M4 size screw terminal

Grounding:

Grounding resistance 100 Ω or less

When optional code A is selected, grounding resistance 10 Ω or less shall be applied.

- * In case of explosion proof type except TIIS, follow the domestic electrical requirements as regulated in each country.
- * In case of TIIS Flameproof type, refer to description of "HAZARDOUS AREA CLASSIFICATION".

Functions

How to Set Parameters (*2):

The indicator's LCD and three infra-red switches enable users to set parameters without opening the case cover. Parameters can also be set with the configuration tool (Such as HHT (handheld terminal) or FieldMate, etc.).

The language for the HHT is English only.

Displayed Languages (*2):

Users can choose a language from among English, Japanese, German, French, Italian, and Spanish.

Instantaneous Flow Rate/Totalized Value Display

Functions (for models with an indicator) (*2):

The full dot-matrix LCD enables user selections of displays from one line to three lines for:

- Instantaneous flow rate
- Instantaneous flow rate (%)
- Instantaneous flow rate (bar graph)
- Current output value (mA)
- Totalized forward-direction flow rate
- Totalized reverse-direction flow rate
- Totalized differential flow rate
- Tag No.
- Results of electrode adhesion diagnostics
- Communication type

Totalizer Display Function (*2):

The flow rate is counted one pulse at a time according to the setting of totalization pulse weights. For forward and reverse flow measurement functions, the totalized values of the flow direction (forward or reverse) and the flow direction are displayed on the indicator together with the units. The difference of totalized values between the forward and reverse flow rate can be displayed.

Totalization for the reverse flow rate is carried out only when "Forward and reverse flow measurement functions" is selected.

Damping Time Constant (*2):

Time constant can be set from 0.1 second to 200.0 seconds (63% response). The default is 3 seconds.

Span Setting Function (*2):

Span flows can be set in units such as volume flow rate, mass flow rate, time, or flow rate value. The velocity unit can also be set.

Volume Flow Rate Unit: kcf, cf, mcf, Mgal (US), kgal (US), gal (US), mgal (US), kbbbl (US)*, bbl (US)*, mbbbl (US)*, μbbbl (US)*, MI (megaliter), m³, kl (kiloliter), l (liter), cm³

Mass Flow Rate Unit (Density must be set.): klb (US), lb (US), t (ton), kg, g

Velocity Unit: ft, m (meter)

Time Unit: s (sec), min, h (hour), d (day)

* "US oil" or "US Beer" can be selected.

Pulse Output (*1)(*2):

Scaled pulse can be output by setting a pulse weight.

Pulse Width: Duty 50% or fixed pulse width (0.05, 0.1, 0.5, 1, 20, 33, 50, 100 ms) can be selected.

Output Rate: 0.0001 to 10,000 pps (pulse/second)

Multi-range Function (*1)(*2):

- Range switching via status input
Status input enables the switching of up to two ranges.
- Automatic range switching
When the flow rate exceeds 100 % of the range, transition to the next range (up to four ranges) is carried out automatically. Range switching can be confirmed by status outputs and indicator.

Forward and Reverse Flow Measurement Functions (*1)(*2):

Flows in both forward and reverse directions can be measured. The reverse flow measurement can be confirmed by status output and indicator.

Totalization Switch (*1)(*2):

The status output is carried out when a totalized value becomes equal to or greater than the set value.

Preset Totalization (*1)(*2):

The parameter setting or status input enables a totalized value to be preset to a setting value or zero.

0% Signal Lock (*1)(*2):

Status input forcibly fixes the instantaneous flow rate display, current output, pulse output, and flow rate totalization to 0%.

Alarm Selection Function (*2):

Alarms are classified into the System Alarms (hard failures), Process Alarms (such as 'Empty Pipe', 'Signal Overflow' and 'Adhesion Alarm'), Setting Alarms, and Warnings.

Whether alarms should be generated or not can be selected for each item.

The current output generated for an alarm can be selected from among 2.4 mA or less, fixed to 4 mA, 21.6 mA or more, or HOLD.

Alarm Output (*1)(*2):

Alarms are generated only for the items selected via the 'Alarm Selection Function' if relevant failures occur.

Self Diagnostics Functions (*2):

If alarms are generated, details of the System Alarms, Process Alarms, Setting Alarms and Warnings are displayed together with concrete descriptions of countermeasures.

Flow Upper/Lower Limit Alarms (*1)(*2):

If a flow rate becomes greater or smaller than the set value, this alarm is generated. In addition, two upper limits (H, HH) and two lower limits (L, LL) can be set.

If a flow rate becomes greater or smaller than any of the set values, the status is output.

Electrode Adhesion Diagnostics Function (*1) (*2):

This function enables monitoring of the adhesion level of insulating substances to the electrodes. Depending on the status of adhesion, users are notified by a warning or an alarm via status outputs. If replaceable electrodes are used, they can be removed and cleaned when adhesion occurs.

● Flowtubes (Remote Flowtube/Integral Flowmeter)

Size of AXF Flowtubes: AXF Standard (Lay length code 1)

Unit: mm (in.)

| Use | Process Connection | Lining | Remote Flowtube | Integral Flowmeter | High Grade Accuracy 0.2% of Rate (*3) | Enhanced Dual Frequency Excitation (Optional code HF1,HF2) (*3) | Replaceable Electrode (Electrode structure code 2) |
|---------------------|--------------------|---------------------|--|---|---|---|---|
| General-purpose Use | Wafer | PFA | 2.5 (0.1), 5 (0.2), 10 (0.4), 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) |
| | | Polyurethane Rubber | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) | — | — | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) |
| | | Natural Soft Rubber | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) | — | — | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | EPDM Rubber | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) | — | — | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | Ceramics (*1) | 15 (0.5), 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — |
| | Flange | PFA | 2.5 (0.1), 5 (0.2), 10 (0.4), 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16) |
| | | Polyurethane Rubber | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16), 500(20), 600 (24), 700 (28), 800 (32), 900(36), 1000(40), 1100(44), 1200(48), 1350(54), 1500(60), 1600(64), 1800(72), 2000(80), 2200(88), 2400(96), 2600(104) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16) | — | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16) |
| | | Natural Soft Rubber | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350(14), 400(16) | — | — | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | EPDM Rubber | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350(14), 400(16) | — | — | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | Union Joint | Ceramics (*2) | 2.5 (0.1), 5 (0.2), 10 (0.4) | — | — | — | — |

Size of AXF Flowtubes: AXF Standard (Lay length code 1) (continued)

Unit: mm (in.)

| Use | Process Connection | Lining | Remote Flowtube | Integral Flowmeter | High Grade Accuracy 0.2% of Rate (*3) | Enhanced Dual Frequency Excitation (Optional code HF1,HF2) (*3) | Replaceable Electrode (Electrode structure code 2) |
|------------------|---|---------------------|---|---|---|---|--|
| Submersible Type | Wafer | PFA | 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) | — | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | Polyurethane Rubber | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) | — | — | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | Natural Soft Rubber | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) | — | — | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | EPDM Rubber | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) | — | — | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | Flange | PFA | 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16) | — | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | Polyurethane Rubber | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16), 500(20), 600 (24), 700 (28), 800 (32), 900(36), 1000(40), 1100(44), 1200(48), 1350(54), 1500(60), 1600(64), 1800(72), 2000(80), 2200(88), 2400(96),2600(104) | — | — | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | Natural Soft Rubber | 50 (2.0), 65 (2.5), 80(3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16) | — | — | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | EPDM Rubber | 50 (2.0), 65 (2.5), 80(3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16) | — | — | 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | Explosion proof Type | Wafer | PFA | 2.5 (0.1), 5 (0.2), 10 (0.4), 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | | Ceramics (*1) | 15 (0.5), 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | 25(1.0),40(1.5),50(2.0), 80(3.0),100(4.0), 150(6.0),200(8.0) | — |
| | | Flange | PFA | 2.5 (0.1), 5 (0.2), 10 (0.4), 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0), 250 (10), 300 (12), 350 (14), 400 (16) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0), 150 (6.0), 200 (8.0) | — |
| | | | Union Joint | Ceramics (*2) | 2.5 (0.1), 5 (0.2), 10 (0.4) | — | — |
| Sanitary Type | Clamp: Tri-Clamp (*4), DIN32676 ISO2852/SMS3016 Union: DIN11851 ISO2853 (*5) SMS1145 (*6) Butt Weld: DIN11850, ISO203 | PFA | 15 (0.5), 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0) | — | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0) | 25 (1.0), 32 (1.25), 40 (1.5), 50 (2.0), 65 (2.5), 80 (3.0), 100 (4.0), 125 (5.0) | — |

*1: AXF standard lay length dimensions for wafer type ceramics linings are the same as those for ADMAG ceramics linings.

T21.EPS

*2: AXF standard lay length dimensions for union joint type ceramics linings are the same as those for ADMAG ceramics linings.

*3: Enhanced dual frequency excitation is not available for models with High grade accuracy.

*4: Not available with 32 mm (1.25 in.), 125 mm (5.0 in.)

*5: Not available with 125 mm (5.0 in.)

*6: Not available with 15 mm (0.5 in.), 125 mm (5.0 in.)

Size of AXF Flowtubes: Replacement model for earlier ADMAG or ADMAG AE (Lay length code 2)

Unit: mm (in.)

| Use | Process Connection | Lining | Remote Flowtube | Integral Flowmeter | High Grade Accuracy 0.2% of Rate | Enhanced Dual Frequency Excitation (Optional code HF1, HF2) | Replaceable Electrode (Electrode structure code 2) |
|----------------------|--------------------|---------------------|---|--------------------|----------------------------------|---|--|
| General-purpose use | Wafer (*6) | PFA | 2.5 (0.1), 5 (0.2), 10 (0.4), 15 (0.5), 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — | — | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — |
| | | Polyurethane rubber | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — | — | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — |
| | Flange (*7) | PFA | 150 (6.0), 200 (8.0), 250 (10) | — | — | 150 (6.0), 200 (8.0) | 150 (6.0), 200 (8.0), 250 (10) |
| | | Polyurethane rubber | 150 (6.0), 200 (8.0), 250 (10) | — | — | 150 (6.0), 200 (8.0) | 150 (6.0), 200 (8.0), 250 (10) |
| Submersible Type | Wafer (*6) | PFA | 15 (0.5), 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — | — | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — |
| | | Polyurethane rubber | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — | — | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — |
| | Flange (*7) | PFA | 150 (6.0), 200 (8.0), 250 (10) | — | — | 150 (6.0), 200 (8.0) | — |
| | | Polyurethane rubber | 150 (6.0), 200 (8.0), 250 (10) | — | — | 150 (6.0), 200 (8.0) | — |
| Explosion proof Type | Wafer (*6) | PFA | 2.5 (0.1), 5 (0.2), 10 (0.4), 15 (0.5), 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — | — | 25 (1.0), 40 (1.5), 50 (2.0), 80 (3.0), 100 (4.0), 150 (6.0), 200 (8.0) | — |
| | Flange (*7) | PFA | 150 (6.0), 200 (8.0), 250 (10) | — | — | 150 (6.0), 200 (8.0) | — |

*6: ADMAG lay length dimensions for wafer type of 250 mm (10 in.), and 300 mm (12 in.) are the same as those for AXF Standard.
And, in case of "platinum-iridium (grounding ring code P) or tantalum (grounding ring code T) or None (grounding ring code N)" in wafer type of 2.5 mm (0.1 in.) to 15 mm (0.5 in.), the lay lengths of Replacement model are the same as those for AXF Standard.

*7: ADMAG lay length dimensions for flange type of 15 mm (0.5 in.) to 100 mm (4.0 in.), or 300 mm (12 in.) to 2600 mm (104 in.) are the same as those for AXF Standard. However, in case of platinum-iridium (grounding ring code P) or tantalum (grounding ring code T) or None (grounding ring code N) in flange type of 15 mm (0.5 in.) to 100 mm (4.0 in.), the lay length of AXF Standard are longer by approx. 4mm (0.16 in) than those of earlier ADMAG or ADMAG AE.

T22.EPS

Protection:**General-Purpose Use/Sanitary Type/TIIS Flameproof Type:**

IP66, IP67

Explosion proof type except TIIS:

In case of explosion proof type except TIIS, refer to description of "Enclosure" in "HAZARDOUS AREA CLASSIFICATION".

Submersible Type (only for Remote Flowtube):

IP68 (Conforms to continuous immersion under the following test condition)

Test Condition: 50 m below the surface of the water, equivalent to 0.5 MPa hydraulic pressure, for one month.
Cable should be protected at customer site.

- Housing, Flange (Flange type only), Terminal Box and Cover (Remote Flowtube):
Corrosion-resistant coating
Coating color; Mint green (Munsell 5.6 BG 3.3/2.9 or its equivalent)

Sanitary Type:

Size 15 to 125 mm (0.5 to 5.0 in.):

- Housing: No coating (Stainless steel surface)
- Adapter : No coating (Stainless steel surface)
- Terminal Box and Cover (Remote Flowtube):
Corrosion-resistant coating
Coating color; Mint green (Munsell 5.6 BG 3.3/2.9 or its equivalent)

Coating:**General-Purpose Use/Explosion proof Type:**

Size 2.5 to 125 mm (0.1 to 5.0 in.) (Wafer type),
Size 2.5 to 125 mm (0.1 to 5.0 in.) (Process connection code B or D of flange type):

- Housing: No coating (Stainless steel surface)
- Flange (Flange type only) : No coating (Stainless steel surface)
- Terminal Box and Cover (Remote Flowtube):
Corrosion-resistant coating
Coating color; Mint green (Munsell 5.6 BG 3.3/2.9 or its equivalent)

Size 150 to 300 mm (6.0 to 12 in.) (Wafer type),
Size 150 to 400 mm (6.0 to 16 in.) (Process connection code B of flange type),
Size 50 to 2600 mm (2.0 to 104 in.) (Process connection code C of flange type):

Submersible Type: Non-tar epoxy coating (black)

Flowtube Material:

Size 2.5 mm (0.1 in.) to 15 mm (0.5 in.)

| Part Name | | Material |
|--------------------------------|--|--|
| Housing | | Stainless steel-JIS SCS11 equivalent |
| Flange | | Stainless steel-JIS SUS304 or SUSF304 (AISI 304 SS/EN 1.4301 equivalent) |
| Mini-Flange | Wafer Type PFA/Polyurethane Rubber lining | Stainless steel-JIS SCS13 (EN 1.4308 equivalent) |
| | Wafer Type Ceramics lining [only for 15 mm (0.5 in.)] | Stainless steel-JIS SUS316L (AISI 316 SS/EN 1.4404 equivalent) |
| | Sanitary Type [only for 15 mm (0.5 in.)] | Stainless steel-JIS SCS13 (EN 1.4308 equivalent) |
| Pipe | Wafer Type PFA/Polyurethane Rubber lining | Stainless steel-JIS SCS13 (EN 1.4308 equivalent) |
| | Wafer Type/Union Joint Ceramics lining | Alumina ceramics (99.9%) |
| | Flange Type PFA lining | Stainless steel-JIS SCS13 (EN 1.4308 equivalent) and SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| | Sanitary Type [only for 15 mm (0.5 in.)] | Stainless steel-JIS SCS13 (EN 1.4308 equivalent) |
| Terminal Box (Remote Flowtube) | | Aluminum alloy |

T03.EPS

Size 25 mm (1.0 in.) to 125 mm (5.0 in.)

| Part Name | | | Material |
|---|--|--|--|
| Housing | | | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| Flange | Process Connection code: B** | | Stainless steel-JIS SUS304 or SUSF304 (AISI 304 SS/EN 1.4301 equivalent) |
| | Process Connection code: C** [(Size 50 mm (2.0 in.) to 125 mm (5.0 in.))] | | Carbon steel-JIS SS400 or SFVC 2A |
| Mini-Flange | Wafer Type PFA/Polyurethane Rubber/ Natural Soft Rubber/ EPDM Rubber lining | Size 25 mm (1.0 in.) (Lay Length code 1) | Stainless steel- EN 1.4308 (SCS13 equivalent) |
| | | Size 25 mm (1.0 in.) (Lay Length code 2) | Stainless steel-JIS SUS430 (ASTM 43000/DIN X6Cr17/EN 1.4016 equivalent) |
| | | Size 32 mm (1.25 in.) to 125 mm (5.0 in.) | Stainless steel-JIS SUS430 (ASTM 43000/DIN X6Cr17/EN 1.4016 equivalent) |
| | Wafer Type Ceramics lining | Size 25 mm (1.0 in.) to 50 mm (2.0 in.) | Stainless steel-JIS SUS316L (AISI 316L SS/EN 1.4404 equivalent) |
| | | Size 80 mm (3.0 in.), 100 mm (4.0 in.) | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| | Sanitary Type | Size 25 mm (1.0 in.) | Stainless steel-JIS SCS13 (EN 1.4308 equivalent) |
| | | Size 32 mm (1.25 in.) to 125 mm (5.0 in.) | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| | Pipe | Wafer Type PFA/Polyurethane Rubber/ Natural Soft Rubber/ EPDM Rubber lining | Size 25 mm (1.0 in.) (Lay Length code 1) |
| Size 25 mm (1.0 in.) (Lay Length code 2) | | | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| Size 32 mm (1.25 in.) to 125 mm (5.0 in.) | | | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| Flange Type PFA/Polyurethane Rubber/ Natural Soft Rubber/ EPDM Rubber lining | | Size 25 mm (1.0 in.) | Stainless steel- EN 1.4308 (SCS13 equivalent) |
| | | Size 32 mm (1.25 in.) to 125 mm (5.0 in.) | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| Wafer Type Ceramics lining | | Size 25 mm (1.0 in.) to 100 mm (4.0 in.) | Alumina ceramics (99.9%) |
| Sanitary Type | | Size 25 mm (1.0 in.) | Stainless steel-JIS SCS13 (EN 1.4308 equivalent) |
| | | Size 32 mm (1.25 in.) to 125 mm (5.0 in.) | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| Terminal Box (Remote Flowtube) | | | Aluminum alloy |

T04.EPS

Size 150 mm (6.0 in.) to 400 mm (16 in.)

| Part Name | | Material |
|--------------------------------|--|--|
| Housing | | Carbon steel-JIS SPCC equivalent |
| Flange | Process Connection code: B** | Stainless steel-JIS SUS304 or SUSF304 (AISI 304 SS/EN 1.4301 equivalent) |
| | Process Connection code: C** | Carbon steel-JIS SS400 or SFVC 2A |
| Mini-Flange | Wafer Type PFA/Polyurethane Rubber/Natural Soft Rubber/EPDM Rubber lining | Carbon steel-JIS SS400 or SFVC 2A |
| | Wafer Type Ceramics lining [available with 150 mm (6.0 in.), 200 mm (8.0 in.)] | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| Pipe | Flange Type/Wafer Type PFA/Polyurethane Rubber/Natural Soft Rubber/EPDM Rubber lining | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| | Wafer Type Ceramics lining [available with 150 mm (6.0 in.), 200 mm (8.0 in.)] | Alumina ceramics (99.9%) |
| Terminal Box (Remote Flowtube) | | Aluminum alloy |

T05.EPS

Size 500 mm (20 in.) to 2600 mm (104 in.)

| Part Name | | Material |
|--------------------------------|---|--|
| Housing | | Carbon steel-JIS SS400 equivalent |
| Flange | | Carbon steel-JIS SS400 or SFVC 2A |
| Pipe | | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) |
| Terminal Box (Remote Flowtube) | Case, Cover (500 to 1000 mm) (20 to 40 in.) | Aluminum alloy |
| | Case (1100 to 2600 mm) (44 to 104 in.) | Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) Electrical connection: Carbon steel |
| | Cover (1100 to 2600 mm) (44 to 104 in.) | Aluminum alloy |

T05-1.EPS

Grounding Ring/Grounding Electrode:

- Grounding Ring(plate type)
Stainless steel-JIS SUS316 (AISI 316 SS/EN 1.4401 equivalent),
Stainless steel-JIS SUS316L (AISI 316L SS/EN 1.4404 equivalent),
Hastelloy*1 C276 equivalent, Titanium,
Stainless steel-JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) for size 500 to 1000mm (20 to 40 in.) only,
SS400 carbon steel lined with stainless steel-JIS SUS316 (AISI 316 SS/EN 1.4401 equivalent) for size 1100 to 2600mm (44 to 104 in.) only.
- Grounding Electrode(electrode type)
Fluorocarbon PFA lining + grounding electrode (Tantalum, Platinum-Iridium)

*1: Hastelloy is a registered trademark of Haynes International Inc.

*2: Available with sizes 2.5 to 200mm (0.1 to 8.0 in.), PFA and ceramics linings only. However, the permeable fluids (such as nitric acid, hydrofluoric acid, or sodium hydroxide at high temperature) are unusable.

Wetted Part Material:**Lining:**

Fluorocarbon PFA*1 lining
Polyurethane Rubber lining
Natural Soft Rubber lining*2
EPDM Rubber lining*3
Alumina ceramics lining






- *1: PFA is FDA (U.S. Food and Drug Administration) approval material.
- *2: Natural soft rubber is a material which can reduce wear of the lining due to fluids mixed with slurries. If the concentration of mixed slurries is high, contact Yokogawa as necessary measures need to be taken separately for the electrodes.
- *3: EPDM rubber lining is superior in the ozone proof.

Electrode:





Stainless steel-JIS SUS316L (AISI 316L SS/EN 1.4404 equivalent), Hastelloy*1 C276 equivalent, Titanium, Tantalum, Platinum-Iridium, Tungsten Carbide, Platinum-Alumina cermet(only for ceramics lining)

Note : For size over 500 mm and sanitary type, SUS316L only.

Gasket:


| Use | General-Purpose Use / Submersible Type / Explosion proof Type | |
|--|--|---|
| Lining | PFA/Polyurethane Rubber/ Natural Soft Rubber/ EPDM Rubber | Ceramics |
| Standard |  No gasket within Flowtube |  Gasket within Flowtube |
| | Gasket Material (within Flowtube) | |
| | — | |
| | Fluororesin with ceramic fillers (Valqua #7020) | |
| Optional code (GA, GC, GD, or GF) |  Gasket within Flowtube |  Gasket within Flowtube |
| | Gasket Material (within Flowtube) | |
| | GA: Fluororubber for PVC pipes (Viton®) GC: Acid-resistant fluororubber for PVC pipes (Viton®) GD: Alkali-resistant fluororubber for PVC pipes (Viton®) GF*1: Fluororesin with alkali-resistant carbons for metal pipes | |
| | *1: GF is applicable only for ceramics lining. | |
| Optional code (BCF, BSF, BCC, or BSC) |  Flange of user's pipe Gasket for user's flange | |
| | Gasket Material (for user's flange) | |
| | BCF, BSF: PTFE-sheathed non-asbestos BCC, BSC: Chloroprene rubber | |

T23-1.EPS

| Use | Sanitary Type |
|-----------------------|---|
| Lining | PFA |
| Standard |  Adapter for clamp connection |
| |  Adapter for union connection |
| |  Adapter for butt weld connection |
| |  Gasket within Flowtube |
| Optional code (GH) | Gasket Material (within Flowtube) |
| | EPDM (ethylene propylene) rubber |
| Optional code (GH) | GH: Silicone rubber |





T23-2.EPS

Joints:

| Lining | Ceramics Union Joints (size 10 mm or less) | |
|----------|---|---|
| Standard |  weld joint (GUW) screw joint (GUN, GUR) | |
| | Gasket within Flowtube | |
| | Materials for Union Joint | |
| | Process Connection Code GUW: Union Joint (weld joint) GUN, GUR: union joint (screw joint) | Stainless steel (JIS SUS316L (ANSI 316L SS/EN 1.4404 equivalent)) |

Note: Contact Yokogawa office if PVC union joint is required.

T23-3.EPS

| Use | Sanitary Type |
|--|---|
| Standard |  Adapter for clamp connection |
| |  Adapter for union connection |
| |  Adapter for butt weld connection |
| |  Gasket within Flowtube |
| Optional code (BCF, BSF, BCC, or BSC) | Materials for Adapters (clamp, union, butt weld) |
| | Stainless steel-JIS SUS316L or SUSF316L (AISI 316L SS/EN 1.4404 equivalent or ANSI F316L SS/EN 1.4435 equivalent) |

T23-4.EPS

O-Ring (Replaceable electrode type only):

Fluororubber (Part number : G9303SE)

Recommended Gaskets Between Flowtubes**And User's Flanges:****Gaskets Type**

Use compressed non-asbestos fiber gaskets, PTFE-sheathed non-asbestos gaskets or gaskets which have equivalent elasticity.

For optional codes GA, GC, and GD, use rubber gaskets or others which have equivalent elasticity (such as Teflon-coated rubber gaskets).

Gaskets Size

Be sure to choose a gasket with an inner and outer diameter that does not protrude inside the piping (refer to Table 3.3.13).

If the inner diameter of the gasket is too large, or outer diameter of the gasket is too small, fluid leakage may result.

Electrode Construction:**Non-replaceable Electrode Type**

General-Purpose Use/Submersible Type/Explosion proof Type:

PFA, Polyurethane Rubber lining:
External insertion type

Natural Soft Rubber, EPDM Rubber lining:
Internal insertion type
Ceramics lining: Integral type
Sanitary Type: Internal insertion type

Replaceable Electrode Type

Electrode parts can be put into unit to facilitate replacement or mounting at customer site.
The optional dedicated tool (F9807SK) is required.

Replaceable electrodes are available for the following:

AXF standard:

| Use | Process Connection | Available Size | Lining | Electrode Material |
|---------------------|--------------------|---------------------------------|--------------------------------|---|
| General-Purpose Use | Wafer | 25 to 300 mm (1.0 to 12 in.) | PFA/ Polyurethane Rubber | JIS SUS316L (AISI 316L SS/EN 1.4404 equivalent) ^{(*)1} |
| | Flange | 25 to 400 mm (1.0 to 16 in.) | | |

T06.EPS

Replacement model for earlier ADMAG or ADMAG AE:

| Use | Process Connection | Available Size | Lining | Electrode Material |
|---------------------|--------------------|----------------------------------|--------------------------------|---|
| General-Purpose Use | Flange | 150 to 250 mm (6.0 to 10 in.) | PFA/ Polyurethane Rubber | JIS SUS316L (AISI 316L SS/EN 1.4404 equivalent) ^{(*)1} |

T07.EPS

*1: If any other electrode materials are required, please contact Yokogawa office.

Mounting/Shapes (Remote Flowtube):

- Electrical Connection: ANSI 1/2 NPT female
ISO M20 × 1.5 female
JIS G1/2 (PF1/2) female
- Direction of Electrical Connection: The direction can be changed even after delivery.
Note: In case of submersible types, an optional code DHC, and sizes of 1100 mm or larger, the direction can not be changed after delivery.
- Terminal Connection at Terminal Box: M4 size screw

Grounding:

Grounding resistance 100 Ω or less

- * In case of explosion proof type except TIIS, follow the domestic electrical requirements as regulated in each country.
- * In case of TIIS Flameproof type, refer to description of "HAZARDOUS AREA CLASSIFICATION".

Combined Converter:

- A remote flowtube for sizes of up to 400 mm can be combined with the AXFA11 Converter or the AXFA14 Converter. If a combined converter is changed from AXFA11 to AXFA14 or vice versa, a new meter factor must be adjusted by flow calibrations.
- In case that size 250 mm (10 in.) or larger is used in low conductivity or high concentration slurries, please use the AXFA11 Converter.
- A remote flowtube for sizes of 500 mm or larger can be combined with the AXFA11 Converter only.
- Maximum Cable Length:
Combination of AXF remote Flowtube and AXFA11:
up to 200 m (660 ft)
Combination of AXF remote Flowtube and AXFA14:
up to 100 m (330 ft)

HAZARDOUS AREA CLASSIFICATION

Refer to Chapter 8.

STANDARD PERFORMANCE

Accuracy

Note: The accuracy of a product before shipment is defined as totalized value at the result of calibration test in our water actual flow test facility.
Calibrated conditions in our water actual test facility are as follows:

Fluid temperature; 20 ± 10°C
Ambient temperature; 20 ± 5°C
Length of straight runs; 10 D or more on the upstream side; 5 D or more on the downstream side
Reference conditions; Similar to BS EN29104 (1993); ISO 9104 (1991)

Pulse Output:


PFA/Ceramics Lining;

| Size mm (in.) | Flow Velocity V m/s (ft/s) | Standard Accuracy (Calibration code B) | Flow Velocity V m/s (ft/s) | High Grade Accuracy (Calibration code C) |
|-----------------------|----------------------------------|--|-------------------------------|--|
| 2.5 (0.1) to 15 (0.5) | $V < 0.3$ (1) | ±1.0 mm/s | — | — |
| | $0.3 \leq V \leq 10$ (1) (33) | ±0.35% of Rate | | |
| 25 (1.0) to 200 (8.0) | $V < 0.15$ (0.5) | ±0.5 mm/s | $V < 0.15$ (0.5) | ±0.5 mm/s |
| | $0.15 \leq V \leq 10$ (0.5) (33) | ±0.35% of Rate | $0.15 \leq V < 1$ (0.5) (3.3) | ±0.18% of Rate ±0.2mm/s |
| | | | $1 \leq V \leq 10$ (3.3) (33) | ±0.2% of Rate |
| 250 (10) to 400 (16) | $V < 0.15$ (0.5) | ±0.5 mm/s | — | — |
| | $0.15 \leq V \leq 10$ (0.5) (33) | ±0.35% of Rate | | |

T08.EPS


Enhanced dual frequency excitation (Option code HF2):
Standard accuracy ±1 mm/s

Size 2.5 mm (0.1 in.) to 15 mm (0.5 in.)

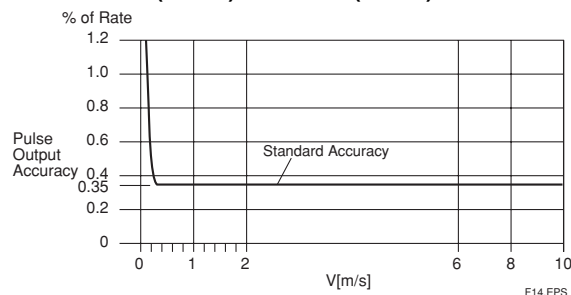

F14.EPS

Size 25 mm (1.0 in.) to 400 mm (16 in.)

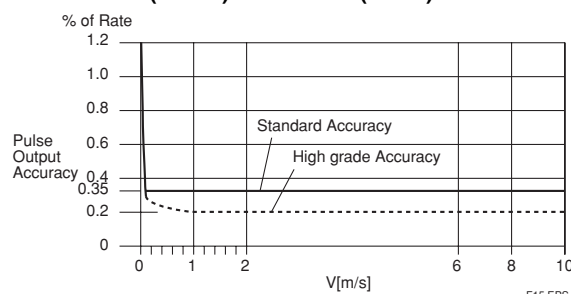


F15.EPS

**Polyurethane Rubber /Natural Soft Rubber /
EPDM Rubber Lining:**


| Size mm (in.) | Flow Velocity V m/s (ft/s) | Standard Accuracy (Calibration code B) |
|-------------------------------|------------------------------------|---|
| 25 (1.0) to 400 (16) | $V < 0.3$ (1.0) | ± 1.0 mm/s |
| | $0.3 \leq V \leq 10$ (1.0) (33) | $\pm 0.35\%$ of Rate |
| 500 (20) to 1000 (40) | $V < 0.3$ (1.0) | ± 1.75 mm/s |
| | $0.3 \leq V < 1$ (1.0) (3.3) | $\pm 0.25\%$ of Rate ± 1 mm/s |
| | $1 \leq V \leq 10$ (3.3) (33) | $\pm 0.35\%$ of Rate |
| 1100 (44) to 2000 (80) | $V < 0.3$ (1.0) | ± 2.2 mm/s |
| | $0.3 \leq V < 1$ (1.0) (3.3) | $\pm 0.4\%$ of Rate ± 1 mm/s |
| | $1 \leq V \leq 10$ (3.3) (33) | $\pm 0.5\%$ of Rate |
| 2200 (88) to 2600 (104) | $V < 1$ (3.3) | ± 8.5 mm/s |
| | $1 \leq V \leq 10$ (3.3) (33) | $\pm 0.85\%$ of Rate |

T09.EPS


Enhanced dual frequency excitation (Option code HF2) :
Standard accuracy ± 1 mm/s

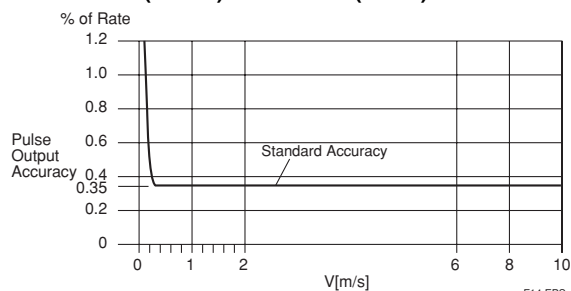Size 25 mm (1.0 in.) to 400 mm (16 in.)


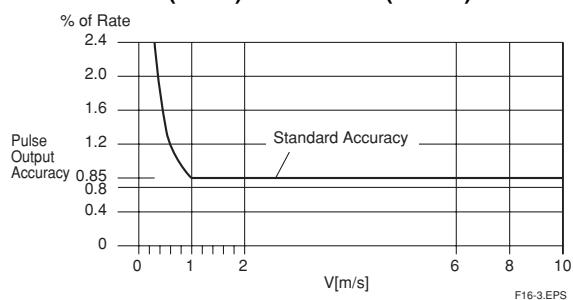
F14.EPS

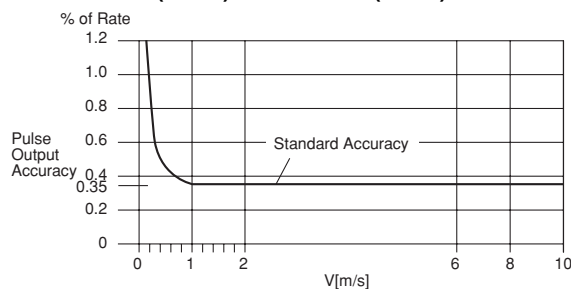Size 500 mm (20 in.) to 1000 mm (40 in.)


F16-1.EPS

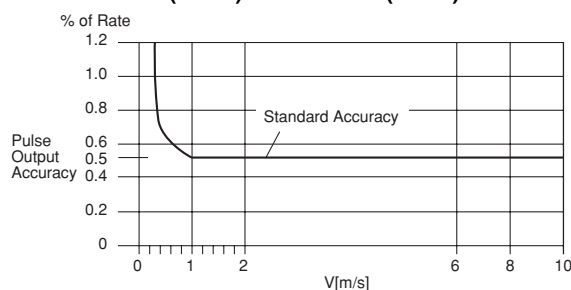Size 1100 mm (44 in.) to 2000 mm (80 in.)


F16-2.EPS

Size 2200 mm (88 in.) to 2600 mm (104 in.)


F16-3.EPS

Current Output “◇”: Pulse output accuracy plus
 $\pm 0.05\%$ of Span

Repeatability:

$\pm 0.1\%$ of Rate ($V \geq 1$ m/s (3.3 ft/s))
 $\pm 0.05\%$ of Rate ± 0.5 mm/s ($V < 1$ m/s (3.3 ft/s))

Maximum Power Consumption:

Integral Flowmeter: 12W

Remote Flowtube: Combined with AXFA11: 20W
Combined with AXFA14: 12W

Insulation Resistance (*1):

Integral Flowmeter:

Between power supply terminals and ground terminal : 100MΩ at 500V DC
Between power supply terminals and input/output terminals : 100MΩ at 500V DC
Between ground terminal and input/output terminals : 20MΩ at 100V DC
Between input/output terminals : 20MΩ at 100V DC

Remote Flowtube:

Between excitation current terminal and signal /common terminals : 100MΩ at 500V DC
Between signal terminals : 100MΩ at 500V DC
Between signal terminals and common terminal (C) : 100MΩ at 500V DC

Withstand Voltage (*1):

Integral Flowmeter

Between power supply terminals and ground terminal : 1390V AC for 2 seconds
Between power supply terminals and input/output terminals : 1390V AC for 2 seconds

Remote Flowtube (option code JF3, KF2, CF1, and SF2)

Between excitation current terminal and ground terminal : 1500V AC for 1 minute
Between signal terminals and ground terminal : 1500V AC for 1 minute
Between signal terminals and excitation current terminal : 2000V AC for 1 minute

Remote Flowtube (option code FF1)

Between signal terminals and ground terminal : 500V AC for 1 minute or 600V AC for 1 second
Between signal terminals and excitation current terminal : 2000V AC for 1 minute or 2400V AC for 1 second.

**CAUTION**

- *1: When performing the Insulation Resistance Test or the Withstand Voltage Test, please obey the following caution.
- Following the relevant test, wait for more than 10 seconds after the power supply has been turned off before removing the cover.
 - Remove all wires from terminals before testing.
 - When the power terminal has a lighting protector (optional code A), remove the short bar at the ground terminal.
 - After testing, be sure to discharge by using a resistance and return all wires and the short bar to its correct position.
 - Screws must be tightened to a torque of 1.18 N-m or more.
 - After closing the cover, the power supply can be restored.

Safety Requirement Standards:

EN61010-1

- Altitude at installation site: Max. 2000 m above sea level
- Installation category based on IEC1010: Overvoltage category II ("II" applies to electrical equipment which is supplied from the fixed installation like distribution board.)
- Pollution degree based on IEC1010
Pollution degree 2 ("Pollution degree" describes the degree to which a solid, liquid, or gas which deteriorates dielectric strength or surface resistivity is adhering. "2" applies to a normal indoor atmosphere.)

EMC Conformity Standards: CE , N200

EN61326-1 Class A, Table 2 (For use in industrial locations)

EN61326-2-3

EN61000-3-2 Class A

EN61000-3-3

**CAUTION**

This instrument is a class A product, and it is designed for use in the industrial environment.

Please use this instrument in the industrial environment only.

■ NORMAL OPERATING CONDITIONS**Ambient Temperature:** -40° to $+60^{\circ}\text{C}$ (-40° to $+140^{\circ}\text{F}$)

*1: Minimum temperature should also be limited according to minimum fluid temperature of flow tube's specification.

Refer to description of "Fluid Temperature and Pressure".

*2: Indicator's operating range (integral flowmeter): -20° to $+60^{\circ}\text{C}$ (-4° to $+140^{\circ}\text{F}$)

*3: Maximum temperature should be $+50^{\circ}\text{C}$ ($+122^{\circ}\text{F}$) in the case of power supply code 2 (integral flowmeter).

Ambient Humidity: 0 to 100%

Lengthy continuous operation at 95% or more is not recommended.

Power Supply (integral flowmeter):**Power supply code 1:**

- AC specifications

Rated power supply: 100 to 240 V AC, 50/60 Hz
(Operating voltage range: 80 to 264 V AC)

- DC specifications

Rated power supply: 100 to 120 V DC
(Operating voltage range: 90 to 130 V DC)

Power supply code 2:


- AC specifications

Rated power supply: 24 V AC, 50/60 Hz
(Operating voltage range: 20.4 to 28.8 V AC)

- DC specifications

Rated power supply: 24 V DC
(Operating voltage range: 20.4 to 28.8 V DC)

**Supply Voltage and
Cable Length for Power Supply Code 2**

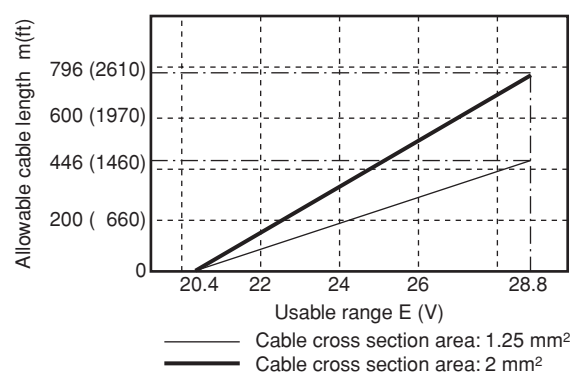

F01.EPS

Fluid Conductivity:

Size 2.5 to 10 mm (0.1 to 0.4 in.): 5 $\mu\text{S}/\text{cm}$ or larger

Size 15 to 125 mm (0.5 to 5 in.): 1 $\mu\text{S}/\text{cm}$ or larger


Size 150 to 400 mm (6 to 16 in.): 3 $\mu\text{S}/\text{cm}$ or larger

Note: For a fluid with large flow noise (pure water, pure alcohol or others), or a fluid with low conductivity and low viscosity, the output fluctuates and is impossible to measure accurately.


Size 500 to 2600 mm (20 to 104 in.): 50 $\mu\text{S}/\text{cm}$ or larger.

Cable Length and Liquid Conductivity (Remote Flowtube):


Size 2.5 to 10 mm (0.1 to 0.4 in.)

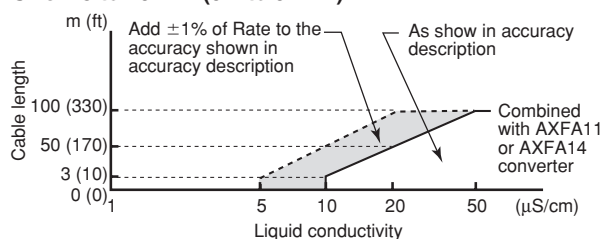

Size 15 to 125 mm (0.5 to 5.0 in.)

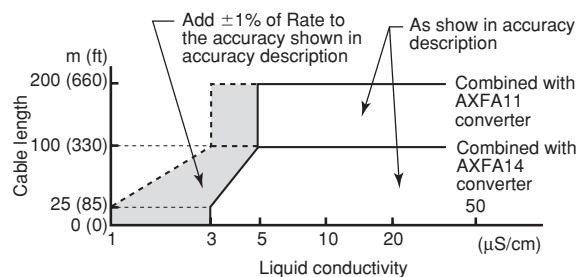


Size 150 to 400 mm (6.0 to 16 in.)

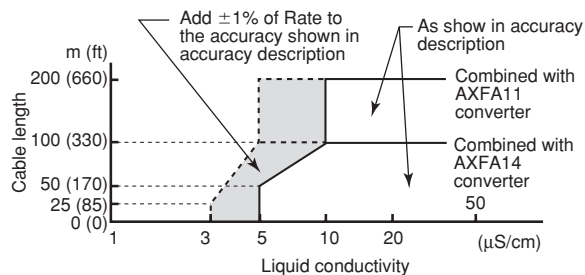

F03.EPS

Note: In case that size 250 or 300 mm (10 or 12 in.) is used for high conductivity fluid (ex. caustic soda, seawater), please use the flange type.

Size 500 to 2600 mm (20 to 104 in.)

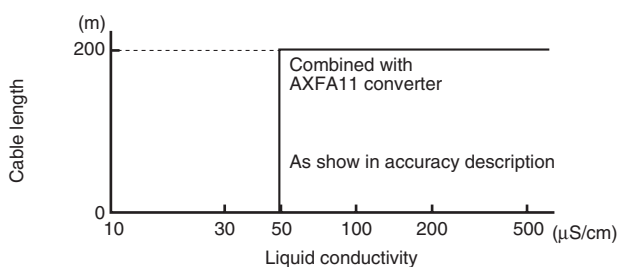

F02.EPS

Measurable Flow Rate Range:

SI Units (Size: mm, Flow rate: m³/h)

| Size (mm) | 0 to Min. Span Flow Rate (0.1 m/s) | 0 to Max. Span Flow Rate (10 m/s) |
|-----------|------------------------------------|-----------------------------------|
| 2.5 | 0 to 0.0018 m³/h | 0 to 0.1767 m³/h |
| 5 | 0 to 0.0071 | 0 to 0.7068 |
| 10 | 0 to 0.0283 | 0 to 2.8274 |
| 15 | 0 to 0.0637 | 0 to 6.361 |
| 25 | 0 to 0.1768 | 0 to 17.671 |
| 32 | 0 to 0.2896 | 0 to 28.952 |
| 40 | 0 to 0.4524 | 0 to 45.23 |
| 50 | 0 to 0.7069 | 0 to 70.68 |
| 65 | 0 to 1.1946 | 0 to 119.45 |
| 80 | 0 to 1.8096 | 0 to 180.95 |
| 100 | 0 to 2.8275 | 0 to 282.74 |
| 125 | 0 to 4.418 | 0 to 441.7 |
| 150 | 0 to 6.362 | 0 to 636.1 |
| 200 | 0 to 11.310 | 0 to 1,130.9 |
| 250 | 0 to 17.672 | 0 to 1,767.1 |
| 300 | 0 to 25.447 | 0 to 2,544.6 |
| 350 | 0 to 34.64 | 0 to 3,463 |
| 400 | 0 to 45.24 | 0 to 4,523 |
| 500 | 0 to 70.69 | 0 to 7,068 |
| 600 | 0 to 101.79 | 0 to 10,178 |
| 700 | 0 to 138.55 | 0 to 13,854 |
| 800 | 0 to 180.96 | 0 to 18,095 |
| 900 | 0 to 229.03 | 0 to 22,902 |
| 1000 | 0 to 282.75 | 0 to 28,274 |

T11-1.EPS

| Size (mm) | 0 to Min. Span Flow Rate (0.3 m/s) | 0 to Max. Span Flow Rate (10 m/s) |
|-----------|------------------------------------|-----------------------------------|
| 1100 | 0 to 1,026.4 m³/h | 0 to 34,211 m³/h |
| 1200 | 0 to 1,221.5 | 0 to 40,715 |
| 1350 | 0 to 1,545.9 | 0 to 51,529 |
| 1500 | 0 to 1,908.6 | 0 to 63,617 |
| 1600 | 0 to 2,171.5 | 0 to 72,382 |
| 1800 | 0 to 2,748.3 | 0 to 91,608 |
| 2000 | 0 to 3,393 | 0 to 113,097 |
| 2200 | 0 to 4,106 | 0 to 136,847 |
| 2400 | 0 to 4,886 | 0 to 162,860 |
| 2600 | 0 to 5,735 | 0 to 191,134 |

T11-1.EPS

English Units (Size: in., Flow rate: GPM)

| Size (in.) | 0 to Min. Span Flow Rate (0.33ft/s) | 0 to Max. Span Flow Rate (33ft/s) |
|------------|-------------------------------------|-----------------------------------|
| 0.1 | 0 to 0.0078 GPM | 0 to 0.7780 GPM |
| 0.2 | 0 to 0.0312 | 0 to 3.112 |
| 0.4 | 0 to 0.1245 | 0 to 12.44 |
| 0.5 | 0 to 0.1946 | 0 to 19.45 |
| 1.0 | 0 to 0.7781 | 0 to 77.80 |
| 1.25 | 0 to 1.216 | 0 to 121.5 |
| 1.5 | 0 to 1.751 | 0 to 175.0 |
| 2.0 | 0 to 3.113 | 0 to 311.2 |
| 2.5 | 0 to 4.863 | 0 to 486.2 |
| 3.0 | 0 to 7.003 | 0 to 700.2 |
| 4.0 | 0 to 12.45 | 0 to 1,244 |
| 5.0 | 0 to 19.46 | 0 to 1,945 |
| 6.0 | 0 to 28.01 | 0 to 2,800 |
| 8.0 | 0 to 49.80 | 0 to 4,979 |
| 10 | 0 to 77.81 | 0 to 7,780 |
| 12 | 0 to 112.1 | 0 to 11,203 |
| 14 | 0 to 152.5 | 0 to 15,249 |
| 16 | 0 to 199.2 | 0 to 19,918 |
| 20 | 0 to 311.3 | 0 to 31,122 |
| 24 | 0 to 448.2 | 0 to 44,815 |
| 28 | 0 to 610.0 | 0 to 60,999 |
| 32 | 0 to 796.8 | 0 to 79,672 |
| 36 | 0 to 1,009 | 0 to 100,835 |
| 40 | 0 to 1,245 | 0 to 124,488 |

T24.EPS



| Size (in.) | 0 to Min. Span Flow Rate (1.0ft/s) | 0 to Max. Span Flow Rate (33ft/s) |
|------------|------------------------------------|-----------------------------------|
| 44 | 0 to 4,519 GPM | 0 to 150,630 GPM |
| 48 | 0 to 5,378 | 0 to 179,262 |
| 54 | 0 to 6,807 | 0 to 226,879 |
| 60 | 0 to 8,403 | 0 to 280,098 |
| 64 | 0 to 9,561 | 0 to 318,689 |
| 72 | 0 to 12,101 | 0 to 403,341 |
| 80 | 0 to 14,939 | 0 to 497,952 |
| 88 | 0 to 18,076 | 0 to 602,522 |
| 96 | 0 to 21,512 | 0 to 717,051 |
| 104 | 0 to 25,247 | 0 to 841,540 |

T24-1.EPS

Fluid Temperature and Pressure:



Note *1 The following figures show maximum allowable fluid pressure for the flowtube. Further fluid pressure should also be limited according to flange rating.

*2 For fluid temperature of the explosion proof type, refer to descriptions of "HAZARDOUS AREA CLASSIFICATION".

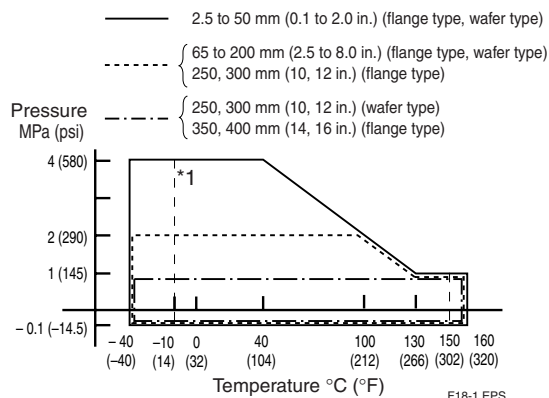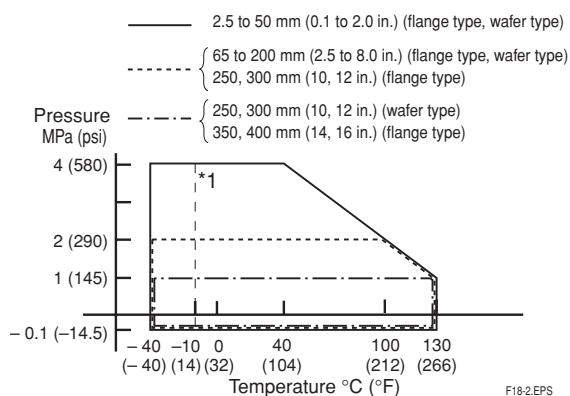
PFA Lining (*1)**General-Purpose Use, Submersible Type, Explosion proof Type, Remote Flowtube (electrode structure code 1: Non-replaceable electrode)****General-Purpose Use and Explosion proof Type, Integral Flowmeter (electrode structure code 1: Non-replaceable electrode)**

*1: For wafer types of 32 mm to 300 mm (1.25 to 12 in.), and for carbon steel flange types (process connection code: C**) of 50 to 400 mm (2.0 to 16 in.), the minimum temperature is -10°C (14°F).



*2: For fluid temperature of the explosion proof type, refer to descriptions of "HAZARDOUS AREA CLASSIFICATION".

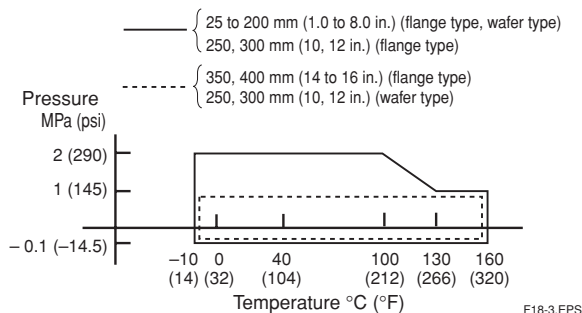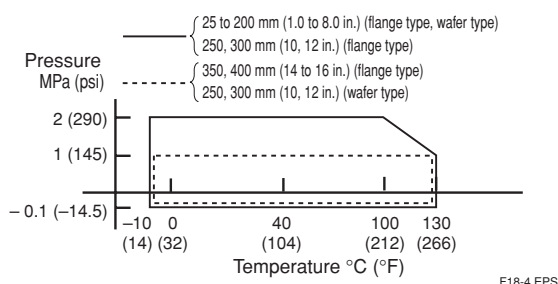General-Purpose Use, Remote Flowtube (electrode structure code 2: replaceable electrode)

General-Purpose Use, Integral Flowmeter (electrode structure code 2: replaceable electrode)

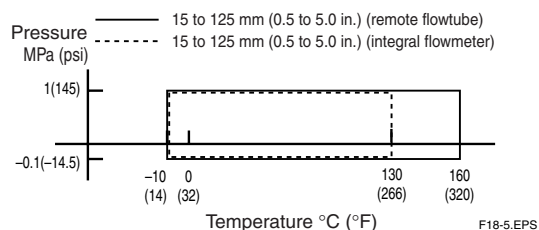
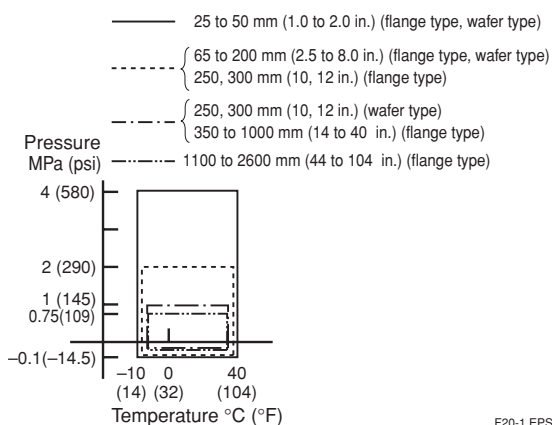
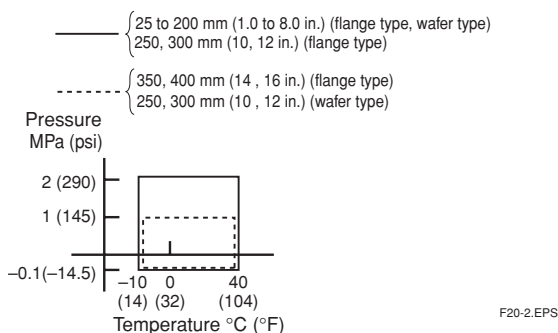
Note: For replaceable electrodes for fluid temperatures of -10°C (14°F) or less, please contact Yokogawa office.

Sanitary Type (electrode structure code 1: Non-replaceable electrode)

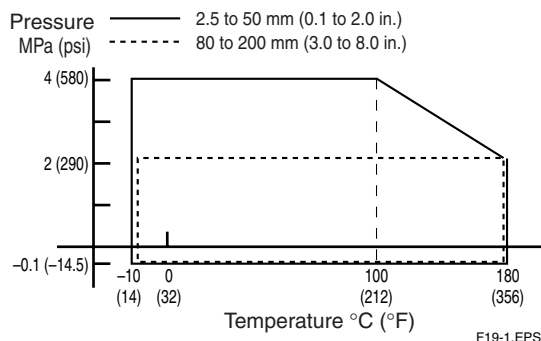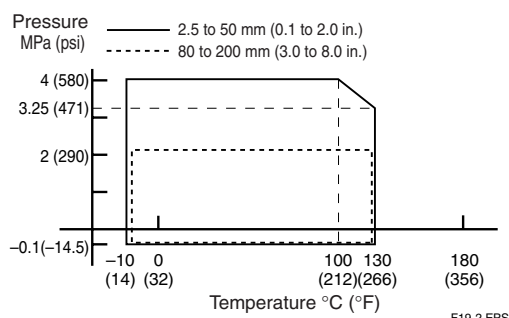
Note: In case of 120 to 160°C (248 to 320°F) of fluid temperature, please select optional code GH.


Ceramics Lining
General-Purpose Use and Explosion proof Type, Remote Flowtube (electrode structure code 1: Non-replaceable electrode)

General-Purpose Use and Explosion proof Type, Integral flowmeter (electrode structure code 1: Non-replaceable electrode)


*1: For fluid temperature of the explosion proof type, refer to descriptions of "HAZARDOUS AREA CLASSIFICATION".

Polyurethane Rubber Lining
General-Purpose Use and Submersible Type, Remote Flowtube (electrode structure code 1: Non-replaceable electrode)

General-Purpose Use, Integral Flowmeter (electrode structure code 2: replaceable electrode)

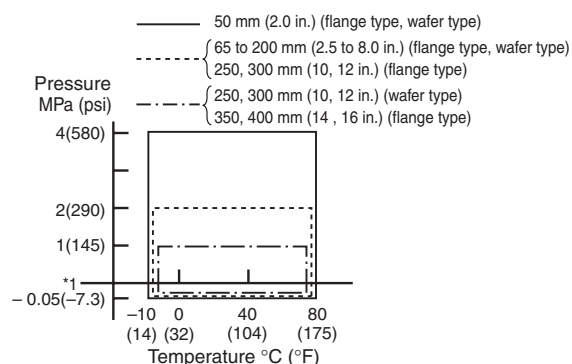
Natural Soft Rubber Lining

General-Purpose Use and Submersible Type, Remote Flowtube (electrode structure code 1: Non-replaceable electrode)




*1 : -0.04 MPa (-5.7 psi) for sizes of 350 mm (14 in.) and 400 mm (16 in.)

F05-2.EPS

EPDM Rubber Lining

General-Purpose Use and Submersible Type, Remote Flowtube (electrode structure code 1: Non-replaceable electrode)

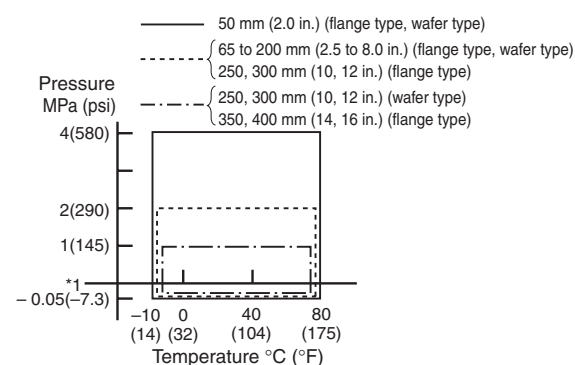


*1 : -0.04 MPa (-5.7 psi) for sizes of 350 mm (14 in.) and 400 mm (16 in.)


F05-3.EPS

Reasonable Figure for Thermal Shock of Creamics Lining:


Size 2.5 to 25 mm (0.1 to 1.0 in.)

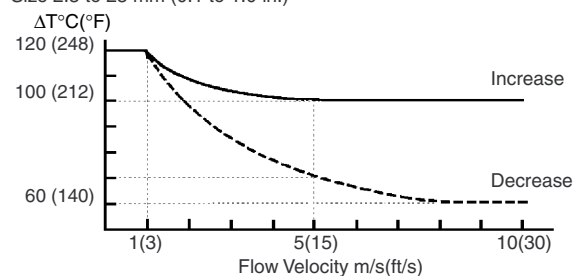

Size 40 and 50 mm (1.5 and 2.0 in.)

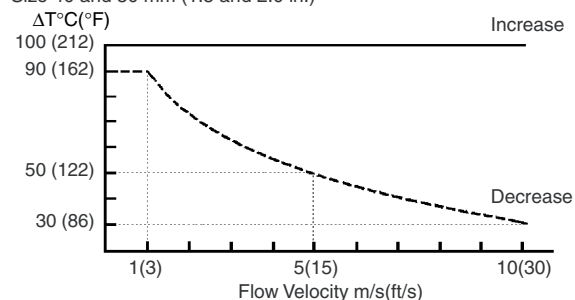

Size 80 to 200 mm (3.0 to 8.0 in.)

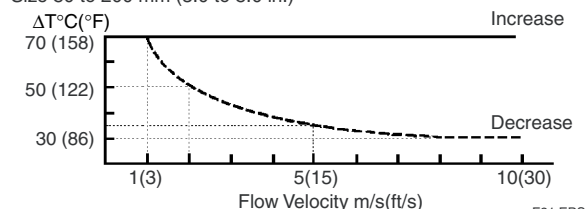

F21.EPS

“Decrease” means that the temperature of a measured fluid drops rapidly, while “increase” means that the temperature rises rapidly. The maximum allowable ranges in both cases are indicated by the curves shown in the diagrams, with the solid line indicating the maximum increase, and the broken line the maximum decrease.

ΔT : Change in temperature of measured fluid in one second

Flow velocity: flow velocity of the measured fluid

Allowable Conditions for Cleaning Sanitary Type Linings

Steam or hot water cleaning: Max.temp.= 150 °C (302°F),
time= 60 minutes or less

Vibration Conditions:

Level of vibration in conformity with IEC 60068-2-6 (SAMA 31.1-1980)

- Integral Flowmeter: 9.8 m/s² or less (frequency of 500 Hz or less)
- Remote Flowtube (size 2.5 to 400 mm (0.1 to 16 in.)): 19.6 m/s² or less (frequency of 500 Hz or less)

Note: Avoid locations with much vibration (where the pipe vibration frequency is 500 Hz or more), which may cause damage to the equipment.

■ ACCESSORIES

Remote Flowtube (size 2.5 to 1000 mm(0.1 to 40 in.)):

- Centering device (wafer type only): 1 pc.
- Hexagonal wrench: 2 pcs.


Integral Flowmeter:

- Centering device (wafer type only): 1 pc.
- Hexagonal wrench: 2 pcs.

■ TERMINAL CONFIGURATION AND TERMINAL WIRING

● Integral Flowmeter “◇”

Terminal configuration




Terminal wiring

| Terminal Symbols | Description |
|------------------|--|
| | Functional grounding |
| | Power supply |
| | Current output 4 to 20mA DC |
| | Pulse output/Alarm output/Status output |
| | Alarm output/Status output/Status input |
| | Protective grounding (Outside of the terminal) |


F41.EPS

● Remote Flowtube


Terminal configuration




size 2.5 to 400 mm (0.1 to 16 in.)



(Only for Explosion proof type)



size 500 to 1000 mm (20 to 40 in.)



size 1100 to 2600 mm (44 to 104 in.)

Terminal wiring

| Terminal Symbols | Description |
|------------------|--|
| | Flow signal output |
| | Excitation current input |
| | Functional grounding (Only for explosion proof type) |
| | Protective grounding (Outside of the terminal) |

F42.EPS

Note: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached.


MODEL AND SUFFIX CODE


AXF STANDARD (Wafer Type)

General-purpose Use/Submersible Type/Explosion proof Type, PFA/Polyurethane Rubber/Natural Soft Rubber/EPDM Rubber Lining

| Model | Suffix Code | Description | Applicable Model |
|--|-------------|--|--|
| AXF002 | | Size 2.5 mm (0.1 in.) Integral Flowmeter/Remote Flowtube | |
| AXF005 | | Size 5 mm (0.2 in.) Integral Flowmeter/Remote Flowtube | |
| AXF010 | | Size 10 mm (0.4 in.) Integral Flowmeter/Remote Flowtube | |
| AXF015 | | Size 15 mm (0.5 in.) Integral Flowmeter/Remote Flowtube | |
| AXF025 | | Size 25 mm (1.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF032 | | Size 32 mm (1.25 in.) Integral Flowmeter/Remote Flowtube | |
| AXF040 | | Size 40 mm (1.5 in.) Integral Flowmeter/Remote Flowtube | |
| AXF050 | | Size 50 mm (2.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF065 | | Size 65 mm (2.5 in.) Integral Flowmeter/Remote Flowtube | |
| AXF080 | | Size 80 mm (3.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF100 | | Size 100 mm (4.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF125 | | Size 125 mm (5.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF150 | | Size 150 mm (6.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF200 | | Size 200 mm (8.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF250 | | Size 250 mm (10 in.) Integral Flowmeter/Remote Flowtube | |
| AXF300 | | Size 300 mm (12 in.) Integral Flowmeter/Remote Flowtube | |
| Use | G | General-Purpose Use | |
| | W | Submersible Type | Size 15 mm (0.5 in.) to 300 mm (12 in.) Remote Flowtube only |
| | C | Explosion proof Type (*5) | PFA lining only |
| Converter Output Signal and Communication | -D | Integral Flowmeter with 4 to 20mA DC Output and BRAIN Communication | |
| | -E | Integral Flowmeter with 4 to 20 mA DC Output and HART Communication | |
| | -F | Integral Flowmeter with Digital communication (FOUNDATION Fieldbus protocol) (*9) | |
| | -G | Integral Flowmeter with Digital communication (PROFIBUS PA protocol) (*10) | |
| | -N | Remote Flowtube for Combined Use with AXFA11 | |
| | -P | Remote Flowtube for Combined Use with AXFA14 | |
| Power Supply | 1 | Integral Flowmeter, 100 V to 240 V AC or 100 to 120 V DC | |
| | 2 | Integral Flowmeter, 24V AC/DC | |
| | N | Remote Flowtube | |
| Lining (*8) | A | Fluorocarbon PFA | |
| | U | Polyurethane Rubber | Size 25 mm (1.0 in.) to 300 mm (12 in.) |
| | D | Natural Soft Rubber | Size 50 mm (2.0 in.) to 300 mm (12 in.) |
| | G | EPDM Rubber | Size 50 mm (2.0 in.) to 300 mm (12 in.) |
| Electrode Material (*8) | L | JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) | |
| | P | Platinum-iridium | PFA lining only |
| | H | Hastelloy C276 Equivalent | |
| | T | Tantalum | PFA lining only |
| | V | Titanium | |
| | W | Tungsten Carbide | Size 15 mm (0.5 in.) to 300 mm (12 in.), PFA/Polyurethane Rubber lining only |
| Electrode Structure | 1 | Non-replaceable | |
| | 2 | Replaceable | General-Purpose use, Size 25 mm (1.0 in.) to 300 mm (12 in.), PFA/Polyurethane Rubber lining only Electrode Material: JIS SUS316L only |
| Grounding Ring and Grounding Electrode Material (*8) | N | None | |
| | S | JIS SUS316 (AISI 316 SS/EN 1.4401 Equivalent) | |
| | L | JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) | |
| | P | Platinum-iridium | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.), PFA lining only |
| | H | Hastelloy C276 Equivalent | |
| | T | Tantalum | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.), PFA lining only |
| | V | Titanium | |
| Process Connection (*3)(*11) | -AA1 | ANSI Class 150 Wafer (*1) | Size 2.5 mm (0.1 in.) to 300 mm (12 in.) |
| | -AA2 | ANSI Class 300 Wafer (*1) | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.) |
| | -AD1 | DIN PN 10 Wafer (*2) | Size 200 mm (8.0 in.) to 300 mm (12 in.) |
| | -AD2 | DIN PN 16 Wafer (*2) | Size 65 mm (2.5 in.) to 300 mm (12 in.) |
| | -AD4 | DIN PN 40 Wafer (*1)(*2) | Size 2.5 mm (0.1 in.) to 50 mm (2.0 in.) |
| | -AJ1 | JIS 10K Wafer (*1) | Size 2.5 mm (0.1 in.) to 300 mm (12 in.) |
| | -AJ2 | JIS 20K Wafer (*1) | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.) |
| | -AG1 | JIS F12 (JIS75M) Wafer | Size 80 mm (3.0 in.) to 300 mm (12 in.) |
| | | | |
| Lay Length | 1 | Standard | |
| Electrical Connection (*6) | -0 | JIS G1/2 female | |
| | -2 | ANSI 1/2 NPT female | Not available for Submersible Type |
| | -4 | ISO M20×1.5 female | Not available for Submersible Type |
| Indicator (*4)(*7) | 1 | Integral Flowmeter with indicator (Horizontal) | |
| | 2 | Integral Flowmeter with indicator (Vertical) | |
| | N | Integral Flowmeter without indicator /Remote Flowtube | |
| Calibration | B | Standard | |
| | C | High Grade (*12) | Size 25 mm (1.0 in.) to 200 mm (8.0 in.), PFA lining only |
| | /□ | Optional code (See the Table of Optional Specifications) | |

T15.EPS


- *1: For a wafer type of 2.5 to 10 mm (0.1 to 0.4 in.), prepare 15 mm (0.5 in.) diameter nominal flanges on the process pipe side.
(Process connection codes: AA1, AA2, AD4, AJ1, and AJ2)
- *2: Even when DIN PN10 or 16 is required for a model of size 2.5 to 50 mm (0.1 to 2.0 in.), select PN40 (Process connection code: AD4) because there is no difference in the dimensions of the mating faces.
Even when DIN PN10 is required for a model of size 65 to 150 mm (2.5 to 6.0 in.), select PN16 (Process connection code: AD2) because there is no difference in the dimensions of the mating faces.
- *3: Mating dimensions are based on standards as follow:
ANSI: ASME B 16.5, DIN: DIN 2501, JIS: JIS B 2220 and JIS G 3443-2
- *4: N shall be always selected for remote flowtubes
In the case of an integral flowmeter, select from among the figures at the right:
- *5: For explosion proof types, specify types of explosion proof certification using the optional codes. In case of TIIS flameproof type, the remote flowtube is available only for combined use with the AXFA14. For the TIIS flameproof type with wiring using a flameproof packing adapter, select optional code G12 or G11. Available only for JIS G1/2 female electrical connections.
- *6: For explosion proof types, JIS G1/2 female electrical connection is available only for TIIS flameproof type.
- *7: In case of integral flowmeters of the TIIS flameproof type, select "with indicator" (code 1 or 2).
- *8:  Users must consider the characteristics of selected wetted parts material and influence of process fluids.
The use of inappropriate materials can result in the leakage of corrosive process fluids and cause injury to personnel and/or damage to plant facilities. It is also possible that the instrument itself can be damaged and that fragments from the instrument can contaminate the user's process fluids.
Be very careful with highly corrosive process fluids such as hydrochloric acid, sulfuric acid, hydrogen sulfide, sodium hypochlorite, and high-temperature steam (150°C [302°F] or above). Contact Yokogawa for detailed information of the wetted parts material.
- *9: For FOUNDATION Fieldbus protocol, refer to IM 01E20F02-01E
- *10: For PROFIBUS PA protocol, refer to IM 01E20F12-01E.
- *11: Allowable fluid pressure should also be limited according to fluid temperature and pressure.
- *12: In the case of calibration code C in remote type, please order a combination of flowtube and converter.



AXF STANDARD (Wafer /Union Joint Type)**General-purpose Use/Explosion proof Type, Ceramics Lining**

| Model | Suffix Code | Description | Applicable Model |
|--|-------------|--|---|
| AXF002 | | Size 2.5 mm (0.1 in.) Integral Flowmeter/Remote Flowtube | |
| AXF005 | | Size 5 mm (0.2 in.) Integral Flowmeter/Remote Flowtube | |
| AXF010 | | Size 10 mm (0.4 in.) Integral Flowmeter/Remote Flowtube | |
| AXF015 | | Size 15 mm (0.5 in.) Integral Flowmeter/Remote Flowtube | |
| AXF025 | | Size 25 mm (1.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF040 | | Size 40 mm (1.5 in.) Integral Flowmeter/Remote Flowtube | |
| AXF050 | | Size 50 mm (2.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF080 | | Size 80 mm (3.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF100 | | Size 100 mm (4.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF150 | | Size 150 mm (6.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF200 | | Size 200 mm (8.0 in.) Integral Flowmeter/Remote Flowtube | |
| Use | G | General-Purpose Use | |
| | C | Explosion proof Type(*5) | |
| Converter Output Signal and Communication | -D | Integral Flowmeter with 4 to 20 mA DC Output and BRAIN Communication | |
| | -E | Integral Flowmeter with 4 to 20 mA DC Output and HART Communication | |
| | -F | Integral Flowmeter with Digital communication (FOUNDATION Fieldbus protocol) (*9) | |
| | -G | Integral Flowmeter with Digital communication (PROFIBUS PA protocol) (*10) | |
| | -N | Remote Flowtube for Combined use with AXFA11 | |
| | -P | Remote Flowtube for Combined use with AXFA14 | |
| Power Supply | 1 | Integral Flowmeter, 100 V to 240 V AC or 100 to 120 V DC | |
| | 2 | Integral Flowmeter, 24 V AC/DC | |
| | N | Remote Flowtube | |
| Lining (*8) | C | Ceramics | |
| Electrode Material (*8) | E | Platinum-alumina Cermet | |
| Electrode Structure | 1 | Non-replaceable | |
| Grounding Ring and Grounding Electrode Material (*8) | N | None | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.) |
| | S | JIS SUS316 (AISI 316 SS/EN 1.4401 Equivalent) | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | L | JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | P | Platinum-iridium | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | H | Hastelloy C276 Equivalent | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | T | Tantalum | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | V | Titanium | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | | | |
| Process Connection (*2) (*11) | -AA1 | ANSI Class 150 Wafer | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | -AA2 | ANSI Class 300 Wafer | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | -AD1 | DIN PN 10 Wafer (*1) | Size 200 mm (8.0 in.) only |
| | -AD2 | DIN PN 16 Wafer (*1) | Size 80 mm (3.0 in.) to 200 mm (8.0 in.) |
| | -AD4 | DIN PN 40 Wafer (*1) | Size 15 mm (0.5 in.) to 50 mm (2.0 in.) |
| | -AJ1 | JIS 10K Wafer | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | -AJ2 | JIS 20K Wafer | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | -AG1 | JIS F12 (JIS75M) Wafer | Size 80 mm (3.0 in.) to 200 mm (8.0 in.) |
| | -GUW | Union Joint (Weld Joint) (*8) | Size 2.5 mm (0.1 in.) to 10 mm (0.4 in.) |
| | -GUN | Union Joint (1/4NPT Male for 2.5 or 5 mm dia.: 3/8NPT Male for 10 mm dia.) (*8) | Size 2.5 mm (0.1 in.) to 10 mm (0.4 in.) |
| | -GUR | Union Joint (R1/4 Male for 2.5 or 5 mm dia.: R3/8 Male for 10mm dia.) (*8) | Size 2.5 mm (0.1 in.) to 10 mm (0.4 in.) |
| Lay Length (*3) | 1 | Standard | |
| Electrical Connection (*6) | -0 | JIS G1/2 female | |
| | -2 | ANSI 1/2 NPT female | |
| | -4 | ISO M20×1.5 female | |
| Indicator (*4)(*7) | 1 | Integral Flowmeter with indicator (Horizontal) | |
| | 2 | Integral Flowmeter with indicator (Vertical) | |
| | N | Integral Flowmeter without indicator /Remote Flowtube | |
| Calibration | B | Standard | |
| | C | High Grade (*12) | Size 25 mm (1.0 in.) to 200mm (8.0 in.) |
| | | /□ Optional code (See the Table of Optional Specifications) | |

T16.EPS


- *1: Even when DIN PN10 or 16 is required for a model of size 2.5 to 50 mm (0.1 to 2.0 in.), select PN40 (Process connection code : AD4) because there is no difference in the dimensions of the mating faces.
Even when DIN PN10 is required for a model of size 65 to 150 mm (2.5 to 6.0 in.), select PN16 (Process connection code : AD2) because there is no difference in the dimensions of the mating faces.
- *2: Mating dimensions are based on standards as follow:
ANSI:ASME B 16.5, DIN: DIN 2501, JIS:JIS B 2220 and JIS G 3443-2
- *3: AXF standard lay length dimension for ceramics linings are the same as those for ADMAG ceramics linings.
- *4: N shall be always selected for remote flowtubes
In the case of an integral flowmeter, select from among the figures at the right:
- *5: For explosion proof types, specify types of explosion proof certification using the optional codes. In case of TIIS flameproof type, the remote flowtube is available only for combined use with the AXFA14. For the TIIS flameproof type with wiring using a flameproof packing adapter, select optional code G12 or G11. Available only for JIS G1/2 female electrical connections.
- *6: For explosion proof types, JIS G1/2 female electrical connection is available only for TIIS flameproof type.
- *7: In case of integral flowmeters of the TIIS flameproof type, select "with indicator"(code 1 or 2).
- *8:  Users must consider the characteristics of selected wetted parts material and influence of process fluids.
The use of inappropriate materials can result in the leakage of corrosive process fluids and cause injury to personnel and/or damage to plant facilities. It is also possible that the instrument itself can be damaged and that fragments from the instrument can contaminate the user's process fluids.
Be very careful with highly corrosive process fluids such as hydrochloric acid, sulfuric acid, hydrogen sulfide, sodium hypochlorite, and high-temperature steam (150°C [302°F] or above). Contact Yokogawa for detailed information of the wetted parts material.
- *9: For FOUNDATION Fieldbus protocol, refer to GS 01E20F02-01E
- *10: For PROFIBUS PA protocol, refer to GS 01E20F12-01E.
- *11: Allowable fluid pressure should also be limited according to fluid temperature and pressure.
- *12: In the case of calibration code C in remote type, please order a combination of flowtube and converter.

AXF STANDARD (Flange Type) Size 2.5 mm (0.1 in.) to 400 mm (16 in.)**General-purpose Use/Submersible Type/Explosion proof Type, PFA/Polyurethane Rubber /Natural Soft Rubber/EPDM Rubber Lining**

| Model | Suffix Code | Description | Applicable Model |
|--|--------------------------|---|---|
| AXF002 | | Size 2.5 mm (0.1 in.) Integral Flowmeter/Remote Flowtube | |
| AXF005 | | Size 5 mm (0.2 in.) Integral Flowmeter/Remote Flowtube | |
| AXF010 | | Size 10 mm (0.4 in.) Integral Flowmeter/Remote Flowtube | |
| AXF015 | | Size 15 mm (0.5 in.) Integral Flowmeter/Remote Flowtube | |
| AXF025 | | Size 25 mm (1.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF032 | | Size 32 mm (1.25 in.) Integral Flowmeter/Remote Flowtube | |
| AXF040 | | Size 40 mm (1.5 in.) Integral Flowmeter/Remote Flowtube | |
| AXF050 | | Size 50 mm (2.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF065 | | Size 65 mm (2.5 in.) Integral Flowmeter/Remote Flowtube | |
| AXF080 | | Size 80 mm (3.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF100 | | Size 100 mm (4.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF125 | | Size 125 mm (5.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF150 | | Size 150 mm (6.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF200 | | Size 200 mm (8.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF250 | | Size 250 mm (10 in.) Integral Flowmeter/Remote Flowtube | |
| AXF300 | | Size 300 mm (12 in.) Integral Flowmeter/Remote Flowtube | |
| AXF350 | | Size 350 mm (14 in.) Integral Flowmeter/Remote Flowtube | |
| AXF400 | | Size 400 mm (16 in.) Integral Flowmeter/Remote Flowtube | |
| Use | G | General-Purpose Use | Size 15 mm (0.5 in.) to 400 mm (16 in.), Remote Flowtube only PFA lining only |
| | W | Submersible Type | |
| | C | Explosion proof Type (*6) | |
| Converter Output Signal and Communication | -D | Integral Flowmeter with 4 to 20 mA DC Output and BRAIN Communication | |
| | -E | Integral Flowmeter with 4 to 20 mA DC Output and HART Communication | |
| | -F | Integral Flowmeter with Digital communication (FOUNDATION Fieldbus protocol) (*10) | |
| | -G | Integral Flowmeter with Digital communication (PROFIBUS PA protocol) (*11) | |
| | -N | Remote Flowtube for Combined Use with AXFA11 | |
| Power Supply | 1 | Integral Flowmeter, 100 V to 240 V AC or 100 to 120 V DC | |
| | 2 | Integral Flowmeter, 24 V AC/DC | |
| | N | Remote Flowtube | |
| Lining (*9) | A | Fluorocarbon PFA | Size 25 mm (1.0 in.) to 400 mm (16 in.) Size 50 mm (2.0 in.) to 400 mm (16 in.) Size 50 mm (2.0 in.) to 400 mm (16 in.) |
| | U | Polyurethane Rubber | |
| | D | Natural Soft Rubber | |
| | G | EPDM Rubber | |
| Electrode Material (*9) | L | JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) | PFA lining only PFA lining only Size 15 mm (0.5 in.) to 400 mm (16 in.), PFA/Polyurethane Rubber lining only |
| | P | Platinum-iridium | |
| | H | Hastelloy C276 Equivalent | |
| | T | Tantalum | |
| | V | Titanium | |
| | W | Tungsten Carbide | |
| Electrode Structure | 1 | Non-replaceable | General-Purpose use, Size 25 mm (1.0 in.) to 400 mm (16 in.) PFA/Polyurethane Rubber lining only Electrode Material: JIS SUS316L only |
| | 2 | Replaceable | |
| Grounding Ring and Grounding Electrode Material (*9) | N | None | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.), PFA lining only Size 2.5mm (0.1 in.) to 200 mm (8.0 in.), PFA lining only |
| | S | JIS SUS316 (AISI 316 SS/EN 1.4401 Equivalent) | |
| | L | JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) | |
| | P | Platinum-iridium | |
| | H | Hastelloy C276 Equivalent | |
| | T | Tantalum | |
| Process Connection (*4)(*12) | -BA1 | ANSI Class 150 Flange (Stainless Steel)(*1) | Size 2.5 mm (0.1 in.) to 400 mm (16 in.) Size 2.5 mm (0.1 in.) to 300 mm (12 in.) Size 200 mm (8.0 in.) to 400 mm (16 in.) Size 65 mm (2.5 in.) to 300 mm (12 in.) Size 2.5 mm (0.1 in.) to 50 mm (2.0 in.) Size 2.5 mm (0.1 in.) to 400 mm (16 in.) Size 2.5 mm (0.1 in.) to 300 mm (12 in.) Size 80 mm (3.0 in.) to 400 mm (16 in.) Size 50 mm (2 in.) to 400 mm (16 in.), Not available for TIIS flameproof type Size 50 mm (2 in.) to 300 mm (12 in.), Not available for TIIS flameproof type Size 200 mm (8.0 in.) to 400 mm (16 in.), Not available for TIIS flameproof type Size 65 mm (2.5 in.) to 300 mm (12 in.), Not available for TIIS flameproof type Size 50 mm (2.0 in.) only, Not available for TIIS flameproof type Size 50 mm (2.0 in.) to 400 mm (16 in.), Not available for TIIS flameproof type Size 50 mm (2.0 in.) to 300 mm (12 in.), Not available for TIIS flameproof type Size 80 mm (3.0 in.) to 400 mm (16 in.), Not available for TIIS flameproof type Size 2.5 mm (0.1 in.) to 10 mm (0.4 in.) Size 2.5 mm (0.1 in.) to 10 mm (0.4 in.) |
| | -BA2 | ANSI Class 300 Flange (Stainless Steel)(*1) | |
| | -BD1 | DIN PN 10 Flange (Stainless Steel)(*2) | |
| | -BD2 | DIN PN 16 Flange (Stainless Steel)(*2) | |
| | -BD4 | DIN PN 40 Flange (Stainless Steel)(*1)(*2) | |
| | -BJ1 | JIS 10K Flange (Stainless Steel)(*1) | |
| | -BJ2 | JIS 20K Flange (Stainless Steel)(*1) | |
| | -BG1 | JIS F12 (JIS75M) Flange (Stainless Steel) | |
| | -CA1 | ANSI Class 150 Flange (Carbon Steel) | |
| | -CA2 | ANSI Class 300 Flange (Carbon Steel) | |
| | -CD1 | DIN PN 10 Flange (Carbon Steel)(*2) | |
| | -CD2 | DIN PN 16 Flange (Carbon Steel)(*2) | |
| | -CD4 | DIN PN 40 Flange (Carbon Steel)(*2) | |
| | -CJ1 | JIS 10K Flange (Carbon Steel) | |
| | -CJ2 | JIS 20K Flange (Carbon Steel) | |
| | -CG1 | JIS F12 (JIS75M) Flange (Carbon Steel) | |
| | -DD4 | DIN PN 40 Flange (Stainless Steel), DN10(*2)(*3) | |
| | -DJ1 | JIS 10K Flange (Stainless Steel), 10 mm Diameter Nominal (*3) | |
| | -DJ2 | JIS 20K Flange (Stainless Steel), 10 mm Diameter Nominal (*3) | |
| Lay Length | 1 | Standard | |
| Electrical Connection (*7) | -0 | JIS G1/2 female | Not available for Submersible Type Not available for Submersible Type |
| | -2 | ANSI 1/2 NPT female | |
| | -4 | ISO M20×1.5 female | |
| Indicator (*5)(*8) | 1 | Integral Flowmeter with indicator (Horizontal) | |
| | 2 | Integral Flowmeter with indicator (Vertical) | |
| | N | Integral Flowmeter without indicator /Remote Flowtube | |
| Calibration | B | Standard | Size 25 mm (1.0 in.) to 200 mm (8.0 in.), PFA lining only |
| | C | High Grade (*13) | |
| | <input type="checkbox"/> | Optional code (See the Table of Optional Specifications) | |

T17.EPS

- *1: For a flange type of 2.5 to 10 mm (0.1 to 0.4 in.), prepare 15 mm (0.5 in.) diameter nominal flanges on the process pipe side.
(Process connection codes: BA1, BA2, BD4, BJ1, and BJ2)
- *2: Even when DIN PN10 or 16 is required for a model of size 2.5 to 50 mm (0.1 to 2.0 in.), select PN40 (Process connection codes: BD4, CD4 and DD4) because there is no difference in the dimensions of the mating faces.
Even when DIN PN10 is required for a model of size 65 to 150 mm (2.5 to 6.0 in.), select PN16 (Process connection codes: BD2, CD2) because there is no difference in the dimensions of the mating faces.
- *3: For a flange type of 2.5 to 10 mm (0.1 to 0.4 in.) (Process connection codes: DJ1, DJ2, and DD4), prepare 10 mm (0.4 in.) diameter nominal flanges on the process pipe side.
- *4: Mating dimensions are based on standards as follow:
ANSI: ASME B 16.5, DIN: DIN 2501, JIS: JIS B 2220 and JIS G 3443-2
- *5: N shall be always selected for remote flowtubes
In the case of an integral flowmeter, select from among the figures at the right:
- *6: For explosion proof types, specify types of explosion proof certification using the optional codes. In case of TIS flameproof type, the remote flowtube is available only for combined use with the AXFA14. For the TIS flameproof type with wiring using a flameproof packing adapter, select optional code G12 or G11. Available only for JIS G1/2 female electrical connections.
- *7: For explosion proof types, JIS G1/2 female electrical connection is available only for TIS flameproof type.
- *8: In case of integral flowmeters of the TIS flameproof type, select "with indicator" (code 1 or 2).
- *9: Δ Users must consider the characteristics of selected wetted parts material and influence of process fluids.
The use of inappropriate materials can result in the leakage of corrosive process fluids and cause injury to personnel and/or damage to plant facilities. It is also possible that the instrument itself can be damaged and that fragments from the instrument can contaminate the user's process fluids.
Be very careful with highly corrosive process fluids such as hydrochloric acid, sulfuric acid, hydrogen sulfide, sodium hypochlorite, and high-temperature steam (150°C [302°F] or above).
Contact Yokogawa for detailed information of the wetted parts material.
- *10: For FOUNDATION Fieldbus protocol, refer to IM 01E20F02-01E
- *11: For PROFIBUS PA protocol, refer to IM 01E20F12-01E.
- *12: Allowable fluid pressure should also be limited according to fluid temperature and pressure.
- *13: In the case of calibration code C in remote type, please order a combination of flowtube and converter.



AXF STANDARD (Flange Type) Size 500 mm (20 in.) to 2600 mm (104 in.)**General-purpose Use/Submersible Type, Polyurethane Rubber Lining**

| Model | Suffix Code | Description | Applicable Model |
|------------------------------|--|--|--|
| AXF500 | | Size 500 mm (20 in.) Remote Flowtube | |
| AXF600 | | Size 600 mm (24 in.) Remote Flowtube | |
| AXF700 | | Size 700 mm (28 in.) Remote Flowtube | |
| AXF800 | | Size 800 mm (32 in.) Remote Flowtube | |
| AXF900 | | Size 900 mm (36 in.) Remote Flowtube | |
| AXF10L | | Size 1000 mm (40 in.) Remote Flowtube | |
| AXF11L | | Size 1100 mm (44 in.) Remote Flowtube | |
| AXF12L | | Size 1200 mm (48 in.) Remote Flowtube | |
| AXF13L | | Size 1350 mm (54 in.) Remote Flowtube | |
| AXF15L | | Size 1500 mm (60 in.) Remote Flowtube | |
| AXF16L | | Size 1600 mm (64 in.) Remote Flowtube | |
| AXF18L | | Size 1800 mm (72 in.) Remote Flowtube | |
| AXF20L | | Size 2000 mm (80 in.) Remote Flowtube | |
| AXF22L | | Size 2200 mm (88 in.) Remote Flowtube | |
| AXF24L | | Size 2400 mm (96 in.) Remote Flowtube | |
| AXF26L | | Size 2600 mm (104 in.) Remote Flowtube | |
| Use | G | General-Purpose Use | |
| | W | Submersible Type | |
| Converter | -N | Remote Flowtube for Combined Use with AXFA11 | |
| Power Supply | N | Remote Flowtube | |
| Lining (*4) | U | Polyurethane Rubber | |
| Electrode Material (*4) | L | JIS SUS316L(AISI 316L SS/EN 1.4404 Equivalent) | |
| Electrode Structure | 1 | Non-replaceable | |
| Grounding Ring material (*4) | S | JIS SUS304 (AISI 304 SS/EN 1.4301 Equivalent) SS400 Carbon Steel lined with Stainless Steel SUS316 (AISI 316 SS/EN 1.4401 Equivalent) | Size 500 mm (20 in.) to 1000 mm (40 in.) Size 1100 mm (44 in.) to 2600 mm (104 in.) |
| Process Connection (*1)(*5) | -CA1 -CD1 -CJ1 -CG1 | ANSI Class 150 Flange (Carbon Steel) (*2) DIN PN10 Flange (Carbon Steel) (*2) JIS 10K Flange (Carbon Steel) (*2) JIS F12 (JIS 75M) Flange (Carbon Steel) (*2)(*3) | Size 500 mm (20 in.), 600 mm (24 in.) Size 500 mm (20 in.) to 1000 mm (40 in.) Size 500 mm (20 in.) to 1000 mm (40 in.) Size 500 mm (20 in.) to 2600 mm (104 in.) |
| Lay Length | 1 | AXF Standard | |
| Electrical Connection | -0 -2 -4 | JIS G1/2 female ANSI 1/2 NPT female ISO M20×1.5 female | Size 500 mm (20 in.) to 1000 mm (40 in.), Not available for Submersible Type Size 500 mm (20 in.) to 1000 mm (40 in.), Not available for Submersible Type |
| Indicator | N ... | None | |
| Calibration | B ... | Standard | |
| Options | /□ | Optional code (See the Table of Optional Specifications) | |

*1: Mating dimensions are based on standards as follows:

ANSI:ASME B 16.5, DIN: DIN 2501, JIS:JIS B 2220 and JIS G 3443-2

*2: Carbon steel Flange Material: JIS SS400(EN S275 Equivalent) or SFVC 2A

*3: There are no differences in dimensions of mating faces between JIS F12(JIS 75M) and JIS 7.5K.

*4: △Users must consider the characteristics of selected wetted parts material and influence of process fluids.

The use of inappropriate materials can result in the leakage of corrosive process fluids and cause injury to personnel and/or damage to plant facilities. It is also possible that the instrument itself can be damaged and that fragments from the instrument can contaminate the user's process fluids.

Be very careful with highly corrosive process fluids such as hydrochloric acid, sulfuric acid, hydrogen sulfide, sodium hypochlorite, and high-temperature steam (150°C [302°F] or above). Contact Yokogawa for detailed information of the wetted parts material.

*5: Allowable fluid pressure should also be limited according to fluid temperature and pressure.

T18-1.EPS

AXF STANDARD (Clamp/Union/Butt Weld Connection)**Sanitary Type , PFA Lining**

| Model | Suffix Code | Description | Applicable Model |
|--|-------------|--|---|
| AXF015 | | Size 15 mm (0.5 in.), Integral Flowmeter/Remote Flowtube | |
| AXF025 | | Size 25 mm (1.0 in.), Integral Flowmeter/Remote Flowtube | |
| AXF032 | | Size 32 mm (1.25 in.), Integral Flowmeter/Remote Flowtube | |
| AXF040 | | Size 40 mm (1.5 in.), Integral Flowmeter/Remote Flowtube | |
| AXF050 | | Size 50 mm (2.0 in.), Integral Flowmeter/Remote Flowtube | |
| AXF065 | | Size 65 mm (2.5 in.), Integral Flowmeter/Remote Flowtube | |
| AXF080 | | Size 80 mm (3.0 in.), Integral Flowmeter/Remote Flowtube | |
| AXF100 | | Size 100 mm (4.0 in.), Integral Flowmeter/Remote Flowtube | |
| AXF125 | | Size 125 mm (5.0 in.), Integral Flowmeter/Remote Flowtube | |
| Use | H | Sanitary Type | |
| Converter Output Signal and Communication | -D | Integral Flowmeter with 4 to 20 mA DC Output and BRAIN Communication | |
| | -E | Integral Flowmeter with 4 to 20 mA DC Output and HART Communication | |
| | -F | Integral Flowmeter with Digital communication (FOUNDATION Fieldbus protocol) (*5) | |
| | -G | Integral Flowmeter with Digital communication (PROFIBUS PA protocol) (*6) | |
| | -N | Remote Flowtube for Combined use with AXFA11 | |
| | -P | Remote Flowtube for Combined use with AXFA14 | |
| Power Supply | 1 | Integral Flowmeter, 100 V to 240 V AC or 100 to 120 V DC | |
| | 2 | Integral Flowmeter, 24 V AC/DC | |
| | N | Remote Flowtube | |
| Lining (*4) | A | Fluorocarbon PFA | |
| Electrode Material (*4) | L | JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) | |
| Electrode Structure | 1 | Non-replaceable | |
| Grounding Ring | N | None | |
| Process Connection (*2) (*4) (*7) | -HAB | Tri-Clamp (3A), JIS SUS316L or SUSF316L (AISI 316L SS/EN1.4404 Equivalent or ANSI F316L SS/EN1.4435 Equivalent)(*1) | Size 15 mm (0.5 in.) to 100 mm (4.0 in.), except 32 mm (1.25 in.) |
| | -HDB | DIN32676 Clamp, JIS SUS316L or SUSF316L (AISI 316L SS/EN1.4404 Equivalent or ANSI F316L SS/EN1.4435 Equivalent) | Size 15 mm (0.5 in.) to 125 mm (5.0 in.) |
| | -HKB | ISO2852/SMS3016 Clamp, JIS SUS316L or SUSF316L (AISI 316L SS/EN1.4404 Equivalent or ANSI F316L SS/EN1.4435 Equivalent) | Size 15 mm (0.5 in.) to 125 mm (5.0 in.) |
| | -JDB | DIN11851 Union, SUS316L or SUSF316L (AISI 316L SS/EN1.4404 Equivalent or ANSI F316L SS/EN1.4435 Equivalent) | Size 15 mm (0.5 in.) to 125 mm (5.0 in.) |
| | -JKB | ISO2853 Union, SUS316L or SUSF316L (AISI 316L SS/EN1.4404 Equivalent or ANSI F316L SS/EN1.4435 Equivalent) | Size 15 mm (0.5 in.) to 100 mm (4.0 in.) |
| | -JSB | SMS1145 Union, SUS316L or SUSF316L (AISI 316L SS/EN1.4404 Equivalent or ANSI F316L SS/EN1.4435 Equivalent) | Size 25 mm (1.0 in.) to 100 mm (4.0 in.) |
| | -KDB | Butt Weld for DIN 11850 Pipe Connection (SUS316L or SUSF316L [AISI 316L SS/EN1.4404 Equivalent or ANSI F316L SS/EN1.4435 Equivalent]) | Size 15 mm (0.5 in.) to 125 mm (5.0 in.) |
| | -KKB | Butt Weld for ISO 2037 Pipe Connection (SUS316L or SUSF316L [AISI 316L SS/EN1.4404 Equivalent or ANSI F316L SS/EN1.4435 Equivalent]) | Size 15 mm (0.5 in.) to 125 mm (5.0 in.) |
| | | | |
| Lay Length | 1 | Standard | |
| Electrical Connection | -0 | JIS G1/2 female | |
| | -2 | ANSI 1/2 NPT female | |
| | -4 | ISO M20×1.5 female | |
| Indicator (*3) | 1 ... | Integral Flowmeter with indicator (Horizontal) | |
| | 2 ... | Integral Flowmeter with indicator (Vertical) | |
| | N ... | Integral Flowmeter without indicator /Remote Flowtube | |
| Calibration | B ... | Standard | |
| | C ... | High Grade (*8) | Size 25 mm (1.0 in.) to 125 mm (5.0 in.) |
| | /□ | Optional code (See the Table of Optional Specifications) | |


*1: For a tri-clamp type of size 15 mm (0.5 in.) (Process connection code: HAB), prepare a 3/4 in. tri-clamp on the process pipe side.

T18.EPS

*2: The detail dimensions of process connections (clamp/union/butt weld) are shown in the 'EXTERNAL DIMENSIONS' section of the sanitary type.
In case of Butt Weld type, ferrules, sleeves, or alternative must be provided by the user. User need to weld these parts to the butt weld adapter.

*3: N shall be always selected for remote flowtubes.

In the case of an integral flowmeter, select from among the following figures.



*4: Users must consider the characteristics of selected wetted parts material and influence of process fluids.

⚠ The use of inappropriate materials can result in the leakage of corrosive process fluids and cause injury to personnel and/or damage to plant facilities. It is also possible that the instrument itself can be damaged and that fragments from the instrument can contaminate the user's process fluids.

Be very careful with highly corrosive process fluids such as hydrochloric acid, sulfuric acid, hydrogen sulfide, sodium hypochlorite, and high-temperature steam (150°C [302°F] or above). Contact Yokogawa for detailed information of the wetted parts material.

*5: For FOUNDATION Fieldbus protocol, refer to IM 01E20F02-01E

*6: For PROFIBUS PA protocol, refer to IM 01E20F12-01E.

*7: Allowable fluid pressure should also be limited according to fluid temperature and pressure.


*8: In the case of calibration code C in remote type, please order a combination of flowtube and converter.

REPLACEMENT MODEL FOR EARLIER ADMAG OR ADMAG AE (Wafer Type)**General-purpose Use/Submersible Type/Explosion proof Type, PFA/Polyurethane Rubber Lining**For the Wafer Types of size 250 mm (10 in.), 300 mm (12 in.), **AXF Standard** shall be selected.

| Model | Suffix Code | Description | Applicable Model |
|--|--------------------------|---|--|
| AXF002 | | Size 2.5 mm (0.1 in.) Integral Flowmeter/Remote Flowtube (*8) | |
| AXF005 | | Size 5 mm (0.2 in.) Integral Flowmeter/Remote Flowtube (*8) | |
| AXF010 | | Size 10 mm (0.4 in.) Integral Flowmeter/Remote Flowtube (*8) | |
| AXF015 | | Size 15 mm (0.5 in.) Integral Flowmeter/Remote Flowtube (*8) | |
| AXF025 | | Size 25 mm (1.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF040 | | Size 40 mm (1.5 in.) Integral Flowmeter/Remote Flowtube | |
| AXF050 | | Size 50 mm (2.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF080 | | Size 80 mm (3.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF100 | | Size 100 mm (4.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF150 | | Size 150 mm (6.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF200 | | Size 200 mm (8.0 in.) Integral Flowmeter/Remote Flowtube | |
| Use | G | General-Purpose Use | Size 15 mm (0.5 in.) to 200 mm (8.0 in.), Remote Flowtube only PFA lining only |
| | W | Submersible Type | |
| | C | Explosion proof Type (*5) | |
| Converter Output Signal and Communication | -D | Integral Flowmeter with 4 to 20 mA DC Output and BRAIN Communication | |
| | -E | Integral Flowmeter with 4 to 20 mA DC Output and HART Communication | |
| | -F | Integral Flowmeter with Digital communication (FOUNDATION Fieldbus protocol) (*10) | |
| | -G | Integral Flowmeter with Digital communication (PROFIBUS PA protocol) (*11) | |
| | -N | Remote Flowtube for Combined Use with AXFA11 | |
| | -P | Remote Flowtube for Combined Use with AXFA14 | |
| Power Supply | 1 | Integral Flowmeter, 100 V to 240 V AC or 100 to 120 V DC | |
| | 2 | Integral Flowmeter, 24 V AC/DC | |
| | N | Remote Flowtube | |
| Lining (*9) | A | Fluorocarbon PFA | Size 25 mm (1.0 in.) to 200 mm (8.0 in.) |
| | U | Polyurethane Rubber | |
| Electrode Material (*9) | L | JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) | PFA lining only |
| | P | Platinum-iridium | |
| | H | Hastelloy C276 Equivalent | PFA lining only |
| | T | Tantalum | |
| | V | Titanium | Size 15 mm (0.5 in.) to 200 mm (8.0 in.) |
| | W | Tungsten Carbide | |
| Electrode Structure | 1 | Non-replaceable | |
| Grounding Ring and Grounding Electrode Material (*9) | N | None | Size 25 mm (1.0 in.) to 200 mm (8.0 in.)(*5) |
| | S | JIS SUS316 (AISI 316 SS/EN 1.4401 Equivalent) | |
| | L | JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) | PFA lining only |
| | P | Platinum-iridium (*8) | |
| | H | Hastelloy C276 Equivalent | PFA lining only |
| | T | Tantalum (*8) | |
| | V | Titanium | |
| Process Connection (*3)(*12) | -AA1 | ANSI Class 150 Wafer(*1) | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.) |
| | -AA2 | ANSI Class 300 Wafer(*1) | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.) |
| | -AD1 | DIN PN 10 Wafer(*2) | Size 200 mm(8.0 in.) only |
| | -AD2 | DIN PN 16 Wafer(*2) | Size 80 mm (3.0 in.) to 200 mm (8.0 in.) |
| | -AD4 | DIN PN 40 Wafer(*1)(*2) | Size 2.5 mm (0.1 in.) to 50 mm (2.0 in.) |
| | -AJ1 | JIS 10K Wafer(*1) | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.) |
| | -AJ2 | JIS 20K Wafer(*1) | Size 2.5 mm (0.1 in.) to 200 mm (8.0 in.) |
| | -AG1 | JIS F12 (JIS75M) Wafer | Size 80 mm (3.0 in.) to 200 mm (8.0 in.) |
| Lay Length | 2 | Matches an Earlier ADMAG Flowmeter (ADMAG or ADMAG AE) for Replacement | |
| Electrical Connection (*6) | -0 | JIS G1/2 female | Not available for Submersible Type Not available for Submersible Type |
| | -2 | ANSI 1/2 NPT female | |
| | -4 | ISO M20×1.5 female | |
| Indicator (*4)(*7) | 1 | Integral Flowmeter with indicator(Horizontal) | |
| | 2 | Integral Flowmeter with indicator(Vertical) | |
| | N | Integral Flowmeter without indicator /Remote Flowtube | |
| Calibration | B | Standard | |
| | <input type="checkbox"/> | Optional code (See the Table of Optional Specifications) | |

T19.EPS

- *1: For a wafer type of 2.5 to 10 mm (0.1 to 0.4 in.), prepare 15 mm (0.5 in.) diameter nominal flanges on the process pipe side.
(Process connection codes: AA1, AA2, AD4, AJ1, and AJ2)
- *2: Even when DIN PN10 or 16 is required for a model of size 2.5 to 50 mm (0.1 to 2.0 in.), select PN40 (Process connection code: AD4) because there is no difference in the dimensions of the mating faces.
Even when DIN PN10 is required for a model of size 65 to 150 mm (2.5 to 6.0 in.), select PN16 (Process connection code: AD2) because there is no difference in the dimensions of the mating faces.
- *3: Mating dimensions are based on standards as follow:
ANSI: ASME B 16.5, DIN: DIN 2501, JIS: JIS B 2220 and JIS G 3443-2
- *4: N shall be always selected for remote flowtubes
In the case of an integral flowmeter, select from among the figures at the right:
- *5: For explosion proof types, specify types of explosion proof certification using the optional codes. In case of TIIS flameproof type, the remote flowtube is available only for combined use with the AXFA14. For the TIIS flameproof type with wiring using a flameproof packing adapter, select optional code G12 or G11. Available only for JIS G1/2 female electrical connections.
- *6: For explosion proof types, JIS G1/2 female electrical connection is available only for TIIS flameproof type.
- *7: In case of integral flowmeters of the TIIS flameproof type, select "with indicator" (code 1 or 2).
- *8: In case of platinum-iridium (grounding ring code P) or tantalum (grounding ring code T) or None (grounding ring code N) in wafer type of 2.5 mm (0.1 in.) to 15 mm (0.5 in.), the lay lengths of Replacement model are the same as those for AXF Standard.
In this case, AXF Standard shall be selected.
- *9: ΔUsers must consider the characteristics of selected wetted parts material and influence of process fluids.
The use of inappropriate materials can result in the leakage of corrosive process fluids and cause injury to personnel and/or damage to plant facilities. It is also possible that the instrument itself can be damaged and that fragments from the instrument can contaminate the user's process fluids.
Be very careful with highly corrosive process fluids such as hydrochloric acid, sulfuric acid, hydrogen sulfide, sodium hypochlorite, and high-temperature steam (150°C [302°F] or above). Contact Yokogawa for detailed information of the wetted parts material.
- *10: For FOUNDATION Fieldbus protocol, refer to GS 01E20F02-01E
- *11: For PROFIBUS PA protocol, refer to GS 01E20F12-01E.
- *12: Allowable fluid pressure should also be limited according to fluid temperature and pressure.




REPLACEMENT MODEL FOR EARLIER ADMAG OR ADMAG AE (Flange Type)**General-purpose Use/Submersible Type/Explosion proof Type, PFA/Polyurethane Rubber Lining**

For Flange Types of size 15 mm (0.5 in.) to 100 mm (4.0 in.), 300 mm (12 in.) to 2600 mm (104 in.), **AXF Standard** shall be selected.

| Model | Suffix Code | Description | Applicable Model |
|--|--|---|---|
| AXF150 | | Size 150 mm (6.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF200 | | Size 200 mm (8.0 in.) Integral Flowmeter/Remote Flowtube | |
| AXF250 | | Size 250 mm (10 in.) Integral Flowmeter/Remote Flowtube | |
| Use | G W C | General-Purpose Use Submersible Type Explosion proof Type (*4) | Remote Flowtube only PFA lining only |
| Converter Output Signal and Communication | -D -E -F -G -N -P | Integral Flowmeter with 4 to 20 mA DC Output and BRAIN Communication Integral Flowmeter with 4 to 20 mA DC Output and HART Communication Integral Flowmeter with Digital communication (FOUNDATION Fieldbus protocol) (*8) Integral Flowmeter with Digital communication (PROFIBUS PA protocol) (*9) Remote Flowtube for Combined Use with AXFA11 Remote Flowtube for Combined Use with AXFA14 | |
| Power Supply | 1 2 N | Integral Flowmeter, 100 V to 240 V AC or 100 to 120 V DC Integral Flowmeter, 24 V AC/DC Remote Flowtube | |
| Lining (*7) | A U | Fluorocarbon PFA Polyurethane Rubber | |
| Electrode Material (*7) | L P H T V W | JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) Platinum-iridium Hastelloy C276 Equivalent Tantalum Titanium Tungsten Carbide | PFA lining only PFA lining only |
| Electrode Structure | 1 2 | Non-replaceable Replaceable | General-Purpose use, Electrode Material : JIS SUS316L only |
| Grounding Ring and Grounding Electrode Material (*7) | N S L P H T V | None JIS SUS316 (AISI 316 SS/EN 1.4401 Equivalent) JIS SUS316L (AISI 316L SS/EN 1.4404 Equivalent) Platinum-iridium Hastelloy C276 Equivalent Tantalum Titanium | Size 150 mm (6.0 in.), 200 mm (8.0 in.), PFA lining only Size 150 mm (6.0 in.), 200 mm (8.0 in.), PFA lining only |
| Process Connection (*2)(*10) | -CA1 -CA2 -CD1 -CD2 -CJ1 -CJ2 -CG1 | ANSI Class 150 Flange (Carbon Steel) ANSI Class 300 Flange (Carbon Steel) DIN PN 10 Flange (Carbon Steel)(*1) DIN PN 16 Flange (Carbon Steel)(*1) JIS 10K Flange (Carbon Steel) JIS 20K Flange (Carbon Steel) JIS F12 (JIS75M) Flange (Carbon Steel) | Size 150 mm (6.0 in.) to 250 mm (10 in.), Not available for TIIS flameproof type Size 150 mm (6.0 in.) to 250 mm (10 in.), Not available for TIIS flameproof type Size 200 mm (8.0 in.) to 250 mm (10 in.), Not available for TIIS flameproof type Size 150 mm (6.0 in.) to 250 mm (10 in.), Not available for TIIS flameproof type Size 150 mm (6.0 in.) to 250 mm (10 in.), Not available for TIIS flameproof type Size 150 mm (6.0 in.) to 250 mm (10 in.), Not available for TIIS flameproof type Size 150 mm (6.0 in.) to 250 mm (10 in.), Not available for TIIS flameproof type |
| Lay Length | 2 | Matches an Earlier ADMAG Flowmeter (ADMAG or ADMAG AE) for Replacement | |
| Electrical Connection (*5) | -0 -2 -4 | JIS G1/2 female ANSI 1/2 NPT female ISO M20×1.5 female | Not available for Submersible Type Not available for Submersible Type |
| Indicator (*3)(*6) | 1 2 N | Integral Flowmeter with indicator (Horizontal) Integral Flowmeter with indicator (Vertical) Integral Flowmeter without indicator /Remote Flowtube | |
| Calibration | B | Standard | |
| | | <input type="checkbox"/> Optional code (See the Table of Optional Specifications) | |

T20.EPS

- *1: Even when DIN PN10 is required for a 150 (6.0 in.)-mm model, select PN16 (Process connection code: CD2) because there is no difference in the dimensions of the mating faces.
- *2: Mating dimensions are based on standards as follow:
ANSI: ASME B 16.5, DIN: DIN 2501, JIS: JIS B 2220 and JIS G 3443-2
- *3: N shall be always selected for remote flowtubes.
In the case of an integral, select from among the following figures:



- *4: For explosion proof types, specify types of explosion proof certification using the optional codes. In case of TIIS flameproof type, the remote flowtube is available only for combined use with the AXFA14. For the TIIS flameproof type with wiring using a flameproof packing adapter, select optional code G12 or G11. Available only for JIS G1/2 female electrical connections.
- *5: For explosion proof types, JIS G1/2 female electrical connection is available only for TIIS flameproof type.
- *6: In case of integral flowmeters of the TIIS flameproof type, select "with indicator" (code 1 or 2).
- *7: ⚠ Users must consider the characteristics of selected wetted parts material and influence of process fluids.
The use of inappropriate materials can result in the leakage of corrosive process fluids and cause injury to personnel and/or damage to plant facilities. It is also possible that the instrument itself can be damaged and that fragments from the instrument can contaminate the user's process fluids.
Be very careful with highly corrosive process fluids such as hydrochloric acid, sulfuric acid, hydrogen sulfide, sodium hypochlorite, and high-temperature steam (150°C [302°F] or above). Contact Yokogawa for detailed information of the wetted parts material.
- *8: For FOUNDATION Fieldbus protocol, refer to IM 01E20F02-01E
- *9: For PROFIBUS PA protocol, refer to IM 01E20F12-01E.
- *10: Allowable fluid pressure should also be limited according to fluid temperature and pressure.

OPTIONAL SPECIFICATIONS FOR FLOWTUBES

Table of Optional Specifications (Size 2.5 mm (0.1 in.) to 400 mm (16 in.)) “◇”

○: Available -: Not available

| Item | Specifications | | Applicable Model | | | | | | | Code |
|--|--|--|--------------------|-----------------|--------------------|-----------------|-----------------|--------------------|-----------------|------|
| | | | General | | Explosion proof | | Submersible | Sanitary | | |
| | | | Integral Flowmeter | Remote Flowtube | Integral Flowmeter | Remote Flowtube | Remote Flowtube | Integral Flowmeter | Remote Flowtube | |
| | | | □WL-G | Z-P | □WL-G | Z-P | Z-P | □WL-G | Z-P | |
| | | AXF***G | AXF***G | AXF***C | AXF***C | AXF***W | AXF***H | AXF***H | | |
| For District Heating and Cooling or Condensation-proof | Urethane resin potting is applied in the terminal box of a remote flowtube. Select JIS G1/2 for the electrical connections. 30-meter signal and excitation cables are pre-wired and waterproof grounds with union joints are attached at factory. | | - | ○ | - | - | - | - | ○ | DHC |
| User-specified Signal and Excitation Cable Length | Available for the submersible type and a model with optional code DHC. The cable length is limited up to 200 meters when combined with an AXFA11 converter, or 100 meters when combined with an AXFA14 converter. Following "L," specify the cable length in three digits as a multiple of 1 meter (e.g., 001, 002, or 005) for a length up to 5 meters or as a multiple of 5 meters (i.e., 005, 010, 015, or the like) for a length of 5 meters or more. If this optional code is not selected, a 30-meter length cable is attached. | | - | ○ | - | - | ○ | - | ○ | L*** |
| Lightning Protector | A lightning protector is built into the power terminals. | | ○ | - | ○ | - | - | ○ | - | A |
| DC Noise Cut Circuit | The DC Noise Cut Circuit is built in. Available for 15 mm (0.5 in.) and larger sizes, and for fluids with the conductivity of 50 μS/cm or higher. Nullifies the empty check and electrode adhesion diagnostic function. | | ○ | - | ○ | - | - | ○ | - | ELC |
| Burn Out Down | The output level is set to 0 mA during a CPU failure and is set 2.4 mA (-10 %) or less during an alarm. Standard products are delivered with a setting 25 mA during a CPU failure and 21.6 mA (110%) or more during an alarm. | | ○ (*10) | - | ○ (*10) | - | - | ○ (*10) | - | C1 |
| NAMUR NE43 Compliance | Output signal limits: 3.8 to 20.5 mA | Failure alarm down-scale: The output level is set to 0 mA during a CPU failure and is set 2.4 mA (-10%) or less during an alarm. | ○ (*10) | - | ○ (*10) | - | - | ○ (*10) | - | C2 |
| | | Failure alarm up-scale: The output level is set to 25 mA during a CPU failure and is set 21.6 mA (110%) or more during an alarm. | ○ (*10) | - | ○ (*10) | - | - | ○ (*10) | - | C3 |
| Active Pulse Output | Active pulses are output in order to drive an external electromagnetic or electronic counter directly using the converter's internal power supply. (Nullifies the standard transistor contact pulse output.) Output voltage: 24 V DC ±20% Pulse specifications: • The drive current of 150 mA or less • Pulse rate: 0.0001 to 2 pps (pulse/second); Pulse width: 20, 33, 50, or 100 ms | | ○ (*10) | - | ○ (*10) | - | - | ○ (*10) | - | EM |
| Mass Unit Setting | The flow rate span, transmission pulse weight, and totalizer display pulse weight can be set in terms of mass unit. Specify the density of the process fluid when ordering in addition to the mass flow rate span, transmission pulse weight (for mass unit), and totalizer display pulse weight (for mass unit). When ordering a remote flowtube, parameters for 'Mass Unit Setting' will be set in the corresponding converter before shipment. 1. Density a. Available density Numerics: Specify the numeric within the value of 500 to 2000 kg/m³, 4.2 to 16.7 lb/gal, or 31.2 to 124.8 lb/cf. And it can be up to five digits, to a maximum of 32000 ignoring the decimal point. A fraction is limited to the fourth decimal place. b. Available density units: kg/m³, lb/gal, lb/cf Example: A water density is about 1000kg/m³. In this case specify "1000kg/m³". However a density is changed by temperature. Specify the actual density. (The 1000kg/m³ is equivalent to 8.345lb/gal and 62.43lb/cf.) 2. The mass flow rate span, transmission pulse weight, and totalizer display pulse weight a. Available density Numerics: Specify the numeric within the value of 0.0001 to 32000. And it can be up to five digits, to a maximum of 32000 ignoring the decimal point. A fraction is limited to the fourth decimal place. b. Mass Units Available mass units: t, kg, g, klb, lb Available time units: /d, /h, /min, /s Note1: In case of specifying the mass flow span, calculate the volumetric flow span by the setting density, and specify the available value in the mass flow span. Note2: In case of transmission pulse weight and totalizer display pulse weight, specify the mass unit which was specified as the flow unit. | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | MU |

T26-1.EPS

● Table of Optional Specifications (Size 2.5 mm (0.1 in.) to 400 mm (16 in.)) (continued)

○: Available -: Not available

| Item | Specifications | | Applicable Model | | | | | | | Code |
|--|--|---|--------------------|-----------------|--------------------|-----------------|-----------------|--------------------|-----------------|------|
| | | | General | | Explosion proof | | Submersible | Sanitary | | |
| | | | Integral Flowmeter | Remote Flowtube | Integral Flowmeter | Remote Flowtube | Remote Flowtube | Integral Flowmeter | Remote Flowtube | |
| | | | ΔWL-G | ZΔ | ΔWL-G | ZΔ | ZΔ | ΔWL-G | ZΔ | |
| | | AXF**G | AXF**G-Z | AXF**C | AXF**C-Z | AXF**W-Z | AXF**H | AXF**H-Z | | |
| G3/4 Female Waterproof Glands | Waterproof glands for G3/4 conduits or flexible tubes are attached to the electrical connections. Available only for JIS G1/2 female electric connections. | | - | ○ | - | - | - | - | ○ | EW |
| Waterproof Glands | Waterproof glands are attached to the electrical connections. Available only for JIS G1/2 female electric connections. | | ○ | ○ | - | - | - | ○ | ○ | EG |
| Waterproof Glands with Union Joints | Waterproof glands with union joints are attached to the electrical connections. Available only for JIS G1/2 female electric connections. | | ○ | ○ | - | - | - | ○ | ○ | EU |
| Plastic Glands | Plastic glands are attached to the electrical connections. Available only for JIS G1/2 female electric connections. | | ○ | ○ | - | - | - | ○ | ○ | EP |
| Mirror Finished PFA Lining | Mirror finishing on the PFA lining inside of the tube to the smoothness lining. Available for 15 mm (0.5 in.) and larger sizes. The Ra is average of measured values on several point. Size 15 to 200 mm (0.5 to 8.0 in.) : Ra 0.05 to 0.15 μm Size 250 to 400 mm (10 to 16 in.) : Ra 0.05 to 0.25 μm | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | PM |
| Mirror Finished Ceramics | Mirror finishing on the inside of the ceramics tube to Ra ≦ 0.1 μm. Available for 5 mm (0.2 in.) and larger sizes. The Ra is average of measured values on several point. | | ○ | ○ | ○ | ○ | - | - | - | CM |
| Stainless Steel Tag Plate | A pendant tag plate of JIS SUS304 (AISI 304 SS/EN 1.4301 equivalent) is provided. Choose this option when a pendant tag plate is required in addition to the standard nameplate with the tag number inscribed on it. Dimension (Height × Width): Appr. 12.5 (4.92) × 40 (15.7) mm (inch) | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | SCT |
| Direction change of the electrical connection (*1) | +90 degrees rotated converter (or terminal box) to change the direction of the electrical connection. | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | RA |
| | +180 degrees rotated converter (or terminal box) to change the direction of the electrical connection. | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | RB |
| | -90 degrees rotated converter (or terminal box) to change the direction of the electrical connection. | | ○ | ○ | ○ | ○ | ○ | ○ | ○ | RC |
| Bolts, Nuts, and Gaskets (*2) | Bolts, nuts, and gaskets are provided for wafer connections. Available only for ANSI 150, JIS10K, or, JIS20K wafer connections. | Bolts and nuts: Carbon steel; Gaskets: Chloroprene rubber (*3) | ○ | ○ | ○ | ○ | ○ | - | - | BCC |
| | | Bolts and nuts: Carbon steel; Gaskets: PTFE-sheathed non-asbestos (*4) | ○ | ○ | ○ | ○ | ○ | - | - | BCF |
| | | Bolts: JIS SUS304 (AISI 304 SS stainless steel equivalent); Nuts: JIS SUS403 (AISI 403SS stainless steel equivalent) ; Gaskets: Chloroprene rubber (*3) | ○ | ○ | ○ | ○ | ○ | - | - | BSC |
| | | Bolts: JIS SUS304 (AISI 304 SS stainless steel equivalent); Nuts: JIS SUS403 (AISI 403SS stainless steel equivalent) ; Gaskets: PTFE-sheathed non-asbestos (*4) | ○ | ○ | ○ | ○ | ○ | - | - | BSF |
| | | | | | | | | | | |
| Special Gaskets (*5) | Viton® gaskets for use with a PFA or ceramics lining with PVC piping. Allowable temperature and pressure are equivalent to Valqua #4010, special fluororubber not mixed. Available for 2.5 mm (0.1 in.) to 200 mm (8.0 in.) of PFA lining or 15 to 200 mm (0.5 to 8 in.) sizes of ceramics lining. | | ○ | ○ | ○ | ○ | ○ | - | - | GA |
| | Acid-resistant Viton® gaskets for use with a PFA or ceramics lining with PVC piping. Allowable temperature and pressure are equivalent to Valqua #4010, special fluororubber mixed (mixing #D2470). Available for 2.5 mm (0.1 in.) to 200 mm (8.0 in.) of PFA lining or 15 to 200 mm (0.5 to 8 in.) sizes of ceramics lining. | | ○ | ○ | ○ | ○ | ○ | - | - | GC |
| | Alkali-resistant Viton® gaskets for use with a PFA or ceramics lining with PVC piping. Allowable temperature and pressure are equivalent to Valqua #4010, special fluororubber mixed (mixing #RCD970). Available for 2.5 mm (0.1 in.) to 200 mm (8.0 in.) of PFA lining or 15 to 200 mm (0.5 to 8 in.) sizes of ceramics lining. | | ○ | ○ | ○ | ○ | ○ | - | - | GD |
| | Alkali-resistant carbonized fluororesin gaskets for use with a ceramics lining with metal piping. Allowable temperature and pressure are equivalent to Valqua #7026. | | ○ | ○ | ○ | ○ | - | - | - | GF |
| | Silicon rubber gaskets for Sanitary Type, provided between the lining and the adapter. For the condition of fluid temp. 120 to 160°C (248 to 320°F). | | - | - | - | - | - | ○ | ○ | GH |
| Oil-prohibited Use | Electrodes, linings, and grounding rings are assembled and packed with polyethylene after being cleaned with water and acetone and dried with air. The label 'OIL FREE' is affixed. | | ○ | ○ | ○ | ○ | - | - | - | K1 |

T26-2.EPS

● Table of Optional Specifications (Size 2.5 mm (0.1 in.) to 400 mm (16 in.)) (continued)

○: Available -: Not available

| Item | Specifications | Applicable Model | | | | | | | Code |
|---|---|--------------------|-----------------|--------------------|-----------------|-----------------|--------------------|-----------------|------|
| | | General | | Explosion proof | | Submersible | Sanitary | | |
| | | Integral Flowmeter | Remote Flowtube | Integral Flowmeter | Remote Flowtube | Remote Flowtube | Integral Flowmeter | Remote Flowtube | |
| | | □WL□ AXF***G- | Z□ AXF***G- | □WL□ AXF***C- | Z□ AXF***C- | Z□ AXF***W- | □WL□ AXF***H- | Z□ AXF***H- | |
| Oil-prohibited Use with Dehydrating Treatment | Electrodes, linings, and grounding rings are assembled and packed with polyethylene including desiccants after being cleaned with water and acetone and dried with air. The label 'OIL & WATER FREE' is affixed. | ○ | ○ | ○ | ○ | - | - | - | K5 |
| Painting Color Change | Coated in black (Munsell N1.5 or its equivalent.) | ○ | ○ | ○ | ○ | - | ○ | ○ | P1 |
| | Coated in jade green (Munsell 7.5 BG 4/1.5 or its equivalent.) | ○ | ○ | ○ | ○ | - | ○ | ○ | P2 |
| | Coated in metallic silver. | ○ | ○ | ○ | ○ | - | ○ | ○ | P7 |
| Epoxy Resin Coating | Epoxy resin coating which has alkali-resistance instead of standard polyurethane resin coating. The color is same as standard type. | ○ | ○ | ○ | ○ | - | - | - | X1 |
| High Anti-corrosion Coating | Three-layer coating (polyurethane coating on two-layer epoxy resin coating) in the same range as that for the standard coating. The color is same as standard type. Salt/alkali/acid/weather-resistance. | ○ | ○ | ○ | ○ | - | - | - | X2 |
| Material Certificate | Reproduced material certificates for : PFA/polyurethane: Pipe, electrodes, grounding rings/grounding electrodes, flanges or mini flanges, adapters (for sanitary type) Ceramics: only grounding rings or grounding electrodes or union joint | ○ | ○ | ○ | ○ | ○ | ○ | ○ | M01 |
| Hydrostatic Test | The test verifies the absence of leaks by applying the following water pressures (which are determined under process connection conditions) to linings for ten minutes. Test results are described in the Note column of a test certificate (QIC). Process Connection: ANSI Class 150, DIN PN10, JIS 10K ANSI Class 300, DIN PN16, JIS 20K DIN PN40, Union joint (Ceramics lining) JIS F12 Water Pressure: 1.5 MPa 3.0 MPa 6.0 MPa 1.25 MPa | ○ | ○ | ○ | ○ | ○ | - | - | T01 |
| Calibration Certificate | Level 2: The Declaration and the Calibration Equipment List are issued. | ○ | ○ | ○ | ○ | ○ | ○ | ○ | L2 |
| | Level 3: The Declaration and the Primary Standard List are issued. | ○ | ○ | ○ | ○ | ○ | ○ | ○ | L3 |
| | Level 4: The Declaration and the Yokogawa Measuring Instruments Control System are issued. | ○ | ○ | ○ | ○ | ○ | ○ | ○ | L4 |
| Vent Hole | With a vent hole provided for permeable fluids (such as nitric acid, hydrofluoric acid, or sodium hydroxide at high temperature). Available only for a PFA lining flange type tube. | ○ | ○ | ○ | ○ | - | - | - | H |
| Enhanced Dual Frequency Excitation (*6) | Available for 25 to 200 mm (1.0 to 8.0 in.) sizes. Products are delivered with the Standard dual frequency excitation mode and the Enhanced dual frequency excitation mode enabled. Although the meter factors for the Standard dual frequency excitation mode and the Enhanced dual frequency excitation mode are inscribed on the nameplate, the flow calibration of optional code HF1 is not performed in Enhanced dual frequency excitation.Excitation mode select optional code HF2 when an accurate flow measurement is required. | ○ | ○ | ○ | ○ | ○ | ○ | ○ | HF1 |
| | Available for 25 to 200 mm (1.0 to 8.0 in.) sizes. Products are delivered with the Standard dual frequency excitation mode and the Enhanced dual frequency excitation mode enabled. The meter factor for the Enhanced dual frequency excitation obtained by flow calibration is inscribed on the nameplate and set into the combined converter in addition to the meter factor for the Standard dual frequency excitation. | ○ | ○ | ○ | ○ | ○ | ○ | ○ | HF2 |

T26-3.EPS

● Table of Optional Specifications (Size 2.5 mm (0.1 in.) to 400 mm (16 in.)) (continued)

○: Available -: Not available

| Item | Specifications | Applicable Model | | | | | | | Code | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|---|--|--------------------|---|--------------------|----------------------------|-----------------|---------------------------|-----------------|---------------------------|----------|--------------------------|--------|-------------------------|-----------|----------------------------|----------|-------------------------|--------|-------------------------|----------|-------------------------|--------|--------------------------|---------|--------------------------|---------|--------------------------|---------|--------------------------|---------|--------------------------|----------|---------------------------|----------|--------------------------|----------|--------------------------|----------|--------------------------|---|---|---|---|---|---|---|----|
| | | General | | Explosion proof | | Submersible | Sanitary | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | Integral Flowmeter | Remote Flowtube | Integral Flowmeter | Remote Flowtube | Remote Flowtube | Integral Flowmeter | Remote Flowtube | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | □ W L C | Z P | □ W L C | Z P | Z P | □ W L C | Z P | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | AXF**G | AXF**G | AXF**C | AXF**C | AXF**W | AXF**H | AXF**H | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Five-point Calibration in User-specified Span | A flow test near 0, 25, 50, 75, and 100% of the user-specified span is performed instead of the flow test of the standard 2m/s span and a test certificate (QIC) is submitted. Specify the span (100% flow span) whose corresponding flow velocity lies between 0.5 to 10 m/s (0.8 to 10m/s for sizes 32, 65, and 125mm) and that is less than the maximum line capacity. Selectable range of flow rate span is showing below. <table><tr><th>Size : mm (in.)</th><th>Selectable range of flow rate span : m³/h (Flow rate span velocity : m/s)</th></tr><tr><td>2.5 (0.1)</td><td>0.009 (0.5) to 0.05 (2.83)</td></tr><tr><td>5 (0.2)</td><td>0.036 (0.5) to 0.2 (2.83)</td></tr><tr><td>10 (0.4)</td><td>0.15 (0.5) to 0.96 (3.40)</td></tr><tr><td>15 (0.5)</td><td>0.32 (0.5) to 2.8 (4.40)</td></tr><tr><td>25 (1)</td><td>0.89 (0.5) to 11 (6.22)</td></tr><tr><td>32 (1.25)</td><td>2.32 (0.8) to 28.9 (10.00)</td></tr><tr><td>40 (1.5)</td><td>2.27 (0.5) to 28 (6.30)</td></tr><tr><td>50 (2)</td><td>3.54 (0.5) to 56 (7.92)</td></tr><tr><td>65 (2.5)</td><td>9.56 (0.8) to 80 (6.70)</td></tr><tr><td>80 (3)</td><td>9.05 (0.5) to 126 (6.96)</td></tr><tr><td>100 (4)</td><td>14.2 (0.5) to 190 (6.72)</td></tr><tr><td>125 (5)</td><td>35.3 (0.8) to 300 (6.79)</td></tr><tr><td>150 (6)</td><td>31.9 (0.5) to 380 (5.97)</td></tr><tr><td>200 (8)</td><td>56.6 (0.5) to 670 (5.92)</td></tr><tr><td>250 (10)</td><td>88.4 (0.5) to 1000 (5.66)</td></tr><tr><td>300 (12)</td><td>128 (0.5) to 1200 (4.72)</td></tr><tr><td>350 (14)</td><td>174 (0.5) to 1200 (3.47)</td></tr><tr><td>400 (16)</td><td>227 (0.5) to 1350 (2.98)</td></tr></table> | Size : mm (in.) | Selectable range of flow rate span : m³/h (Flow rate span velocity : m/s) | 2.5 (0.1) | 0.009 (0.5) to 0.05 (2.83) | 5 (0.2) | 0.036 (0.5) to 0.2 (2.83) | 10 (0.4) | 0.15 (0.5) to 0.96 (3.40) | 15 (0.5) | 0.32 (0.5) to 2.8 (4.40) | 25 (1) | 0.89 (0.5) to 11 (6.22) | 32 (1.25) | 2.32 (0.8) to 28.9 (10.00) | 40 (1.5) | 2.27 (0.5) to 28 (6.30) | 50 (2) | 3.54 (0.5) to 56 (7.92) | 65 (2.5) | 9.56 (0.8) to 80 (6.70) | 80 (3) | 9.05 (0.5) to 126 (6.96) | 100 (4) | 14.2 (0.5) to 190 (6.72) | 125 (5) | 35.3 (0.8) to 300 (6.79) | 150 (6) | 31.9 (0.5) to 380 (5.97) | 200 (8) | 56.6 (0.5) to 670 (5.92) | 250 (10) | 88.4 (0.5) to 1000 (5.66) | 300 (12) | 128 (0.5) to 1200 (4.72) | 350 (14) | 174 (0.5) to 1200 (3.47) | 400 (16) | 227 (0.5) to 1350 (2.98) | ○ | ○ | ○ | ○ | ○ | ○ | ○ | SC |
| Size : mm (in.) | Selectable range of flow rate span : m³/h (Flow rate span velocity : m/s) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2.5 (0.1) | 0.009 (0.5) to 0.05 (2.83) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 (0.2) | 0.036 (0.5) to 0.2 (2.83) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 (0.4) | 0.15 (0.5) to 0.96 (3.40) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 15 (0.5) | 0.32 (0.5) to 2.8 (4.40) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 25 (1) | 0.89 (0.5) to 11 (6.22) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 32 (1.25) | 2.32 (0.8) to 28.9 (10.00) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 40 (1.5) | 2.27 (0.5) to 28 (6.30) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 50 (2) | 3.54 (0.5) to 56 (7.92) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 65 (2.5) | 9.56 (0.8) to 80 (6.70) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 80 (3) | 9.05 (0.5) to 126 (6.96) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 100 (4) | 14.2 (0.5) to 190 (6.72) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 125 (5) | 35.3 (0.8) to 300 (6.79) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 150 (6) | 31.9 (0.5) to 380 (5.97) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 200 (8) | 56.6 (0.5) to 670 (5.92) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 250 (10) | 88.4 (0.5) to 1000 (5.66) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 300 (12) | 128 (0.5) to 1200 (4.72) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 350 (14) | 174 (0.5) to 1200 (3.47) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 400 (16) | 227 (0.5) to 1350 (2.98) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| FM Approval | FM Explosion proof See "HAZARDOUS AREA CLASSIFICATION" | — | — | ○ | ○ | — | — | — | FF1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| ATEX Certification | ATEX Explosion proof See "HAZARDOUS AREA CLASSIFICATION" | — | — | ○ | ○ | — | — | — | KF2 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| CSA Certification | CSA Explosion proof, Dual Seal See "HAZARDOUS AREA CLASSIFICATION" | — | — | ○ | ○ | — | — | — | CF1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| IECEX Certification (*7) | IECEX Explosion proof See "HAZARDOUS AREA CLASSIFICATION" | — | — | ○ | ○ | — | — | — | SF2 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| TIIS Certification | TIIS Flameproof See "HAZARDOUS AREA CLASSIFICATION" | — | — | ○ | △ (*9) | — | — | — | JF3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Flameproof packing adapter for TIIS Flameproof Type (*8) | Two flameproof packing adapters | — | — | ○ | ○ | — | — | — | G12 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | One flameproof packing adapter and one blind plug. Available for integral flowmeter and only when a four-wire cable is used for power input and signal output with a DC power supply. | — | — | ○ (*10) | — | — | — | — | G11 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

*1:

| | Standard | +90-degree rotation Optional Code RA | +180-degree rotation Optional Code RB | -90-degree rotation Optional Code RC |
|--------------------|-----------------------|---|--|---|
| Integral Flowmeter | Electrical Connection | Indicator | Indicator | Indicator |
| Remote Flowtube | | Electrical Connection | | Electrical Connection |

*2: When specifying the optional code BCC or BSC for a PFA or ceramics lining, it is advisable to specify the optional code GA, GC, or GD at the same time to prevent potential leakage caused by the difference in elasticity between the flowtube and chloroprene gaskets. Refer to description of "Gasket" in the "Wetted Part Material".

*3: Allowable temperature and pressure with the optional code BCC or BSC (only for Gaskets: Chloroprene rubber) are equivalent to Valqua #2010.

*4: Allowable temperature and pressure with the optional code BCF or BSF (only for Gaskets: PTFE-sheathed non-asbestos) are equivalent to Valqua #7030 (S).

*5: Special gaskets are inserted between the flowtube and the grounding ring or grounding electrode.

*6: Enhanced dual frequency excitation is not available for models with calibration code C (High Grade Accuracy).

*7: Applicable only for Australia, New Zealand, Singapore and India.

*8: Select optional code G12 or G11 when TIIS Flameproof type with wiring using a flameproof packing adapter. Available only for JIS G1/2 female electric connection.

*9: The TIIS flameproof type is only available for AXF***C-P (remote flowtube for combined use with AXFA14).

*10: In the case of Fieldbus communication type, optional codes C1, C2, C3, EM and G11 are unable to select.





T26-4.EPS

● Table of Optional Specifications (Size 500 mm (20 in.) to 2600 mm (104 in.))

○: Available —: Not available

| Item | Specifications | Applicable Model | | Code |
|--|--|------------------|-----------------|------|
| | | General | Submersible | |
| | | Remote Flowtube | Remote Flowtube | |
| | | AXF**G-N | AXF**W-N | |
| For District Heating and Cooling or Condensation-proof | Urethane resin potting is applied in the terminal box of a remote flowtube. Select JIS G1/2 for the electrical connections. 30-meter dedicated and excitation cables are pre-wired and waterproof glands with union joints are attached at factory. | ○ | — | DHC |
| User-specified Signal and Excitation Cable Length | Available for the submersible type and a model with optional code DHC. The cable length is limited up to 200 meters when combined with an AXFA11 converter. Following "L," specify the cable length in three digits as a multiple of 1 meter (e. g., 001, 002, or 005) for a length up to 5 meters, or as a multiple of 5 meters (i.e., 005, 010, 015, or the like) for a length of 5 meters or more. If this optional code is not selected, a 30-meter length cable is attached. | ○ | ○ | L*** |
| Mass Unit Setting | <p>The flow rate span, transmission pulse weight, and totalizer display pulse weight can be set in terms of mass unit. Specify the density of the process fluid when ordering in addition to the mass flow rate span, transmission pulse weight (for mass unit), and totalizer display pulse weight (for mass unit).</p> <p>When ordering a remote flowtube, parameters for 'Mass Unit Setting' will be set in the corresponding converter before shipment.</p> <p>1. Density</p> <p>a. Available density Numerics:</p> <p>Specify the numeric within the value of 500 to 2000 kg/m³, 4.2 to 16.7 lb/gal, or 31.2 to 124.8 lb/cf. And it can be up to five digits, to a maximum of 32000 ignoring the decimal point. A fraction is limited to the fourth decimal place.</p> <p>b. Available density units: kg/m³, lb/gal, lb/cf</p> <p>Example: A water density is about 1000kg/m³. In this case specify "1000kg/m³".</p> <p>However a density is changed by temperature. Specify the actual density.</p> <p>(The 1000kg/m³ is equivalent to 8.345lb/gal and 62.43lb/cf.)</p> <p>2. The mass flow rate span, transmission pulse weight, and totalizer display pulse weight</p> <p>a. Available density Numerics:</p> <p>Specify the numeric within the value of 0.0001 to 32000. And it can be up to five digits, to a maximum of 32000 ignoring the decimal point. A fraction is limited to the fourth decimal place.</p> <p>b. Mass Units Available mass units: t, kg, g, klb, lb</p> <p>Available time units: /d, /h, /min, /s</p> <p>Note1: In case of specifying the mass flow span, calculate the volumetric flow span by the setting density, and specify the available value in the mass flow span.</p> <p>Note2: In case of transmission pulse weight and totalizer display pulse weight, specify the mass unit which was specified as the flow unit.</p> | ○ | ○ | MU |
| G3/4 Female Waterproof Glands | Waterproof glands for G3/4 conduits or flexible tubes are attached to the electrical connections. Available only for JIS G1/2 female electric connections. | ○ | — | EW |
| Waterproof Glands | Waterproof glands are attached to the electrical connections. Available only for JIS G1/2 female electric connections. | ○ | — | EG |
| Waterproof Glands with Union Joints | Waterproof glands with union joints are attached to the electrical connections. Available only for JIS G1/2 female electric connections. | ○ | — | EU |
| Stainless Steel Tag Plate | Screw JIS SUS304 (AISI 304 SS/EN 1.4301 stainless steel equivalent) stainless steel tag plate for size 1100 to 2600 mm, or a pendant tag plate of JIS SUS304 is provided for size 500 to 1000 mm. Choose this option when a SS tag plate is required in addition to the standard nameplate with the tag number inscribed on it. | ○ | ○ | SCT |
| Direction Change of Electrical Connection (*1) | +90 degrees rotated terminal box to change the direction of the electrical connection. Available for 1000 mm (40 in.) and smaller sizes. | ○ | ○ | RA |
| | +180 degrees rotated terminal box to change the direction of the electrical connection. Available for 1000 mm (40 in.) and smaller sizes. | ○ | ○ | RB |
| | −90 degrees rotated terminal box to change the direction of the electrical connection. Available for 1000 mm (40 in.) and smaller sizes. | ○ | ○ | RC |
| Material Certificate | Material certificates are provided for pipe, electrodes, grounding rings, and flanges. | ○ | ○ | M01 |

*1:

| | Standard | +90-degree rotation | +180-degree rotation | −90-degree rotation |
|-----------------|---|---|---|---|
| | | Optional Code RA | Optional Code RB | Optional Code RC |
| Remote Flowtube |  | Electrical Connection →  |  | ← Electrical Connection  |

T26-5.EPS

● Table of Optional Specifications (Size 500 mm (20 in.) to 2600 mm (104 in.)) (continued)


○: Available -: Not available

| Item | Specifications | Applicable Model | | Code | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|---|--|--------------------|--|----------|---------------------------|----------|--------------------------|----------|--------------------------|----------|--------------------------|----------|---------------------------|-----------|---------------------------|-----------|---------------------------|-----------|---------------------------|-----------|----------------------------|-----------|----------------------------|-----------|----------------------------|-----------|----------------------------|-----------|----------------------------|-----------|----------------------------|-----------|----------------------------|------------|----------------------------|---|---|----|
| | | General | Submersible | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | Remote Flowtube | Remote Flowtube | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | AXF**G-N | AXF**W-N | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Hydrostatic Test | <p>The test verifies the absence of leaks by applying the following water pressures (which are determined under process connection conditions) to lining for ten minutes. Test results are described in the Note column of a test certificate(QIC).</p> <p>Process Connection: JIS 10K, ANSI Class 150, DIN PN10 JIS F12</p> <p>Water Pressure: 1.5 MPa 1.25 MPa</p> | ○ | ○ | T01 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Calibration Certificate | Level 2: The Declaration and the Calibration Equipment List are issued. | ○ | ○ | L2 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | Level 3: The Declaration and the Primary Standard List are issued. | ○ | ○ | L3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | Level 4: The Declaration and the Yokogawa Measuring Instruments Control System are issued. | ○ | ○ | L4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Five-point Calibration in User-specified Span | <p>A flow test near 0, 25, 50, 75, and 100% of the user-specified span is performed instead of the flow test of the standard 2m/s span and a test certificate (QIC) is submitted. Specify the span (100% flow span) whose corresponding flow velocity lies between 0.5 to 10 m/s and that is less than the maximum line capacity. Selectable range of flow rate span is showing below.</p> <table><thead><tr><th>Size : mm (in.)</th><th>Selectable range of flow rate span : m³/h (Flow rate span velocity : m/s)</th></tr></thead><tbody><tr><td>500 (20)</td><td>354 (0.5) to 7068 (10.00)</td></tr><tr><td>600 (24)</td><td>509 (0.5) to 8200 (8.06)</td></tr><tr><td>700 (28)</td><td>693 (0.5) to 8200 (5.92)</td></tr><tr><td>800 (32)</td><td>905 (0.5) to 8200 (4.53)</td></tr><tr><td>900 (36)</td><td>1146 (0.5) to 8200 (3.58)</td></tr><tr><td>1000 (40)</td><td>1414 (0.5) to 8200 (2.90)</td></tr><tr><td>1100 (44)</td><td>1711 (0.5) to 8200 (2.40)</td></tr><tr><td>1200 (48)</td><td>2036 (0.5) to 8200 (2.01)</td></tr><tr><td>1350 (54)</td><td>2577 (0.5) to 30000 (5.82)</td></tr><tr><td>1500 (60)</td><td>3181 (0.5) to 30000 (4.71)</td></tr><tr><td>1600 (64)</td><td>3620 (0.5) to 30000 (4.14)</td></tr><tr><td>1800 (72)</td><td>4581 (0.5) to 30000 (3.27)</td></tr><tr><td>2000 (80)</td><td>5655 (0.5) to 30000 (2.65)</td></tr><tr><td>2200 (88)</td><td>6843 (0.5) to 30000 (2.19)</td></tr><tr><td>2400 (96)</td><td>8143 (0.5) to 30000 (1.84)</td></tr><tr><td>2600 (104)</td><td>9557 (0.5) to 30000 (1.57)</td></tr></tbody></table> | Size : mm (in.) | Selectable range of flow rate span : m³/h (Flow rate span velocity : m/s) | 500 (20) | 354 (0.5) to 7068 (10.00) | 600 (24) | 509 (0.5) to 8200 (8.06) | 700 (28) | 693 (0.5) to 8200 (5.92) | 800 (32) | 905 (0.5) to 8200 (4.53) | 900 (36) | 1146 (0.5) to 8200 (3.58) | 1000 (40) | 1414 (0.5) to 8200 (2.90) | 1100 (44) | 1711 (0.5) to 8200 (2.40) | 1200 (48) | 2036 (0.5) to 8200 (2.01) | 1350 (54) | 2577 (0.5) to 30000 (5.82) | 1500 (60) | 3181 (0.5) to 30000 (4.71) | 1600 (64) | 3620 (0.5) to 30000 (4.14) | 1800 (72) | 4581 (0.5) to 30000 (3.27) | 2000 (80) | 5655 (0.5) to 30000 (2.65) | 2200 (88) | 6843 (0.5) to 30000 (2.19) | 2400 (96) | 8143 (0.5) to 30000 (1.84) | 2600 (104) | 9557 (0.5) to 30000 (1.57) | ○ | ○ | SC |
| Size : mm (in.) | Selectable range of flow rate span : m³/h (Flow rate span velocity : m/s) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 500 (20) | 354 (0.5) to 7068 (10.00) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 600 (24) | 509 (0.5) to 8200 (8.06) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 700 (28) | 693 (0.5) to 8200 (5.92) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 800 (32) | 905 (0.5) to 8200 (4.53) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 900 (36) | 1146 (0.5) to 8200 (3.58) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1000 (40) | 1414 (0.5) to 8200 (2.90) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1100 (44) | 1711 (0.5) to 8200 (2.40) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1200 (48) | 2036 (0.5) to 8200 (2.01) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1350 (54) | 2577 (0.5) to 30000 (5.82) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1500 (60) | 3181 (0.5) to 30000 (4.71) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1600 (64) | 3620 (0.5) to 30000 (4.14) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1800 (72) | 4581 (0.5) to 30000 (3.27) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2000 (80) | 5655 (0.5) to 30000 (2.65) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2200 (88) | 6843 (0.5) to 30000 (2.19) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2400 (96) | 8143 (0.5) to 30000 (1.84) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2600 (104) | 9557 (0.5) to 30000 (1.57) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

T26-6.EPS

EXTERNAL DIMENSIONS

AXF Standard, AXF002-AXF015, Wafer Type, PFA Lining

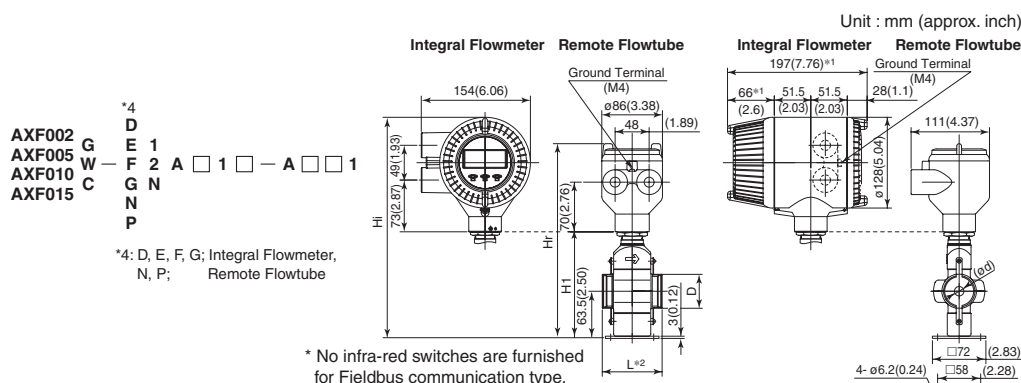

| Model | Size code | | 002 | 005 | 010 | 015 |
|--------------------|----------------------------------|-----------------|------------|--------|---------|---------|
| | Size | | 2.5(0.1) | 5(0.2) | 10(0.4) | 15(0.5) |
| | Lining code | | A | A | A | A |
| Remote flowtube | Face-to-face length | L ^{*2} | 81(3.19) | | | |
| | Outside dia. | D | 44(1.73) | | | |
| Integral flowmeter | Inner diameter of Grounding ring | ød | 15(0.59) | | | |
| | Height | H1 | 144(5.67) | | | |
| Remote flowtube | Max. Height | Hr | 268(10.55) | | | |
| | Weight kg (lb) ^{*3} | | 2.4(5.3) | | | |
| Integral flowmeter | Max. Height | Hi | 306(12.03) | | | |
| | Weight kg (lb) | | 4.1(9.0) | | | |


- *1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.
In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.
- *2: Depending on the selection of grounding ring code and optional code, add the following value to L (face-to-face length).

| Grounding Ring Code | | S, L, H, V | P, T | N |
|---------------------|------------------------------|------------|-----------|----------|
| Option Code | None | +0 | +26(1.02) | -2(0.08) |
| | GA, GC, GD (Special Gaskets) | +6(0.24) | +28(1.10) | - |

- *3: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg(20.9lb) to the weight in the table.

F22.EPS

AXF Standard, AXF025-AXF125, Wafer Type, PFA /Polyurethane Rubber /Natural Soft Rubber /EPDM Rubber Lining

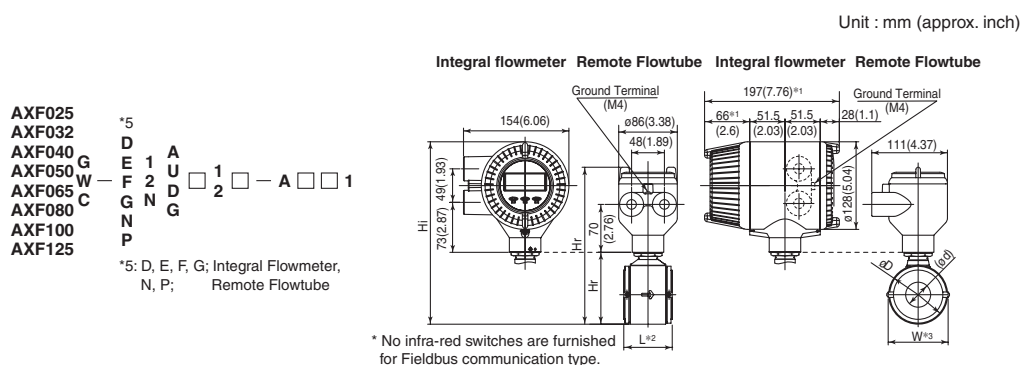

| Model | Size code | | 025 | 032 | 040 | 050 | 065 | 080 | 100 | 125 |
|--------------------|----------------------------------|-----------------|------------|------------|------------|------------|------------|------------|------------|------------|
| | Size | | 25(1) | 32(1.25) | 40(1.5) | 50(2) | 65(2.5) | 80(3) | 100(4) | 125(5) |
| | Lining code | | A,U | A,U | A,U | A,U D,G | A,U D,G | A,U D,G | A,U D,G | A,U D,G |
| Remote Flowtube | Face-to-face length | L ^{*2} | 60(2.36) | 70(2.76) | 70(2.76) | 80(3.15) | 100(3.94) | 120(4.72) | 150(5.91) | 200(7.87) |
| | Outside dia. | øD | 67.5(2.66) | 73(2.87) | 86(3.39) | 99(3.90) | 117(4.61) | 129(5.08) | 155(6.10) | 183(7.20) |
| Integral Flowmeter | Inner diameter of Grounding ring | ød | 28(1.10) | 34(1.34) | 41(1.61) | 53(2.09) | 66(2.60) | 77(3.03) | 102(4.02) | 128(5.04) |
| | Width | W ^{*3} | 67.5(2.66) | 73(2.87) | 86(3.39) | 99(3.90) | 117(4.61) | 129(5.08) | 155(6.10) | 183(7.20) |
| Remote Flowtube | Height | H1 | 92(3.62) | 98(3.86) | 111(4.37) | 129(5.08) | 147(5.79) | 157(6.18) | 183(7.20) | 212(8.35) |
| | Max. Height | Hr | 216(8.50) | 222(8.74) | 235(9.25) | 253(9.96) | 271(10.67) | 281(11.06) | 307(12.09) | 336(13.23) |
| Integral Flowmeter | Weight kg (lb) ^{*4} | | 1.9(4.1) | 2.0(4.5) | 2.2(4.9) | 2.7(5.8) | 3.4(7.6) | 4.1(9.1) | 5.6(12.3) | 9.3(20.4) |
| | Max. Height | Hi | 254(9.98) | 260(10.24) | 273(10.73) | 291(11.44) | 309(12.17) | 319(12.54) | 345(13.56) | 374(14.70) |
| Integral Flowmeter | Weight kg (lb) | | 3.6(7.8) | 3.7(8.2) | 3.9(8.7) | 4.4(9.6) | 5.1(11.3) | 5.8(12.9) | 7.3(16.0) | 11.0(24.2) |

- *1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.
In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.
- *2: Depending on the selection of grounding ring code and optional code, add the following value to L (face-to-face length).

| Grounding Ring Code | | S, L, H, V | P, T | N |
|---------------------|------------------------------|------------|-----------|----------|
| Option Code | None | +0 | +26(1.02) | -2(0.08) |
| | GA, GC, GD (Special Gaskets) | +8(0.31) | +30(1.18) | - |


- *3: When electrode structure 2 is selected, add the following value to W (width).

| Nominal Size | 25 | 32, 40, 50 | 65, 80 | 100 | 125 |
|--------------|-------------|------------|-----------|-----------|-----------|
| W | +52.5(2.07) | +52(2.05) | +49(1.93) | +48(1.89) | +47(1.85) |

- *4: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg(20.9lb) to the weight in the table.

F23.EPS

● AXF Standard, AXF150-AXF300, Wafer Type, PFA /Polyurethane Rubber /Natural Soft Rubber /EPDM Rubber Lining

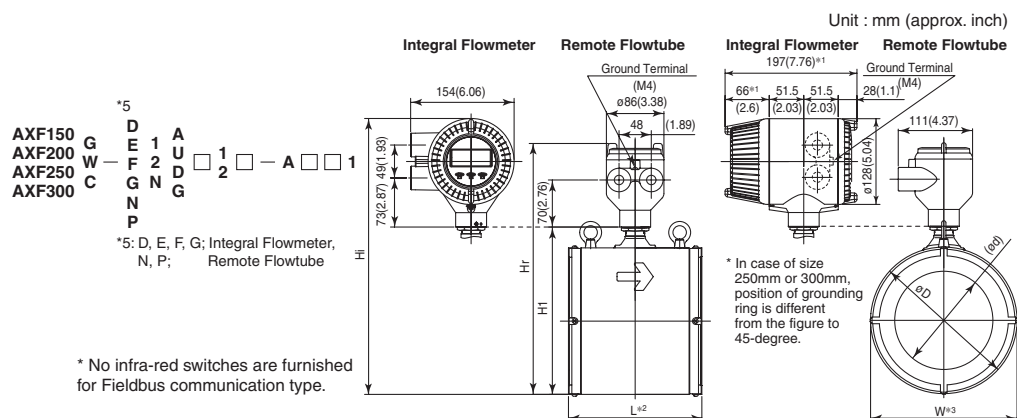

| Model | Size code | | 150 | 200 | 250 | 300 |
|--------------------|----------------------------------|-----------------|-------------|-------------|-------------|--------------|
| | Size | | 150(6) | 200(8) | 250(10) | 300(12) |
| | Lining code | | A,U D,G | A,U D,G | A,U D,G | A,U D,G |
| Remote Flowtube | Face-to-face length | L ^{*2} | 200(7.87) | 250(9.84) | 300(11.81) | 350(13.78) |
| | Outside dia. | øD | 202(7.95) | 252(9.92) | 310(12.20) | 358(14.09) |
| | Inner diameter of Grounding ring | ød | 146.1(5.75) | 193.6(7.62) | 243.7(9.59) | 294.7(11.60) |
| Integral Flowmeter | Width | W ^{*3} | 202(7.95) | 252(9.92) | 310(12.20) | 358(14.09) |
| | Height | H1 | 243(9.57) | 293(11.54) | 354(13.94) | 402(15.83) |
| | Max. Height | Hr | 367(14.45) | 417(16.42) | 478(18.82) | 526(20.71) |
| Remote Flowtube | Weight kg (lb) | | 14.5(32.0) | 22.1(48.7) | 39.0(86.0) | 48.3(106.5) |
| | | | | | | |
| Integral Flowmeter | Max. Height | Hi | 405(15.93) | 455(17.89) | 516(20.31) | 564(22.20) |
| | Weight kg (lb) | | 16.2(35.7) | 23.8(52.4) | 40.7(89.7) | 50.0(110.2) |

- *1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.
In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.
- *2: Depending on the selection of grounding ring code and optional code, add the following value to L (face-to-face length).

| Nominal Size: 150 to 200mm | | | | |
|----------------------------|------------------------------|-----------|-----------|----------|
| Grounding Ring Code | S, L, H, V | P, T | N | |
| Option Code | None | +0 | +32(1.26) | -2(0.08) |
| | GA, GC, GD (Special Gaskets) | +10(0.39) | +38(1.5) | — |

| Nominal Size: 250 to 300mm | | | | |
|----------------------------|------------|------|----------|--|
| Grounding Ring Code | S, L, H, V | P, T | N | |
| Option Code is "None" | +0 | — | -2(0.08) | |


- *3: When electrode structure 2 is selected, add the following value to W(width).

| Nominal size | 150 | 200 | 250 | 300 |
|--------------|-----------|-----------|-----------|-----------|
| W | +49(1.93) | +50(1.97) | +49(1.93) | +53(2.09) |

- *4: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached.
Add 9.5kg(20.9lb) to the weight in the table.


F24.EPS

● AXF Standard, AXF002-AXF010, Weld · Union Joint, Ceramics Lining

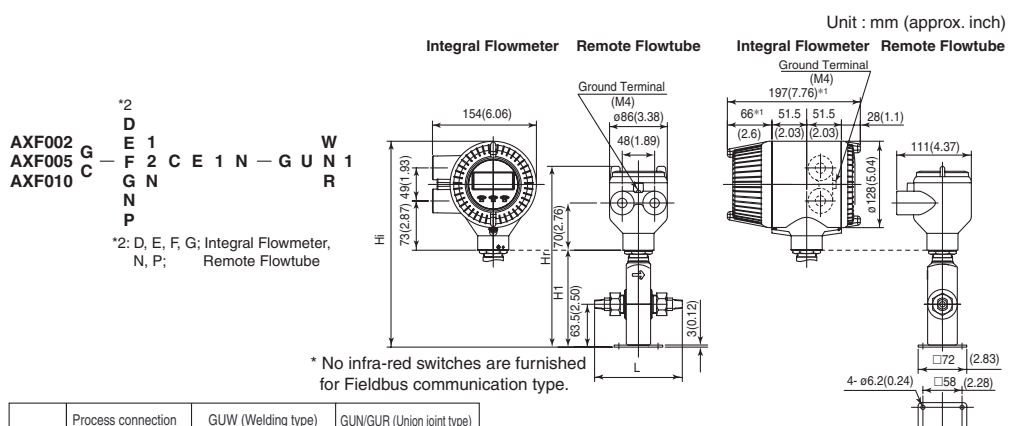


| Model | Process connection | | GUW (Welding type) | | | GUN/GUR (Union joint type) | | |
|--------------------|---------------------|----|--------------------|------------|-------------|----------------------------|------------|-------------|
| | Size code | | 002 | 005 | 010 | 002 | 005 | 010 |
| | Size | | 2.5 (0.1) | 5 (0.2) | 10 (0.4) | 2.5 (0.1) | 5 (0.2) | 10 (0.4) |
| Remote flowtube | Face-to-face length | L | 140(5.51) | | | 130(5.12) | | |
| | Height | H1 | 144(5.67) | | | 144(5.67) | | |
| | Max. Height | Hr | 268(10.55) | | | 268(10.55) | | |
| Remote flowtube | Weight kg (lb) | | 2.3(5.1) | | | 2.3(5.1) | | |
| | | | | | | | | |
| Integral flowmeter | Max. Height | Hi | 306(12.03) | | | 306(12.03) | | |
| | Weight kg (lb) | | 4(8.8) | | | 4(8.8) | | |

- *1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.
In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.

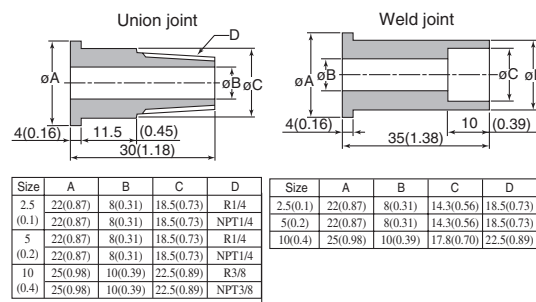

F25.EPS


● AXF Standard, AXF025-AXF100, Wafer Type, Ceramics Lining



| | | | |
|--------------------|----------------------------------|-----------------|------------|
| Model | Size code | | 015 |
| | Size | | 15(0.5) |
| | Lining code | | C |
| Remoteflowtube | Face-to-face length | L ^{*2} | 85(3.35) |
| Integral flowmeter | Outside dia. | D | 44(1.73) |
| | Inner diameter of Grounding ring | ød | 15(0.59) |
| | Height | H1 | 144(5.67) |
| Remoteflowtube | Max. Height | Hr | 268(10.55) |
| | Weight kg (lb) | | 2.3(5.1) |
| Integral flowmeter | Max. Height | Hi | 306(12.03) |
| | Weight kn (lb) | | 4.8(8) |

F26.FPS

● AXF Standard, AXF025-AXF100, Wafer Type, Ceramics Lining




| Model | Size code | | 025 | 040 | 050 | 080 | 100 |
|--------------------|----------------------------------|-----------------|------------|------------|------------|------------|------------|
| | Size | | 25(1) | 40(1.5) | 50(2) | 80(3) | 100(4) |
| | Lining code | | C | C | C | C | C |
| Remote Flowtube | Face-to-face length | L ^{±2} | 93(3.66) | 106(4.17) | 120(4.72) | 160(6.30) | 180(7.09) |
| | Outside dia. | ØD | 67.5(2.66) | 86(3.39) | 99(3.90) | 129(5.08) | 155(6.10) |
| Integral Flowmeter | Inner diameter of Grounding ring | Ød | 27(1.06) | 40(1.57) | 52(2.05) | 81(3.19) | 98(3.86) |
| | Height | H1 | 92(3.62) | 111(4.37) | 129(5.08) | 159(6.26) | 184(7.24) |
| Remote Flowtube | Max. Height | Hr | 216(8.50) | 235(9.25) | 253(9.96) | 283(11.14) | 308(12.13) |
| | Weight kg (lb) | | 2.3(5.1) | 3.2(7.0) | 4.1(9.0) | 6.8(15.0) | 9.6(21.1) |
| Integral Flowmeter | Max. Height | Hi | 254(9.98) | 273(10.73) | 291(11.44) | 321(12.64) | 346(13.62) |
| | Weight kg (lb) | | 4.0(8.8) | 4.9(10.8) | 5.8(12.7) | 8.5(18.8) | 11.3(24.9) |

E27 FPS

6-38

*3: D, E, F, G; Integral Flowmeter,
N, P; Remote Flowtube

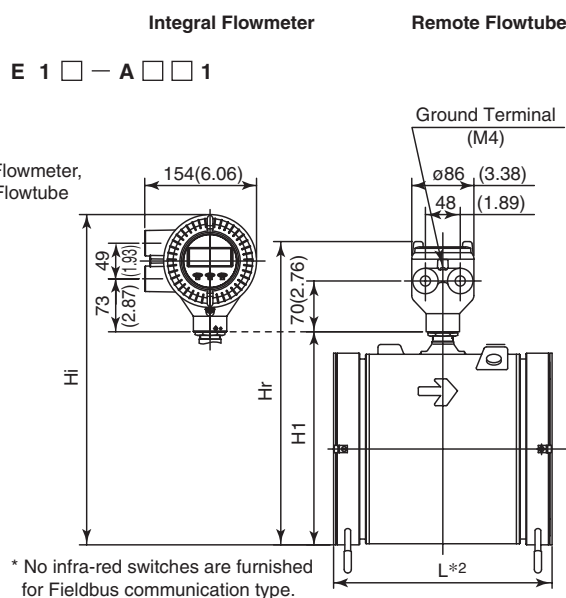

Integral Flowmeter Remote Flowtube

Ground Terminal (M4)

197(7.76)*1

66*1 (2.6) 51.5 (2.03) 51.5 (2.03) 28(1.1)

128(5.04)

111(4.37)

128(5.04)

ØD

Ød

| | | | | |
|--------------------|----------------------------------|-----------------|------------|------------|
| Model | Size code | | 150 | 200 |
| | Size | | 150(6) | 200(8) |
| | Lining code | | C | C |
| Remote Flowtube | Face-to-face length | L ^{*2} | 232(9.13) | 302(11.89) |
| | Outside dia. | D | 214(8.43) | 264(10.39) |
| Integral Flowmeter | Inner diameter of Grounding ring | ød | 144(5.67) | 192(7.56) |
| | Height | H1 | 254(10.00) | 304(11.97) |
| Remote Flowtube | Max. Height | Hr | 378(14.88) | 428(16.85) |
| | Weight kg (lb) | | 20.2(44.5) | 33.5(73.9) |
| Integral Flowmeter | Max. Height | Hi | 416(16.36) | 466(18.33) |
| | Weight kg (lb) | | 21.9(48.3) | 35.2(77.6) |


In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.

*2: Depending on the selection of grounding ring code and optional code, add the following value to L (face-to-face length).

| | | | |
|------------------------|------------|-----------|----------|
| Grounding Ring Code | S, L, H, V | P, T | N |
| L(Face-to-face length) | +0 | +30(1.18) | -6(0.24) |

● AXF Standard, AXF002-AXF015, JIS/ANSI/DIN Flange Type, PFA Lining

Unit : mm (approx. inch)

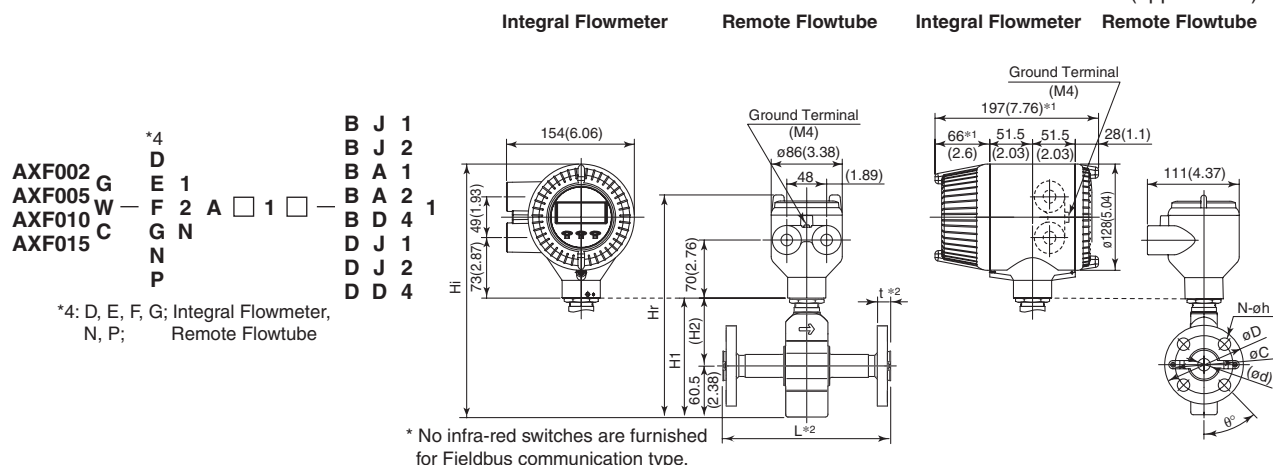

| Model | Process Connection | BJ1(JIS10K) | | | | BJ2(JIS20K) | | | | BA1(ANSI Class 150) | | | | BA2(ANSI Class 300) | | | | BD4(DIN PN40) | | | | DJ1(JIS10K) | | | DJ2(JIS20K) | | | DD4(DIN PN40) | | |
|--------------------|-------------------------------------|----------------------------|------------|-------------|-------------|----------------------------|------------|-------------|-------------|----------------------------|------------|-------------|-------------|----------------------------|------------|-------------|-------------|----------------------------|------------|-------------|-------------|----------------------------|------------|-------------|----------------------------|------------|-------------|----------------------------|------------|-------------|
| | Size code | 002 | 005 | 010 | 015 | 002 | 005 | 010 | 015 | 002 | 005 | 010 | 015 | 002 | 005 | 010 | 015 | 002 | 005 | 010 | 015 | 002 | 005 | 010 | 002 | 005 | 010 | 002 | 005 | 010 |
| | Size | 2.5 (0.1) | 5 (0.2) | 10 (0.4) | 15 (0.5) | 2.5 (0.1) | 5 (0.2) | 10 (0.4) | 15 (0.5) | 2.5 (0.1) | 5 (0.2) | 10 (0.4) | 15 (0.5) | 2.5 (0.1) | 5 (0.2) | 10 (0.4) | 15 (0.5) | 2.5 (0.1) | 5 (0.2) | 10 (0.4) | 15 (0.5) | 2.5 (0.1) | 5 (0.2) | 10 (0.4) | 2.5 (0.1) | 5 (0.2) | 10 (0.4) | 2.5 (0.1) | 5 (0.2) | 10 (0.4) |
| | Lining code | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A | A |
| Remote Flowtube | Face-to-face length L ^{*2} | 150(5.91) | | | | 150(5.91) | | | | 150(5.91) | | | | 150(5.91) | | | | 150(5.91) | | | | 150(5.91) | | | 150(5.91) | | | 150(5.91) | | |
| | Outside dia. øD | 95(3.74) | | | | 95(3.74) | | | | 88.9(3.50) | | | | 95.3(3.75) | | | | 95(3.74) | | | | 90(3.54) | | | 90(3.54) | | | 90(3.54) | | |
| | Thickness t ^{*2} | 18 to 22 (0.71 to 0.87) | | | | 20 to 24 (0.79 to 0.94) | | | | 17 to 22 (0.67 to 0.87) | | | | 20 to 25 (0.79 to 0.98) | | | | 21 to 25 (0.83 to 0.98) | | | | 18 to 22 (0.71 to 0.87) | | | 20 to 24 (0.79 to 0.94) | | | 21 to 25 (0.83 to 0.98) | | |
| | Inner diameter of grounding ring ød | 15(0.59) | | | | 15(0.59) | | | | 15(0.59) | | | | 15(0.59) | | | | 15(0.59) | | | | 12(0.47) | | | 12(0.47) | | | 12(0.47) | | |
| | Pitch circle dia. øC | 70(2.76) | | | | 70(2.76) | | | | 60.5(2.38) | | | | 66.5(2.62) | | | | 65(2.56) | | | | 65(2.56) | | | 65(2.56) | | | 60(2.36) | | |
| | Bolt hole interval ø° | 45 | | | | 45 | | | | 45 | | | | 45 | | | | 45 | | | | 45 | | | 45 | | | 45 | | |
| | Hole dia. øh | 15(0.59) | | | | 15(0.59) | | | | 15.7(0.62) | | | | 15.7(0.62) | | | | 14(0.55) | | | | 15(0.59) | | | 15(0.59) | | | 14(0.55) | | |
| Integral Flowmeter | Number of holes N | 4 | | | | 4 | | | | 4 | | | | 4 | | | | 4 | | | | 4 | | | 4 | | | 4 | | |
| | Height H1 | 141(5.54) | | | | 141(5.54) | | | | 141(5.54) | | | | 141(5.54) | | | | 141(5.54) | | | | 141(5.54) | | | 141(5.54) | | | 141(5.54) | | |
| | Height H2 | 80(3.15) | | | | 80(3.15) | | | | 80(3.15) | | | | 80(3.15) | | | | 80(3.15) | | | | 80(3.15) | | | 80(3.15) | | | 80(3.15) | | |
| Remote Flowtube | Max. Height Hr | 265(10.43) | | | | 265(10.43) | | | | 265(10.43) | | | | 265(10.43) | | | | 265(10.43) | | | | 265(10.43) | | | 265(10.43) | | | 265(10.43) | | |
| | Weight kg (lb) ^{*3} | 3.4(7.5) | | | | 3.6(7.9) | | | | 3.2(7.1) | | | | 3.6(7.9) | | | | 3.8(8.4) | | | | 3.3(7.3) | | | 3.4(7.5) | | | 3.6(7.9) | | |
| Integral Flowmeter | Max. Height Hi | 303(11.91) | | | | 303(11.91) | | | | 303(11.91) | | | | 303(11.91) | | | | 303(11.91) | | | | 303(11.91) | | | 303(11.91) | | | 303(11.91) | | |
| | Weight kg (lb) | 5.1(11.2) | | | | 5.3(11.7) | | | | 4.9(10.8) | | | | 5.3(11.7) | | | | 5.5(12.1) | | | | 5.0(11.0) | | | 5.1(11.2) | | | 5.3(11.7) | | |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.

*2: Depending on the selection of grounding ring code and optional code, add the following value to "L" (face-to-face length) and "t" (thickness of flange).

| | | L | t | L | t | L | t |
|---------------------|------------------------------|------------|----------|-----------|-----------|----------|----------|
| Grounding Ring Code | | S, L, H, V | | P, T | | N | |
| Option Code | None | +0 | +0 | +26(1.02) | +13(0.51) | -2(0.08) | -1(0.04) |
| | GA, GC, GD (Special Gaskets) | +8(0.31) | +4(0.16) | +30(1.18) | +15(0.59) | - | - |

*3: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached.
Add 9.5kg(20.9lb) to the weight in the table.

F29.EPS


Unit : mm (approx. inch)

| Integral Flowmeter | Remote Flowtube | Integral Flowmeter | Remote Flowtube |
|--------------------|-----------------|--------------------|-----------------|
|--------------------|-----------------|--------------------|-----------------|

Flowmeter Remote Flowtube

*4: D, E, F, G; Integral Flowmeter,
N, P: Remote Flowtube

* No infra-red switches are furnished for Fieldbus communication type.

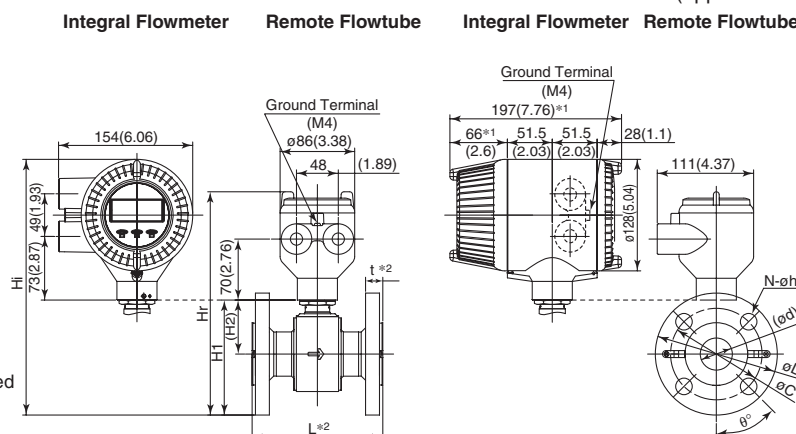[illegible]

In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.


| | | | | | | |
|--|---|---|---|---|---|---|
| | 1 | 2 | 3 | 4 | 5 | 6 |
|--|---|---|---|---|---|---|

| | | | | | | | |
|---------------------|---------------------------------|------------|----------|-----------|-----------|----------|----------|
| | | L | t | L | t | L | t |
| Grounding Ring Code | | S, L, H, V | | P, T | | N | |
| Option Code | None | +0 | +0 | +26(1.02) | +13(0.51) | -2(0.08) | -1(0.04) |
| | GA, GC, GD (Special Gaskets) | +8(0.31) | +4(0.16) | +30(1.18) | +15(0.59) | - | - |

91 92 93 94 95 96 97 98 99 100 101 102 103 104 105 106 107 108 109 110 111 112 113 114 115 116 117 118 119 120 121 122 123 124 125 126 127 128 129 130 131 132 133 134 135 136 137 138 139 140 141 142 143 144 145 146 147 148 149 150 151 152 153 154 155 156 157 158 159 160 161 162 163 164 165 166 167 168 169 170 171 172 173 174 175 176 177 178 179 180 181 182 183 184 185 186 187 188 189 190 191 192 193 194 195 196 197 198 199 200 201 202 203 204 205 206 207 208 209 210 211 212 213 214 215 216 217 218 219 220 221 222 223 224 225 226 227 228 229 230 231 232 233 234 235 236 237 238 239 240 241 242 243 244 245 246 247 248 249 250 251 252 253 254 255 256 257 258 259 260 261 262 263 264 265 266 267 268 269 270 271 272 273 274 275 276 277 278 279 280 281 282 283 284 285 286 287 288 289 290 291 292 293 294 295 296 297 298 299 300 301 302 303 304 305 306 307 308 309 310 311 312 313 314 315 316 317 318 319 320 321 322 323 324 325 326 327 328 329 330 331 332 333 334 335 336 337 338 339 340 341 342 343 344 345 346 347 348 349 350 351 352 353 354 355 356 357 358 359 360 361 362 363 364 365 366 367 368 369 370 371 372 373 374 375 376 377 378 379 380 381 382 383 384 385 386 387 388 389 390 391 392 393 394 395 396 397 398 399 400 401 402 403 404 405 406 407 408 409 410 411 412 413 414 415 416 417 418 419 420 421 422 423 424 425 426 427 428 429 430 431 432 433 434 435 436 437 438 439 440 441 442 443 444 445 446 447 448 449 450 451 452 453 454 455 456 457 458 459 460 461 462 463 464 465 466 467 468 469 470 471 472 473 474 475 476 477 478 479 480 481 482 483 484 485 486 487 488 489 490 491 492 493 494 495 496 497 498 499 500 501 502 503 504 505 506 507 508 509 510 511 512 513 514 515 516 517 518 519 520 521 522 523 524 525 526 527 528 529 530 531 532 533 534 535 536 537 538 539 540 541 542 543 544 545 546 547 548 549 550 551 552 553 554 555 556 557 558 559 560 561 562 563 564 565 566 567 568 569 570 571 572 573 574 575 576 577 578 579 580 581 582 583 584 585 586 587 588 589 590 591 592 593 594 595 596 597 598 599 600 601 602 603 604 605 606 607 608 609 610 611 612 613 614 615 616 617 618 619 620 621 622 623 624 625 626 627 628 629 630 631 632 633 634 635 636 637 638 639 640 641 642 643 644 645 646 647 648 649 650 651 652 653 654 655 656 657 658 659 660 661 662 663 664 665 666 667 668 669 670 671 672 673 674 675 676 677 678 679 680 681 682 683 684 685 686 687 688 689 690 691 692 693 694 695 696 697 698 699 700 701 702 703 704 705 706 707 708 709 710 711 712 713 714 715 716 717 718 719 720 721 722 723 724 725 726 727 728 729 730 731 732 733 734 735 736 737 738 739 740 741 742 743 744 745 746 747 748 749 750 751 752 753 754 755 756 757 758 759 760 761 762 763 764 765 766 767 768 769 770 771 772 773 774 775 776 777 778 779 780 781 782 783 784 785 786 787 788 789 790 791 792 793 794 795 796 797 798 799 800 801 802 803 804 805 806 807 808 809 810 811 812 813 814 815 816 817 818 819 820 821 822 823 824 825 826 827 828 829 830 831 832 833 834 835 836 837 838 839 840 841 842 843 844 845 846 847 848 849 850 851 852 853 854 855 856 857 858 859 860 861 862 863 864 865 866 867 868 869 870 871 872 873 874 875 876 877 878 879 880 881 882 883 884 885 886 887 888 889 890 891 892 893 894 895 896 897 898 899 900 901 902 903 904 905 906 907 908 909 910 911 912 913 914 915 916 917 918 919 920 921 922 923 924 925 926 927 928 929 930 931 932 933 934 935 936 937 938 939 940 941 942 943 944 945 946 947 948 949 950 951 952 953 954 955 956 957 958 959 960 961 962 963 964 965 966 967 968 969 970 971 972 973 974 975 976 977 978 979 980 981 982 983 984 985 986 987 988 989 990 991 992 993 994 995 996 997 998 999 1000 1001 1002 1003 1004 1005 1006 1007 1008 1009 1010 1011 1012 1013 1014 1015 1016 1017 1018 1019 1020 1021 1022 1023 1024 1025 1026 1027 1028 1029 1030 1031 1032 1033 1034 1035 1036 1037 1038 1039 1040 1041 1042 1043 1044 1045 1046 1047 1048 1049 1050 1051 1052 1053 1054 1055 1056 1057 1058 1059 1060 1061 1062 1063 1064 1065 1066 1067 1068 1069 1070 1071 1072 1073 1074 1075 1076 1077 1078 1079 1080 1081 1082 1083 1084 1085 1086 1087 1088 1089 1090 1091 1092 10

● **AXF Standard, AXF065-AXF125, JIS/ANSI/DIN Flange Type, PFA /Polyurethane Rubber /Natural Soft Rubber /EPDM Rubber Lining**

Unit : mm (approx. inch)

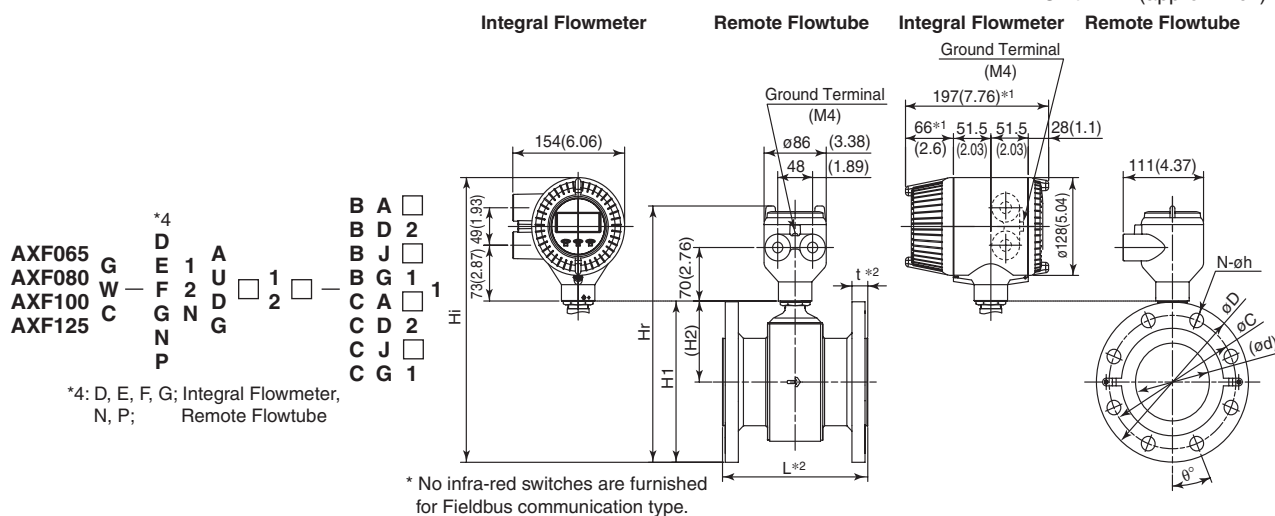

* No infra-red switches are furnished for Fieldbus communication type.

| Model | Process Connection | | B1/J1/G1(JIS10K) | | | | B2/G2/J2(JIS20K) | | | | B1/G1/G1(JIS F12) | | | | BA1/CA1(ANSI Class 150) | | | | BA2/CA2(ANSI Class 300) | | | | BD2/CD2(DIN PN16) | | | |
|---------------------|----------------------------------|------------|------------------|----------------|----------------|----------------|------------------|----------------|----------------|----------------|-------------------|----------------|----------------|-----------------|-------------------------|-----------------|------------------|-----------------|-------------------------|------------------|------------------|----------------|-------------------|----------------|----------------|--|
| | Size code | | 065 | 080 | 100 | 125 | 065 | 080 | 100 | 125 | 080 | 100 | 125 | 065 | 080 | 100 | 125 | 065 | 080 | 100 | 125 | 065 | 080 | 100 | 125 | |
| | Size | | 65 (2.53) | 80 (3.15) | 100 (3.94) | 125 (4.92) | 65 (2.53) | 80 (3.15) | 100 (3.94) | 125 (4.92) | 80 (3.15) | 100 (3.94) | 125 (4.92) | 65 (2.53) | 80 (3.15) | 100 (3.94) | 125 (4.92) | 65 (2.53) | 80 (3.15) | 100 (3.94) | 125 (4.92) | 65 (2.53) | 80 (3.15) | 100 (3.94) | 125 (4.92) | |
| Face-to-face length | L | $r^{+0.2}$ | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | A (2.00) | | |
| | L | $r^{+0.2}$ | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | D (7.87) | | |
| | L | $r^{+0.2}$ | 200 (7.87) | 200 (7.87) | 250 (9.84) | 250 (9.84) | 200 (7.87) | 200 (7.87) | 250 (9.84) | 250 (9.84) | 200 (7.87) | 200 (7.87) | 250 (9.84) | 250 (9.84) | 200 (7.87) | 200 (7.87) | 250 (9.84) | 250 (9.84) | 200 (7.87) | 200 (7.87) | 250 (9.84) | 250 (9.84) | 200 (7.87) | 200 (7.87) | 250 (9.84) | |
| Outside dia. | ØD | | 175 (6.89) | 180 (7.28) | 210 (8.27) | 250 (9.84) | 175 (6.89) | 210 (8.27) | 225 (8.86) | 270 (10.63) | 211 (8.31) | 238 (9.37) | 263 (10.35) | 177.8 (7.00) | 190.5 (7.50) | 228.6 (9.00) | 254.0 (10.00) | 190.5 (7.50) | 209.5 (8.25) | 254.0 (10.00) | 279.4 (11.00) | 185 (7.28) | 200 (7.87) | 250 (9.84) | | |
| | Thickness | $t^{+0.2}$ | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | |
| | Inner diameter of Grounding ring | ØC | 66 (2.60) | 77 (3.03) | 102 (4.02) | 128 (5.04) | 66 (2.60) | 77 (3.03) | 102 (4.02) | 128 (5.04) | 66 (2.60) | 77 (3.03) | 102 (4.02) | 128 (5.04) | 66 (2.60) | 77 (3.03) | 102 (4.02) | 128 (5.04) | 66 (2.60) | 77 (3.03) | 102 (4.02) | 128 (5.04) | 66 (2.60) | 77 (3.03) | 102 (4.02) | |
| Pitch circle dia. | ØC | | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | | |
| | ØC | | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | | |
| | ØC | | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | 175 (6.89) | 210 (8.27) | 140 (5.51) | 150 (5.91) | | |
| Integral flowmeter | Bolt hole interval | θ° | 45 | 22.5 | 22.5 | 22.5 | 22.5 | 22.5 | 22.5 | 22.5 | 45 | 30 | 45 | 45 | 22.5 | 22.5 | 22.5 | 22.5 | 22.5 | 22.5 | 22.5 | 22.5 | 22.5 | 22.5 | | |
| | Hole dia. | Øh | 19 (0.75) | 19 (0.75) | 19 (0.75) | 23 (0.91) | 19 (0.75) | 23 (0.91) | 23 (0.91) | 23 (0.91) | 19 (0.75) | 19 (0.75) | 19 (0.75) | 19 (0.75) | 19 (0.75) | 19 (0.75) | 19 (0.75) | 22.4 (0.88) | 22.4 (0.88) | 22.4 (0.88) | 22.4 (0.88) | 18 (0.71) | 18 (0.71) | 18 (0.71) | | |
| | Number of holes | N | 4 | 8 | 8 | 8 | 8 | 8 | 8 | 8 | 4 | 4 | 4 | 4 | 4 | 4 | 8 | 8 | 8 | 8 | 8 | 4 | 4 | 4 | 4 | |
| Remote flowtube | Height | H1 | 176 (6.93) | 187 (7.36) | 211 (8.30) | 245 (9.65) | 176 (6.93) | 195 (7.68) | 218 (8.59) | 255 (10.03) | 200 (7.87) | 225 (8.85) | 252 (9.90) | 177 (6.97) | 190 (7.48) | 220 (8.66) | 247 (9.72) | 184 (7.24) | 200 (7.87) | 233 (9.16) | 260 (10.22) | 181 (7.13) | 195 (7.68) | 216 (8.49) | | |
| | Height | H2 | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | 120 (4.72) | | |
| | Max. Height | Hr | 300 (11.81) | 311 (12.24) | 335 (13.18) | 365 (14.52) | 300 (11.81) | 325 (12.76) | 342 (13.47) | 379 (14.92) | 429 (16.90) | 324 (12.76) | 376 (14.79) | 430 (16.93) | 300 (11.81) | 314 (12.36) | 344 (13.54) | 371 (14.61) | 300 (11.81) | 324 (12.76) | 357 (14.04) | 384 (15.11) | 416 (16.37) | 439 (17.28) | 469 (18.45) | |
| Integral flowmeter | Weight kg (lb) | $W^{+0.3}$ | 19.8 (43.8) | 21.2 (46.8) | 23.2 (51.2) | 28.3 (62.4) | 20.5 (45.2) | 22.7 (50.1) | 27.3 (60.2) | 33.3 (73.5) | 26.2 (57.7) | 29.6 (65.3) | 32.9 (72.6) | 19.8 (43.8) | 21.2 (46.8) | 23.2 (51.2) | 28.3 (62.4) | 20.5 (45.2) | 22.7 (50.1) | 27.3 (60.2) | 33.3 (73.5) | 26.2 (57.7) | 29.6 (65.3) | 32.9 (72.6) | | |
| | Max. Height | H1 | 338 (13.31) | 349 (13.73) | 372 (14.65) | 407 (16.01) | 338 (13.31) | 360 (14.16) | 380 (14.96) | 417 (16.40) | 476 (19.54) | 362 (14.29) | 413 (16.26) | 439 (17.31) | 338 (13.31) | 352 (15.02) | 382 (16.08) | 436 (19.62) | 362 (14.25) | 394 (15.52) | 421 (16.58) | 441 (13.50) | 462 (14.06) | 495 (14.85) | | |
| | Weight kg (lb) | | 10.7 (23.4) | 11.3 (25.0) | 14.1 (31.1) | 19.1 (42.1) | 11.0 (24.2) | 14.1 (31.1) | 14.6 (32.3) | 18.6 (41.1) | 24.5 (54.0) | 13.9 (30.6) | 15.2 (33.6) | 16.2 (35.7) | 10.7 (23.4) | 11.3 (25.0) | 14.1 (31.1) | 19.1 (42.1) | 10.7 (23.4) | 11.3 (25.0) | 14.1 (31.1) | 19.1 (42.1) | 14.6 (32.3) | 18.6 (41.1) | | |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.

*2: Depending on the selection of grounding ring code and optional code, add the following value to "L" (face-to-face length) and "t" (thickness of flange).


| | | L | t | L | t | L | t |
|---------------------|---------------------------------|------------|----------|-----------|-----------|----------|----------|
| Grounding Ring Code | | S, L, H, V | | P, T | | N | |
| Option Code | None | +0 | +0 | +26(1.02) | +13(0.51) | -2(0.08) | -1(0.04) |
| | GA, GC, GD (Special Gaskets) | +8(0.31) | +4(0.16) | +30(1.18) | +15(0.59) | - | - |

*3: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached.

Add 9.5kg(20.9lb) to the weight in the table.

● AXF Standard, AXF150, AXF200, JIS/ANSI/DIN Flange Type, PFA /Polyurethane Rubber /Natural Soft Rubber /EPDM Rubber Lining


Unit : mm (approx. inch)

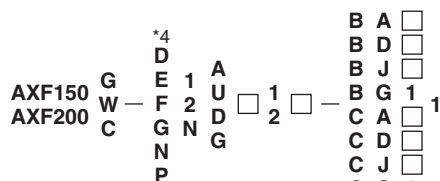

*4: D, E, F, G; Integral Flowmeter,
N, P; Remote Flowtube

Integral Flowmeter


Remote Flowtube

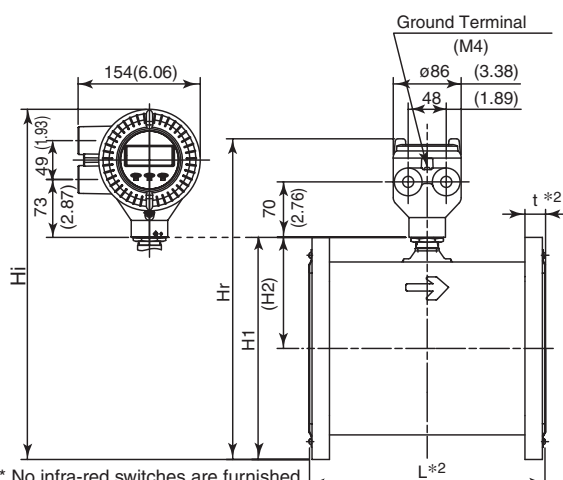

* No infra-red switches are furnished for Fieldbus communication type.

Integral Flowmeter

Remote Flowtube

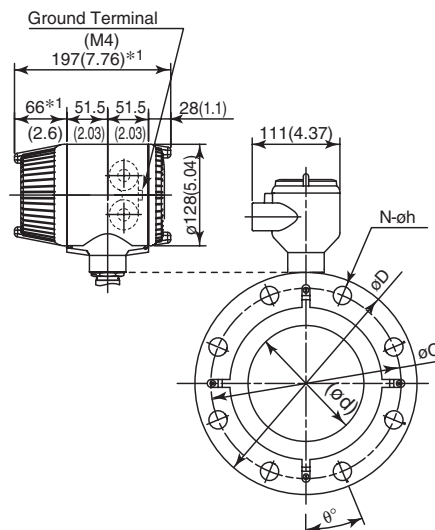

| Model | Process Connection | | BJ1/CJ1(JIS10K) | | BJ2/CJ2(JIS20K) | | BG1/CG1(JIS F12) | | BA1/CA1(ANSI Class 150) | | BA2/CA2(ANSI Class 300) | | BD1/CD1(DIN PN10) | | BD2/CD2(DIN PN16) | |
|-----------------------|-------------------------------------|--------------------------------|-----------------|-----------------|-----------------|-----------------|------------------|-----------------|-------------------------|------------------|-------------------------|------------------|-------------------|-----------------|-------------------|--|
| | Size code | | 150 | 200 | 150 | 200 | 150 | 200 | 150 | 200 | 150 | 200 | 200 | 150 | 200 | |
| | Size | | 150 (6) | 200 (8) | 150 (6) | 200 (8) | 150 (6) | 200 (8) | 150 (6) | 200 (8) | 150 (6) | 200 (8) | 200 (8) | 150 (6) | 200 (8) | |
| | Lining code | | A.U D.G | A.U D.G | A.U D.G | A.U D.G | A.U D.G | A.U D.G | A.U D.G | A.U D.G | A.U D.G | A.U D.G | A.U D.G | A.U D.G | A.U D.G | |
| Remote flowtube | Face-to-face length | L ^{o*2} ₋₃ | 300 (11.81) | 350 (13.78) | 300 (11.81) | 350 (13.78) | 300 (11.81) | 350 (13.78) | 300 (11.81) | 350 (13.78) | 300 (11.81) | 350 (13.78) | 350 (13.78) | 300 (11.81) | 350 (13.78) | |
| | Outside dia. | øD | 280 (11.02) | 330 (12.99) | 305 (12.01) | 350 (13.78) | 290 (11.42) | 342 (13.46) | 279.4 (11.00) | 342.9 (13.50) | 317.5 (12.50) | 381.0 (15.00) | 340 (13.39) | 285 (11.22) | 340 (13.39) | |
| | Thickness | t ^{*2} | 27 (1.06) | 27 (1.06) | 33 (1.30) | 35 (1.38) | 27 (1.06) | 29 (1.14) | 29 (1.20) | 30.4 (1.31) | 33.4 (1.31) | 46.1 (1.71) | 46.1 (1.81) | 29 (1.14) | 27 (1.06) | |
| | Inner diameter of Grounding ring | ød | 146.1 (5.75) | 193.6 (7.62) | 146.1 (5.75) | 193.6 (7.62) | 146.1 (5.75) | 193.6 (7.62) | 146.1 (5.75) | 193.6 (7.62) | 146.1 (5.75) | 193.6 (7.62) | 146.1 (7.62) | 193.6 (7.62) | 146.1 (5.75) | |
| | Pitch circle dia. | øC | 240 (9.45) | 290 (11.42) | 260 (10.24) | 305 (12.01) | 247 (9.72) | 299 (11.77) | 251.3 (9.50) | 298.5 (11.75) | 269.7 (10.62) | 330.2 (13.00) | 295 (11.61) | 240 (9.45) | 295 (11.61) | |
| Integral flowmeter | Bolt hole interval | θ° | 22.5 | 15 | 15 | 15 | 30 | 22.5 | 22.5 | 22.5 | 15 | 15 | 22.5 | 15 | 15 | |
| | Hole dia. | øh | 23 (0.91) | 23 (0.91) | 25 (0.98) | 25 (0.98) | 19 (0.75) | 19 (0.75) | 22.4 (0.88) | 22.4 (0.88) | 22.4 (0.88) | 25.4 (1.00) | 22 (0.87) | 22 (0.87) | 22 (0.87) | |
| | Number of holes | N | 8 | 12 | 12 | 12 | 6 | 8 | 8 | 8 | 12 | 12 | 8 | 8 | 12 | |
| | Height | H1 | 281 (11.06) | 331 (13.03) | 294 (11.56) | 341 (13.43) | 286 (11.26) | 337 (13.27) | 281 (11.05) | 337 (13.29) | 300 (11.80) | 357 (14.04) | 336 (13.23) | 284 (11.16) | 336 (13.23) | |
| Remote flowtube | Height | H2 | 141 (5.55) | 166 (6.54) | 141 (5.55) | 166 (6.54) | 141 (5.55) | 166 (6.54) | 141 (5.55) | 166 (6.54) | 141 (5.55) | 166 (6.54) | 166 (6.54) | 141 (5.55) | 166 (6.54) | |
| | Max. Height | Hr | 405 (15.94) | 455 (17.91) | 418 (16.44) | 465 (18.31) | 410 (16.14) | 461 (18.15) | 405 (15.93) | 461 (18.17) | 424 (16.68) | 481 (18.92) | 460 (18.11) | 408 (16.04) | 460 (18.11) | |
| | Weight kg (lb) *3 | | 27.8 (61.3) | 37.3 (82.2) | 37.1 (81.8) | 51.9 (114.4) | 29.9 (65.9) | 43.2 (95.3) | 30.9 (68.0) | 49.2 (108.4) | 52.5 (115.7) | 78.8 (173.7) | 42.5 (93.7) | 28.7 (63.2) | 41.9 (92.5) | |
| Integral flowmeter | Max. Height | Hi | 443 (17.42) | 493 (19.39) | 456 (17.95) | 503 (19.80) | 448 (17.64) | 499 (19.65) | 443 (17.43) | 499 (19.66) | 462 (18.18) | 519 (20.41) | 498 (19.61) | 446 (17.54) | 498 (19.61) | |
| | Weight kg (lb) | | 29.5 (65.0) | 39.0 (86.0) | 38.8 (85.5) | 53.6 (118.2) | 31.6 (69.7) | 44.9 (99.0) | 32.6 (71.8) | 50.9 (112.2) | 54.2 (119.5) | 80.5 (177.5) | 44.2 (97.5) | 30.4 (66.9) | 43.6 (96.2) | |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.

*2: Depending on the selection of grounding ring code and optional code, add the following value to "L" (face-to-face length) and "t" (thickness of flange).

| | L | t | L | t | L | t |
|---------------------|------------------------------|-----------|----------|-----------|-----------|----------|
| Grounding Ring Code | S, L, H, V | P, T | N | | | |
| Option Code | None | +0 | +0 | +32(1.26) | +16(0.63) | -2(0.08) |
| | GA, GC, GD (Special Gaskets) | +10(0.39) | +5(0.20) | +38(1.5) | +19(0.75) | - |

*3: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached.

Add 9.5kg(20.9lb) to the weight in the table.

F32.EPS

● AXF Standard, AXF250-AXF400, JIS/ANSI/DIN Flange Type, PFA /Polyurethane Rubber /Natural Soft Rubber /EPDM Rubber Lining

Unit : mm (approx. inch)

AXF250 G W C
AXF300 G W C
AXF350 G W C
AXF400 G W C


*4: D, E, F, G; Integral Flowmeter,
N, P; Remote Flowtube

Integral Flowmeter Remote Flowtube

154(6.06)
49(1.93)
73(2.87)
H1
H2
H3
Hr
L*2
t*2

Ground Terminal (M4)
48(1.89)
Eye Bolt
ø86
(3.38)
197(7.76)*1
66*1 (2.6)
51.5 (2.03)
51.5 (2.03)
28(1.1)
ø128(5.04)
111 (4.37)
N-øh
øD
øC
θ°

*4: D, E, F, G; Integral Flowmeter,
N, P; Remote Flowtube

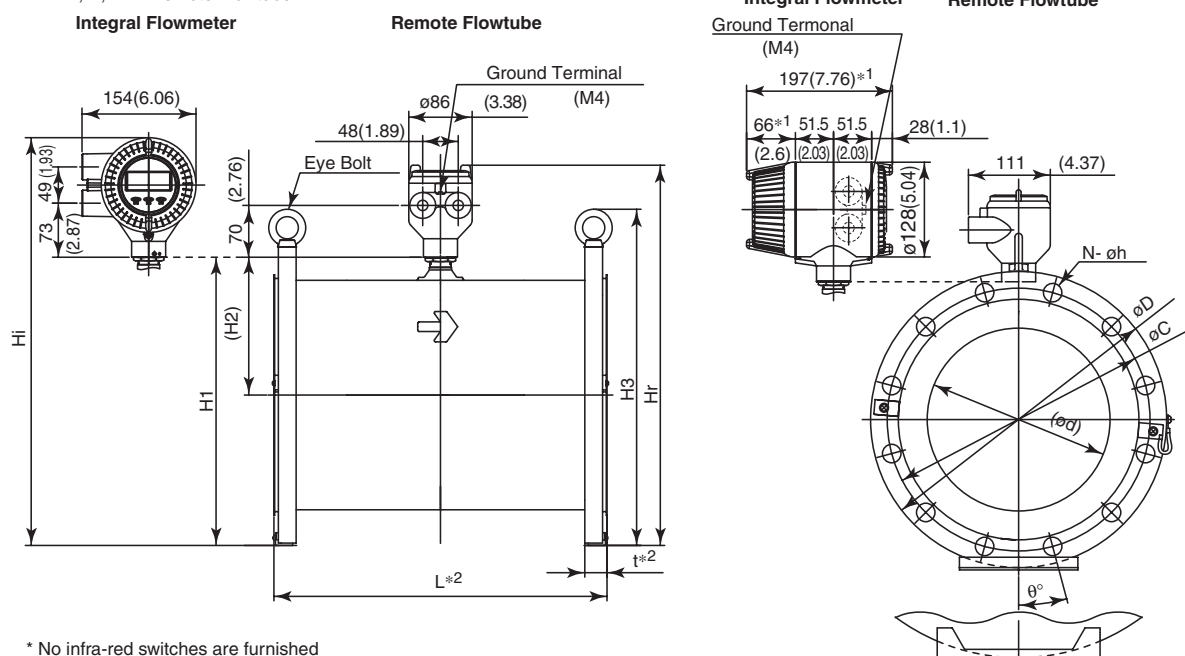

* No infra-red switches are furnished for Fieldbus communication type.

for AXF300, AXF350, AXF400

| Model | Process Connection | | BJ1/CJ1(JIS10K) | | | | BJ2/CJ2(JIS20K) | | | | BG1/CG1(JIS F12) | | | | BA1/CA1(ANSI Class 150) | | | | BA2/CA2(ANSI Class 300) | | | | BD1/CD1(DIN PN10) | | | | BD2/CD2(DIN PN16) | | | |
|--------------------|----------------------------------|-----------------|-----------------|-------|-------|-------|-----------------|-------|-------|-------|------------------|-------|-------|-------|-------------------------|-------|-------|-------|-------------------------|-------|-------|-------|-------------------|-------|-------|-------|-------------------|-------|-------|-------|
| | Size code | | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 |
| Size | | | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 | 250 | 300 | 350 | 400 |
| Lining code | | | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U | A.U |
| Remote flowtube | Face-to-face length | L ^{*2} | 450 | 500 | 550 | 600 | 450 | 500 | 550 | 600 | 450 | 500 | 550 | 600 | 450 | 500 | 550 | 600 | 450 | 500 | 550 | 600 | 450 | 500 | 550 | 600 | 450 | 500 | 550 | 600 |
| | Outside dia. | øD | 400 | 445 | 490 | 560 | 430 | 480 | 530 | 582 | 406.4 | 482.6 | 533.4 | 596.9 | 444.5 | 520.7 | 595 | 665 | 505 | 585 | 655 | 725 | 400 | 445 | 490 | 560 | 430 | 480 | 530 | 582 |
| | Thickness | t ^{*2} | 32 | 34 | 36 | 38 | 32 | 34 | 36 | 38 | 32 | 34 | 36 | 38 | 32 | 34 | 36 | 38 | 32 | 34 | 36 | 38 | 32 | 34 | 36 | 38 | 32 | 34 | 36 | 38 |
| | Inner diameter of Grounding ring | ød | 243 | 291.3 | 323.4 | 373.5 | 243 | 291.3 | 323.4 | 373.5 | 243 | 291.3 | 323.4 | 373.5 | 243 | 291.3 | 323.4 | 373.5 | 243 | 291.3 | 323.4 | 373.5 | 243 | 291.3 | 323.4 | 373.5 | 243 | 291.3 | 323.4 | 373.5 |
| | Pitch circle dia. | øC | 355 | 400 | 445 | 510 | 380 | 430 | 475 | 524 | 362.0 | 431.8 | 476.3 | 539.8 | 387.4 | 450.9 | 500 | 550 | 350 | 400 | 450 | 500 | 350 | 400 | 450 | 500 | 350 | 400 | 450 | 500 |
| Integral flowmeter | Bolt hole interval | θ° | 15 | 11.25 | 11.25 | 11.25 | 15 | 11.25 | 11.25 | 11.25 | 15 | 11.25 | 11.25 | 11.25 | 15 | 11.25 | 11.25 | 11.25 | 15 | 11.25 | 11.25 | 11.25 | 15 | 11.25 | 11.25 | 11.25 | 15 | 11.25 | 11.25 | 11.25 |
| | Hole dia. | øh | 25 | 25 | 25 | 27 | 27 | 27 | 23 | 23 | 25 | 25.4 | 25.4 | 28.4 | 28.4 | 28.4 | 31.8 | 31.8 | 22 | 22 | 22 | 22 | 26 | 26 | 26 | 26 | 26 | 26 | 26 | 26 |
| | Number of holes | N | 12 | 16 | 16 | 16 | 12 | 16 | 8 | 10 | 10 | 12 | 12 | 12 | 12 | 16 | 16 | 16 | 12 | 12 | 12 | 16 | 16 | 12 | 12 | 16 | 16 | 12 | 12 | 12 |
| | Height | H1 | 400 | 447 | 491 | 553 | 415 | 464 | 511 | 564 | 403 | 466 | 512 | 572 | 422 | 485 | 539 | 600 | 447 | 498 | 556 | 626 | 402 | 454 | 512 | 572 | 422 | 485 | 539 | 600 |
| Remote flowtube | Max. Height | Hr | 524 | 571 | 615 | 677 | 539 | 588 | 635 | 688 | 527 | 590 | 636 | 696 | 546 | 609 | 669 | 734 | 571 | 632 | 692 | 759 | 526 | 588 | 648 | 715 | 526 | 588 | 648 | 715 |
| | Weight kg (lb) ^{*3} | | 70.0 | 78.0 | 107.0 | 135.0 | 98.5 | 114.5 | 134.5 | 161.5 | 121.2 | 137.0 | 161.5 | 183.8 | 104.8 | 151.8 | 185.3 | 233.0 | 176.7 | 230.0 | 284.0 | 344.0 | 129.7 | 174.8 | 229.7 | 284.0 | 344.0 | 418.0 | 498.0 | 584.0 |
| Integral flowmeter | Max. Height | Hi | 562 | 609 | 653 | 715 | 577 | 626 | 673 | 726 | 565 | 628 | 674 | 734 | 584 | 647 | 707 | 772 | 615 | 676 | 737 | 802 | 562 | 619 | 676 | 737 | 799 | 860 | 921 | 986 |
| | Weight kg (lb) | | 71.7 | 79.7 | 108.7 | 136.7 | 100.2 | 116.2 | 136.7 | 161.5 | 121.2 | 137.0 | 161.5 | 183.8 | 104.8 | 151.8 | 185.3 | 233.0 | 176.7 | 230.0 | 284.0 | 344.0 | 129.7 | 174.8 | 229.7 | 284.0 | 344.0 | 418.0 | 498.0 | 584.0 |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.

*2: Depending on the selection of grounding ring code and optional code, add the following value to "L" (face-to-face length) and "t" (thickness of flange).

| Nominal Size: 250 mm to 300 mm | | | |
|--------------------------------|------------|----|-------------------|
| | L | t | |
| Grounding Ring Code | S, L, H, V | N | |
| Option Code is "None" | +0 | +0 | -6(0.24) -3(0.12) |

| Nominal Size: 350 mm to 400 mm | | | |
|--------------------------------|------------|----|--------------------|
| | L | t | |
| Grounding Ring Code | S, L, H, V | N | |
| Option Code is "None" | +0 | +0 | -10(0.39) -5(0.20) |

*3: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg(20.9lb) to the weight in the table.


F33.EPS

● AXF Standard, AXF015-AXF125, Sanitary for Clamp Connection, PFA Lining

Unit : mm (approx. inch)

AXF015
AXF025
AXF032
AXF040
AXF050 H — F 2 A L 1 N — H A B
AXF065 G N — H D B 1
AXF080 N — H K B
AXF100 P
AXF125

*3: D, E, F, G; Integral Flowmeter,
N, P; Remote Flowtube

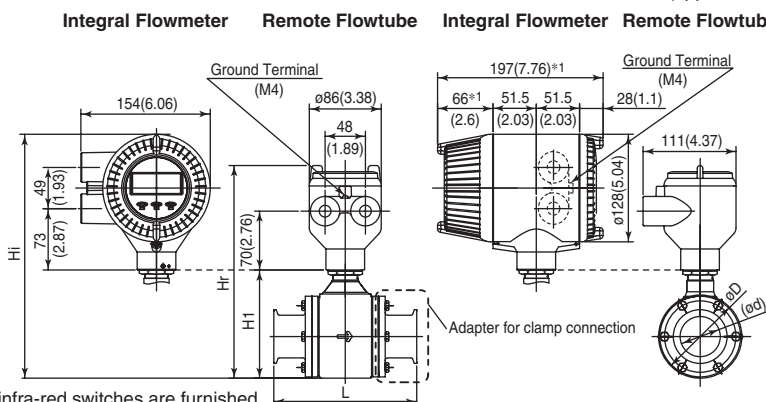


* No infra-red switches are furnished for Fieldbus communication type.

| Model | Process Connection | | HAB / HDB / HKB | | | | | | | | | |
|--------------------|---------------------|----|-----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|-----------------|
| | Size code | | 015 | 025 | 032 | 040 | 050 | 065 | 080 | 100 | 125 | |
| | Size | | 15 (0.5) | 25 (1) | 32 (1.3) | 40 (1.5) | 50 (2) | 65 (2.6) | 80 (3) | 100 (4) | 125 (5) | |
| | Lining code | | A | A | A | A | A | A | A | A | A | |
| Remote Flowtube | Face-to-face length | L | 166 (6.55) | 166 (6.55) | 166 (6.55) | 166 (6.55) | 176 (6.94) | 196 (7.73) | 216 (8.52) | 246 (9.70) | 316 (12.46) | |
| | Outside dia. | øD | 73 (2.87) | 73 (2.87) | 73 (2.87) | 86 (3.39) | 99 (3.90) | 117 (4.61) | 129 (5.08) | 155 (6.10) | 183 (7.20) | |
| Integral Flowmeter | Inner dia. | ød | HAB | 15.7 (0.62) | 22.1 (0.87) | — | 34.8 (1.37) | 47.5 (1.87) | 60.2 (2.37) | 72.9 (2.87) | 97.4 (3.83) | — |
| | | | HDB | 16 (0.63) | 26 (1.02) | 32 (1.26) | 38 (1.50) | 50 (1.97) | 66 (2.60) | 81 (3.19) | 100 (3.94) | 125 (4.92) |
| | | | HKB | 15.2 (0.60) | 22.6 (0.89) | 31.3 (1.23) | 35.6 (1.40) | 48.6 (1.91) | 60.3 (2.37) | 72.9 (2.87) | 97.6 (3.84) | 135.7 (5.34) |
| | Height | H1 | 98 (3.86) | 98 (3.86) | 98 (3.86) | 111 (4.37) | 129 (5.08) | 147 (5.79) | 157 (6.18) | 183 (7.20) | 212 (8.35) | |
| Remote Flowtube | Max. Height | Hr | 222 (8.74) | 222 (8.74) | 222 (8.74) | 235 (9.25) | 253 (9.96) | 271 (10.67) | 281 (11.06) | 307 (12.09) | 336 (13.36) | |
| | Weight kg (lb)*2 | | 2.7 (6.0) | 2.5 (5.5) | 2.6 (5.7) | 2.9 (6.4) | 3.6 (7.9) | 4.8 (10.6) | 5.7 (12.6) | 8.1 (17.9) | 12.1 (26.7) | |
| Integral Flowmeter | Max. Height | Hi | 260 (10.22) | 260 (10.22) | 260 (10.22) | 273 (10.73) | 291 (11.44) | 309 (12.15) | 319 (12.54) | 345 (13.56) | 374 (14.70) | |
| | Weight kg (lb) | | 4.4 (9.7) | 4.2 (9.3) | 4.3 (9.5) | 4.6 (10.1) | 5.3 (11.7) | 6.5 (14.3) | 7.4 (16.3) | 9.8 (21.6) | 13.8 (30.4) | |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

*2: When option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg(20.9lb) to the weight in the table.

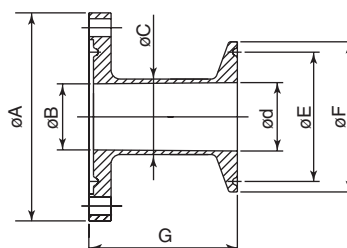

Adapter for clamp connection

| Process Connection | HAB (Tri-Clamp) | | | | | | | HDB (DIN 32676 Clamp) | | | | | | | HKB (ISO2852 Clamp) | | | | | | | | | | | | | |
|--------------------|-----------------|----------------|----------------|----------------|----------------|----------------|-----------------|-----------------------|----------------|----------------|----------------|----------------|----------------|----------------|---------------------|---------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|-----------------|-----------------|-------------|-------------|-------------|
| Nominal Size | 15 | 25 | 40 | 50 | 65 | 80 | 100 | 15 | 25 | 32 | 40 | 50 | 65 | 80 | 100 | 125 | 15 | 25 | 32 | 40 | 50 | 65 | 80 | 100 | 125 | | | |
| øA | 70 (2.76) | 70 (2.76) | 83 (3.27) | 96 (3.78) | 114 (4.49) | 126 (4.96) | 152 (5.98) | 70 (2.76) | 70 (2.76) | 70 (2.76) | 83 (3.27) | 96 (3.78) | 114 (4.49) | 126 (4.96) | 152 (5.98) | 180 (7.09) | 70 (2.76) | 70 (2.76) | 70 (2.76) | 83 (3.27) | 96 (3.78) | 114 (4.49) | 126 (4.96) | 152 (5.98) | 180 (7.09) | | | |
| øB | 16 (0.63) | 22.2 (0.87) | 34.6 (1.36) | 47.6 (1.87) | 59.5 (2.34) | 72.3 (2.85) | 97 (3.82) | 16 (0.63) | 22.2 (0.87) | 29.4 (1.16) | 34.6 (1.36) | 47.6 (1.87) | 59.5 (2.34) | 72.3 (2.85) | 97 (3.82) | 123 (4.84) | 16 (0.63) | 22.2 (0.87) | 29.4 (1.16) | 34.6 (1.36) | 47.6 (1.87) | 59.5 (2.34) | 72.3 (2.85) | 97 (3.82) | 123 (4.84) | | | |
| øC | 19.2 (0.76) | 25.4 (1.00) | 38.1 (1.50) | 50.8 (2.00) | 63.5 (2.50) | 76.2 (3.00) | 101.6 (4.00) | 20 (0.79) | 30 (1.18) | 36 (1.42) | 42 (1.65) | 54 (2.13) | 70 (2.76) | 85 (3.35) | 104 (4.09) | 129 (5.08) | 18 (0.71) | 25.6 (1.01) | 34.3 (1.35) | 38.6 (1.52) | 51.6 (2.03) | 64.1 (2.52) | 76.7 (3.02) | 102.5 (4.04) | 141.2 (5.56) | | | |
| øD | 15.7 (0.62) | 22.1 (0.87) | 34.8 (1.37) | 47.5 (1.87) | 60.2 (2.37) | 72.9 (2.87) | 97.4 (3.83) | 16 (0.63) | 22.2 (0.87) | 29.4 (1.16) | 34.6 (1.36) | 47.6 (1.87) | 59.5 (2.34) | 72.3 (2.85) | 97 (3.82) | 123 (4.84) | 15.2 (0.60) | 22.6 (0.89) | 31.3 (1.23) | 35.6 (1.40) | 48.6 (1.91) | 60.3 (2.37) | 72.9 (2.87) | 97.6 (3.84) | 135.7 (5.34) | | | |
| øE | — | 43.6 (1.72) | 43.6 (1.72) | 56.3 (2.22) | 70.6 (2.78) | 83.3 (3.28) | 110.3 (4.34) | 27.5 (1.08) | 43.5 (1.71) | 43.5 (1.71) | 43.5 (1.71) | 56.5 (2.22) | 70.6 (2.78) | 83.3 (3.28) | 110.3 (4.34) | 146 (5.75) | 27.5 (1.08) | 43.5 (1.71) | 43.5 (1.71) | 43.5 (1.71) | 56.5 (2.22) | 70.6 (2.78) | 83.3 (3.28) | 110.3 (4.34) | 146 (5.75) | | | |
| øF | 25 (0.98) | 50.4 (1.98) | 50.4 (1.98) | 64 (2.52) | 77.4 (3.05) | 91 (3.58) | 118.9 (4.68) | 34 (1.34) | 50.5 (1.99) | 50.5 (1.99) | 50.5 (1.99) | 64 (2.52) | 81 (3.19) | 97 (3.82) | 119 (4.69) | 155 (6.10) | 34 (1.34) | 50.5 (1.99) | 50.5 (1.99) | 50.5 (1.99) | 64 (2.52) | 77.5 (3.05) | 91 (3.58) | 119 (4.69) | 155 (6.10) | | | |
| G | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 60 (2.36) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 50 (1.97) | 60 (2.36) | | | |
| Parts No. | F9811 HU | F9811 HV | F9811 HX | F9811 HY | F9811 HZ | F9811 JA | F9811 JB | F9811 JC | F9811 JD | F9811 JE | F9811 JF | F9811 JG | F9811 JH | F9811 JI | F9811 JJ | F9811 JK | F9811 JL | F9811 JM | F9811 JN | F9811 JO | F9811 JP | F9811 JQ | F9811 JR | F9811 JS | F9811 JT | F9811 JU | F9811 JV | F9811 JW |

F34.EPS


● **AXF Standard, AXF015-AXF125, Sanitary for Union Connection, PFA Lining**

Unit : mm (approx. inch)

AXF015
AXF025
AXF032
AXF040
AXF050
AXF065
AXF080
AXF100
AXF125

*3
D
E 1 J K B
F 2 A L 1 N — J D B 1
G N J S B

*3: D, E, F, G; Integral Flowmeter,
N, P; Remote Flowtube

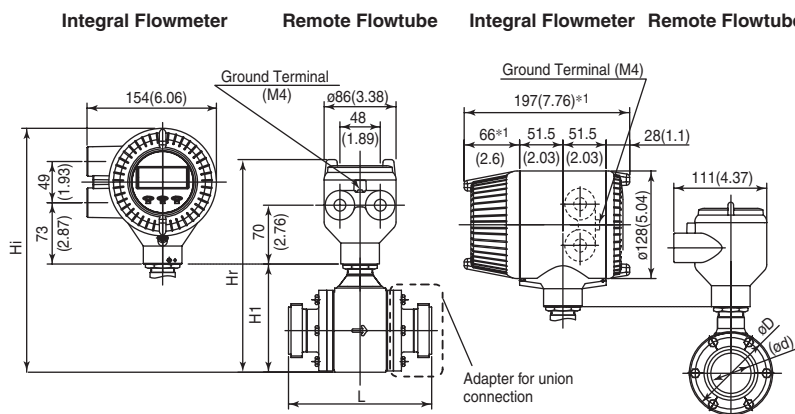


* No infra-red switches are furnished for Fieldbus communication type.

| Model | Process Connection | | | JKB / JDB / JSB | | | | | | | | |
|--------------------|------------------------------|----|----------------|-----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|
| | Size code | | | 015 | 025 | 032 | 040 | 050 | 065 | 080 | 100 | 125 |
| | Size | | | 15 (0.5) | 25 (1) | 32 (1.3) | 40 (1.5) | 50 (2) | 65 (2.6) | 80 (3) | 100 (4) | 125 (5) |
| | Lining code | | | A | A | A | A | A | A | A | A | A |
| Remote Flowtube | Face-to-face length | L | JKB | 166 (6.55) | 166 (6.55) | 166 (6.55) | 166 (6.55) | 176 (6.94) | 196 (7.73) | 216 (8.52) | 246 (9.70) | — |
| | | | JDB | 166 (6.55) | 166 (6.55) | 166 (6.55) | 166 (6.55) | 176 (6.94) | 196 (7.73) | 236 (9.31) | 266 (10.49) | 326 (12.85) |
| | | | JSB | — | 166 (6.55) | 166 (6.55) | 166 (6.55) | 176 (6.94) | 196 (7.73) | 216 (8.52) | 276 (10.88) | — |
| | Outside dia. | ØD | 73 (2.87) | 73 (2.87) | 73 (2.87) | 86 (3.39) | 99 (3.90) | 117 (4.61) | 129 (5.08) | 155 (6.10) | 183 (7.20) | |
| Integral Flowmeter | Inside dia. | ød | JKB | 15.2 (0.60) | 22.6 (0.89) | 31.3 (1.23) | 35.6 (1.40) | 48.6 (1.91) | 60.3 (2.37) | 72.9 (2.87) | 97.6 (3.84) | — |
| | | | JDB | 16 (0.63) | 26 (1.02) | 32 (1.26) | 38 (1.50) | 50 (1.97) | 66 (2.60) | 81 (3.19) | 100 (3.94) | 125 (4.92) |
| | | | JSB | — | 22.5 (0.89) | 29.6 (1.17) | 35.5 (1.40) | 48.5 (1.91) | 60.5 (2.38) | 72.9 (2.87) | 97.6 (3.84) | — |
| | Height | H1 | 98 (3.86) | 98 (3.86) | 98 (3.86) | 111 (4.37) | 129 (5.08) | 147 (5.79) | 157 (6.18) | 183 (7.20) | 212 (8.35) | |
| Remote Flowtube | Max. Height | Hr | 222 (8.74) | 222 (8.74) | 222 (8.74) | 235 (9.25) | 253 (9.96) | 271 (10.67) | 281 (11.06) | 307 (12.09) | 336 (13.23) | |
| | Weight kg (lb) ^{*2} | | 2.6 (5.7) | 2.6 (5.7) | 2.7 (6.0) | 3 (6.6) | 3.8 (8.4) | 4.9 (10.8) | 5.9 (13.0) | 8.2 (18.1) | 12 (28.7) | |
| Integral Flowmeter | Max. Height | Hi | 260 (10.24) | 260 (10.24) | 260 (10.24) | 273 (10.73) | 291 (11.44) | 309 (12.17) | 319 (12.54) | 345 (13.56) | 374 (14.70) | |
| | Weight kg (lb) | | 4.3 (9.5) | 4.3 (9.5) | 4.4 (9.7) | 4.7 (10.4) | 5.5 (12.1) | 6.6 (14.6) | 7.6 (16.8) | 9.9 (21.8) | 14.7 (32.4) | |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

*2: When option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg (20.9lb) to the weight in the table.

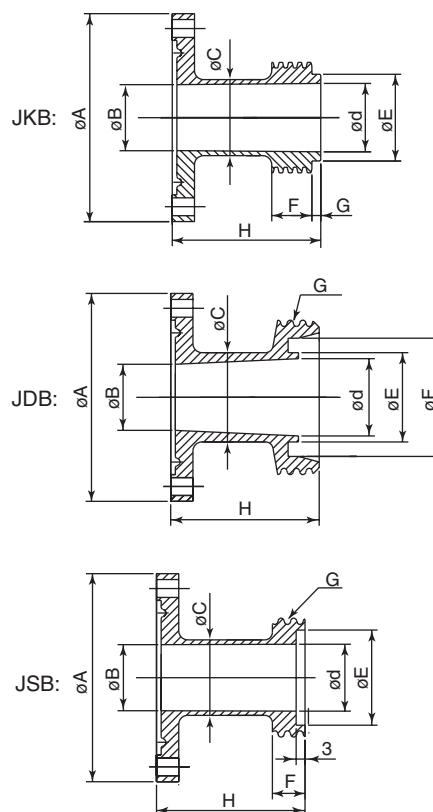


Adapters for union connection

| Process Connection | Nominal Size | JKB (ISO2853 Union) | | | | | | | | JDB (DIN 11851 Union) | | | | | | | | JSB (SMS1145 Union) | | | | | | | |
|-----------------------|-----------------|---------------------|--------|--------|--------|--------|--------|--------|--------|-----------------------|--------|--------|--------|--------|--------|--------|--------|---------------------|--------|--------|--------|--------|--------|--------|--|
| | | 15 | 25 | 32 | 40 | 50 | 65 | 80 | 100 | 15 | 25 | 32 | 40 | 50 | 65 | 80 | 125 | 25 | 32 | 40 | 50 | 65 | 80 | 100 | |
| øA | 70 | 70 | 70 | 83 | 96 | 114 | 126 | 152 | 70 | 70 | 70 | 83 | 96 | 114 | 126 | 152 | 180 | 70 | 70 | 83 | 96 | 114 | 126 | 152 | |
| | (2.76) | (2.76) | (2.76) | (3.27) | (3.78) | (4.49) | (4.96) | (5.98) | (2.76) | (2.76) | (2.76) | (3.27) | (3.78) | (4.49) | (4.96) | (5.98) | (7.09) | (2.76) | (2.76) | (3.27) | (3.78) | (4.49) | (4.96) | (5.98) | |
| øB | 16 | 22.2 | 29.4 | 34.6 | 47.6 | 59.5 | 72.3 | 97 | 16 | 22.2 | 29.4 | 34.6 | 47.6 | 59.5 | 72.3 | 97 | 123 | 22.2 | 29.4 | 34.6 | 47.6 | 59.5 | 72.3 | 97 | |
| | (0.63) | (0.87) | (1.16) | (1.36) | (1.87) | (2.34) | (2.85) | (3.82) | (0.63) | (0.87) | (1.16) | (1.36) | (1.87) | (2.34) | (2.85) | (3.82) | (4.84) | (0.87) | (1.16) | (1.36) | (1.87) | (2.34) | (2.85) | (3.82) | |
| øC | 18 | 25.6 | 34.3 | 38.6 | 51.6 | 64.1 | 76.7 | 102.5 | 20 | 30 | 36 | 42 | 54 | 70 | 85 | 104 | 129 | 25.4 | 32 | 38.1 | 51 | 63.5 | 76.2 | 102.5 | |
| | (0.71) | (1.01) | (1.35) | (1.52) | (2.03) | (2.52) | (3.02) | (4.04) | (0.79) | (1.18) | (1.42) | (1.65) | (2.13) | (2.76) | (3.35) | (4.09) | (5.08) | (1.00) | (1.26) | (1.51) | (2.01) | (2.56) | (3.00) | (4.04) | |
| ød | 15.2 | 20.6 | 26.7 | 30.2 | 38.6 | 47.6 | 59.5 | 72.3 | 15.2 | 20.6 | 26.7 | 30.2 | 38.6 | 47.6 | 59.5 | 72.3 | 85 | 20.6 | 26.7 | 30.2 | 38.6 | 47.6 | 59.5 | 72.3 | |
| | (0.60) | (0.89) | (1.23) | (1.40) | (1.91) | (2.37) | (2.87) | (3.84) | (0.63) | (1.02) | (1.26) | (1.50) | (1.97) | (2.40) | (3.19) | (3.94) | (4.92) | (0.89) | (1.23) | (1.40) | (1.91) | (2.37) | (2.87) | (3.84) | |
| øE | 21.2 | 29.2 | 38.2 | 42.7 | 56.2 | 69.9 | 82.6 | 108.7 | 18 | 30 | 36 | 42 | 54 | 71 | 85 | 104 | 130 | 32 | 40 | 48 | 61 | 73.5 | 86 | 110 | |
| | (0.83) | (1.15) | (1.50) | (1.68) | (2.21) | (2.75) | (3.25) | (4.28) | (0.71) | (1.18) | (1.42) | (1.65) | (2.13) | (2.80) | (3.35) | (4.09) | (5.12) | (1.26) | (1.57) | (1.89) | (2.40) | (2.89) | (3.39) | (4.72) | |
| øF | 13.5 | 13.5 | 13.5 | 13.5 | 13.5 | 13.5 | 13.5 | 25.8 | 39.8 | 45.8 | 51.8 | 63.8 | 80 | 94.8 | 113.8 | 141.8 | 11 | 13 | 15 | 15 | 19 | 19 | 30 | 47.2 | |
| | (0.53) | (0.53) | (0.53) | (0.53) | (0.53) | (0.53) | (0.53) | (1.02) | (1.57) | (1.80) | (2.04) | (2.51) | (3.18) | (3.73) | (4.48) | (5.58) | (0.43) | (0.51) | (0.59) | (0.59) | (0.75) | (0.75) | (1.18) | (1.81) | |
| G | 3 | 3 | 3 | 3 | 3 | 3 | 3 | RD34 | RD52 | RD58 | RD65 | RD78 | RD85 | RD110 | RD130 | RD160 | RD48 | RD48 | RD50 | RD70 | RD75 | RD98 | RD138 | RD138 | |
| | (0.12) | (0.12) | (0.12) | (0.12) | (0.12) | (0.12) | (0.12) | x1/8" | x1/8" | x1/8" | x1/8" | x1/8" | x1/8" | x1/4" | x1/4" | x1/4" | x1/8" | x1/8" | x1/8" | x1/8" | x1/8" | x1/8" | x1/8" | x1/8" | |
| H | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 60 | 65 | 50 | 50 | 50 | 50 | 50 | 50 | 65 | 65 | |
| | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (2.36) | (2.36) | (2.56) | (1.97) | (1.97) | (1.97) | (1.97) | (1.97) | (2.36) | (2.36) | |
| Parts No. | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | F9811 | |
| | LA | LB | LC | LD | LE | LF | LG | LH | LI | LK | LL | LM | LN | LO | LP | LQ | LR | LS | LT | LU | LV | LW | LX | LY | |

F35.EPS

● AXF Standard, AXF015-AXF125, Sanitary for Butt Weld, PFA Lining


Unit : mm (approx. inch)

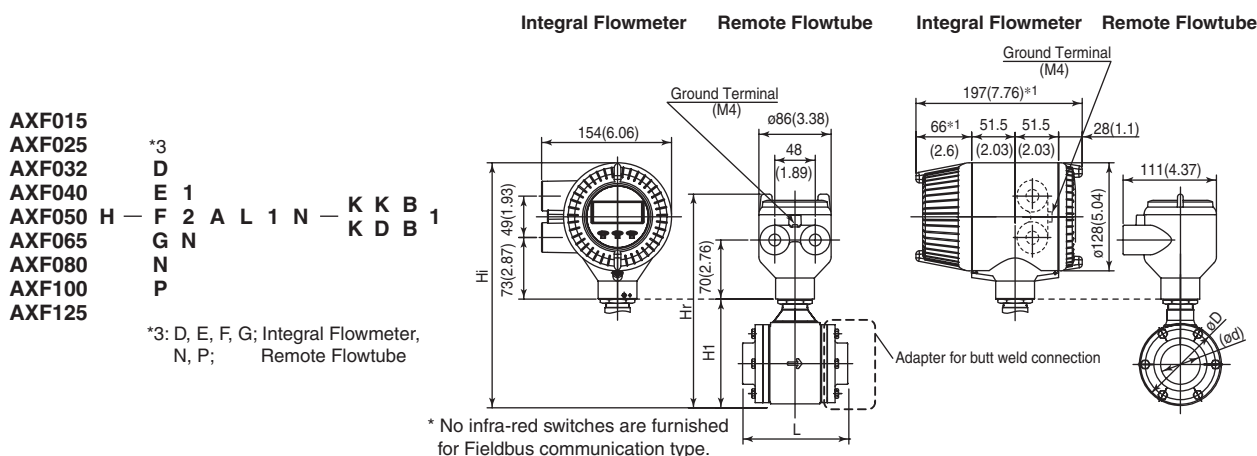

| Model | Process Connection | | KKB / KDB | | | | | | | | | |
|--------------------|------------------------------|----|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|-----------------|
| | Size code | | 015 | 025 | 032 | 040 | 050 | 065 | 080 | 100 | 125 | |
| | Size | | 15 (0.5) | 25 (1) | 32 (1.3) | 40 (1.5) | 50 (2) | 65 (2.6) | 80 (3) | 100 (4) | 125 (5) | |
| | Lining code | | A | A | A | A | A | A | A | A | A | |
| Remote Flowtube | Face-to-face length | L | 126 (4.98) | 126 (4.98) | 126 (4.98) | 126 (4.98) | 136 (5.37) | 156 (6.16) | 176 (6.94) | 206 (8.13) | 276 (10.88) | |
| | Outside dia. | øD | 73 (2.87) | 73 (2.87) | 73 (2.87) | 86 (3.39) | 99 (3.90) | 117 (4.61) | 129 (5.08) | 155 (6.10) | 183 (7.20) | |
| | Inner dia. | ød | KKB | 15.2 (0.60) | 22.6 (0.89) | 31.3 (1.23) | 35.6 (1.40) | 48.6 (1.91) | 60.3 (2.37) | 72.9 (2.87) | 97.6 (3.84) | 135.7 (5.34) |
| | | | KDB | 16 (0.63) | 26 (1.02) | 32 (1.26) | 38 (1.50) | 50 (1.97) | 66 (2.60) | 81 (3.19) | 100 (3.94) | 125 (4.92) |
| Integral Flowmeter | Height | H1 | 98 (3.86) | 98 (3.86) | 98 (3.86) | 111 (4.37) | 129 (5.08) | 147 (5.79) | 157 (6.18) | 183 (7.20) | 212 (8.35) | |
| Remote Flowtube | Max. Height | Hr | 222 (8.74) | 222 (8.74) | 222 (8.74) | 235 (9.25) | 253 (9.96) | 271 (10.67) | 281 (11.06) | 307 (12.09) | 336 (13.23) | |
| | Weight kg (lb) ^{*2} | | 2.6 (5.7) | 2.3 (5.1) | 2.5 (5.5) | 2.8 (6.2) | 3.4 (7.5) | 4.5 (9.9) | 5.3 (11.7) | 7.1 (15.7) | 11 (24.3) | |
| Integral Flowmeter | Max. Height | Hi | 260 (10.24) | 260 (10.24) | 260 (10.24) | 273 (10.73) | 291 (11.44) | 309 (12.17) | 319 (12.54) | 345 (13.56) | 374 (14.70) | |
| | Weight kg (lb) | | 4.3 (9.5) | 4 (8.8) | 4.2 (9.3) | 4.5 (9.9) | 5.1 (11.2) | 6.2 (13.7) | 7 (15.4) | 8.8 (19.4) | 12.7 (28.0) | |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

*2: When option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg (20.9lb) to the weight in the table.

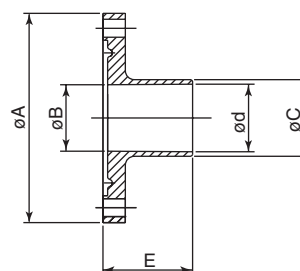


Adapter for butt weld connection

| Process Connection | KKB (ISO2037 Butt Weld) | | | | | | | | | | KDB (DIN 1185 Butt Weld) | | | | | | | | | |
|--------------------|-------------------------|----------------|----------------|----------------|----------------|----------------|----------------|-----------------|-----------------|--|--------------------------|----------------|----------------|----------------|----------------|----------------|----------------|---------------|---------------|--|
| Nominal Size | 15 | 25 | 32 | 40 | 50 | 65 | 80 | 100 | 125 | | 15 | 25 | 32 | 40 | 50 | 65 | 80 | 100 | 125 | |
| øA | 70 (2.76) | 70 (2.76) | 70 (2.76) | 83 (3.27) | 96 (3.78) | 114 (4.49) | 126 (4.96) | 152 (5.98) | 180 (7.09) | | 70 (2.76) | 70 (2.76) | 70 (2.76) | 83 (3.27) | 96 (3.78) | 114 (4.49) | 126 (4.96) | 152 (5.98) | 180 (7.09) | |
| øB | 16 (0.63) | 22.2 (0.87) | 29.4 (1.16) | 34.6 (1.36) | 47.6 (1.87) | 59.5 (2.34) | 72.3 (2.85) | 97 (3.82) | 123 (4.84) | | 16 (0.63) | 22.2 (0.87) | 29.4 (1.16) | 34.6 (1.36) | 47.6 (1.87) | 59.5 (2.34) | 72.3 (2.85) | 97 (3.82) | 123 (4.84) | |
| øC | 18 (0.71) | 25.6 (1.01) | 34.3 (1.35) | 38.6 (1.52) | 51.6 (2.03) | 64.1 (2.52) | 76.7 (3.02) | 102.5 (4.04) | 141.2 (5.56) | | 20 (0.79) | 30 (1.18) | 36 (1.42) | 42 (1.65) | 54 (2.13) | 70 (2.76) | 85 (3.35) | 104 (4.09) | 129 (5.08) | |
| ød | 15.2 (0.60) | 22.6 (0.89) | 31.3 (1.23) | 35.6 (1.40) | 48.6 (1.91) | 60.3 (2.37) | 72.9 (2.87) | 97.6 (3.84) | 135.7 (5.34) | | 16 (0.63) | 26 (1.02) | 32 (1.26) | 38 (1.50) | 50 (1.97) | 66 (2.60) | 81 (3.19) | 100 (3.94) | 125 (4.92) | |
| E | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 40 (1.57) | | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 30 (1.18) | 40 (1.57) | |
| Parts No. | F9811 NN | F9811 NP | F9811 NQ | F9811 NR | F9811 NS | F9811 NT | F9811 NU | F9811 NV | F9811 NW | | F9811 ND | F9811 NE | F9811 NF | F9811 NG | F9811 NH | F9811 NJ | F9811 NK | F9811 NL | F9811 NM | |

F36.EPS

Replacement model for Earlier ADMAG or ADMAG AE, AXF002-AXF015, Wafer Type, PFA Lining

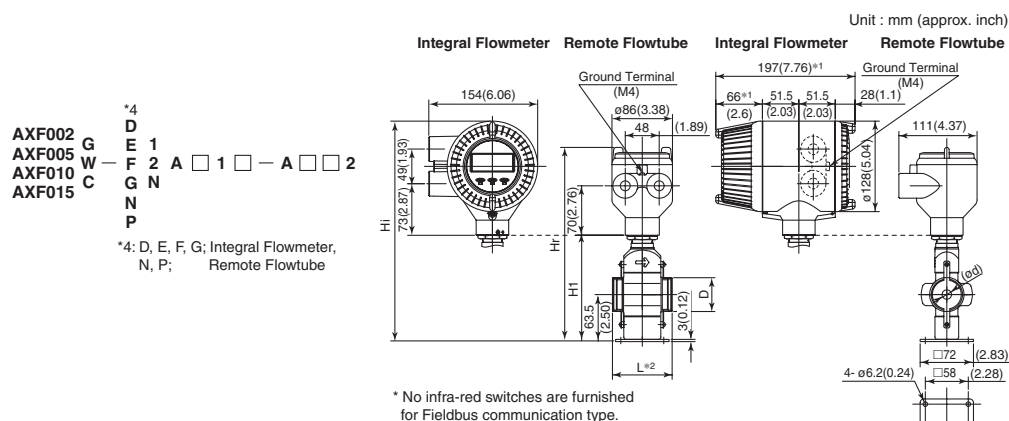

| Model | Size code | | 002 | 005 | 010 | 015 |
|--------------------|----------------------------------|-----------------|------------|--------|---------|---------|
| | Size | | 2.5(0.1) | 5(0.2) | 10(0.4) | 15(0.5) |
| | Lining code | | A | A | A | A |
| Remote Flowtube | Face-to-face length | L ^{*2} | 85(3.35) | | | |
| | Outside dia. | D | 44(1.73) | | | |
| Integral Flowmeter | Inner diameter of Grounding ring | ød | 15(0.59) | | | |
| | Height | H1 | 144(5.67) | | | |
| Remote Flowtube | Max. Height | Hr | 265(10.43) | | | |
| | Weight kg (lb) ^{*3} | | 2.4(5.3) | | | |
| Integral Flowmeter | Max. Height | Hi | 306(12.03) | | | |
| | Weight kg (lb) | | 4.1(9.0) | | | |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.


*2: Depending on the selection of grounding ring code and optional code, add the following value to L (face-to-face length).

| Grounding Ring Code | | S, L, H, V | P, T | N |
|---------------------|------------------------------|------------|-----------|----------|
| Option Code | None | +0 | +22(0.87) | -6(0.24) |
| | GA, GC, GD (Special Gaskets) | +2(0.08) | +24(0.94) | — |

*3: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg(20.9lb) to the weight in the table.

F37.EPS

Replacement model for Earlier ADMAG or ADMAG AE, AXF025-AXF100, Wafer Type, PFA /Polyurethane Rubber Lining

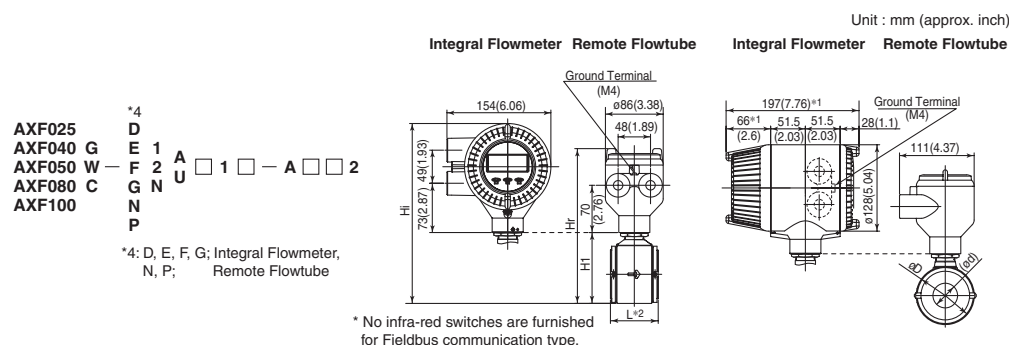

| Model | Size code | | 025 | 040 | 050 | 080 | 100 |
|--------------------|----------------------------------|-----------------|------------|------------|------------|------------|------------|
| | Size | | 25(1) | 40(1.5) | 50(2) | 80(3) | 100(4) |
| | Lining code | | A,U | A,U | A,U | A,U | A,U |
| Remote Flowtube | Face-to-face length | L ^{*2} | 93(3.66) | 106(4.17) | 120(4.72) | 160(6.30) | 180(7.09) |
| | Outside dia. | øD | 67.5(2.66) | 86(3.39) | 99(3.90) | 129(5.08) | 155(6.10) |
| Integral Flowmeter | Inner diameter of Grounding ring | ød | 27(1.06) | 40(1.57) | 52(2.05) | 81(3.19) | 98(3.86) |
| | Height | H1 | 92(3.62) | 111(4.37) | 129(5.08) | 157(6.18) | 183(7.20) |
| Remote Flowtube | Max. Height | Hr | 216(8.50) | 235(9.25) | 253(9.96) | 281(11.06) | 307(12.09) |
| | Weight kg (lb) ^{*3} | | 3.1(6.7) | 3.5(7.7) | 4.2(9.3) | 6.4(14.1) | 8.0(17.6) |
| Integral Flowmeter | Max. Height | Hi | 254(9.98) | 273(10.73) | 291(11.44) | 319(12.54) | 345(13.56) |
| | Weight kg (lb) | | 4.8(10.5) | 5.2(11.4) | 5.9(13.1) | 8.1(17.9) | 9.7(21.3) |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.

*2: Depending on the selection of grounding ring code and optional


| Grounding Ring Code | | S, L, H, V | P, T | N |
|---------------------|------------------------------|------------|-----------|----------|
| Option Code | None | +0 | +22(0.87) | -6(0.24) |
| | GA, GC, GD (Special Gaskets) | +2(0.08) | +24(0.94) | — |

*3: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg(20.9lb) to the weight in the table.

F38.EPS

● Replacement model for Earlier ADMAG or ADMAG AE, AXF150, AXF200, Wafer Type, PFA /Polyurethane Rubber Lining

Unit : mm (approx. inch)

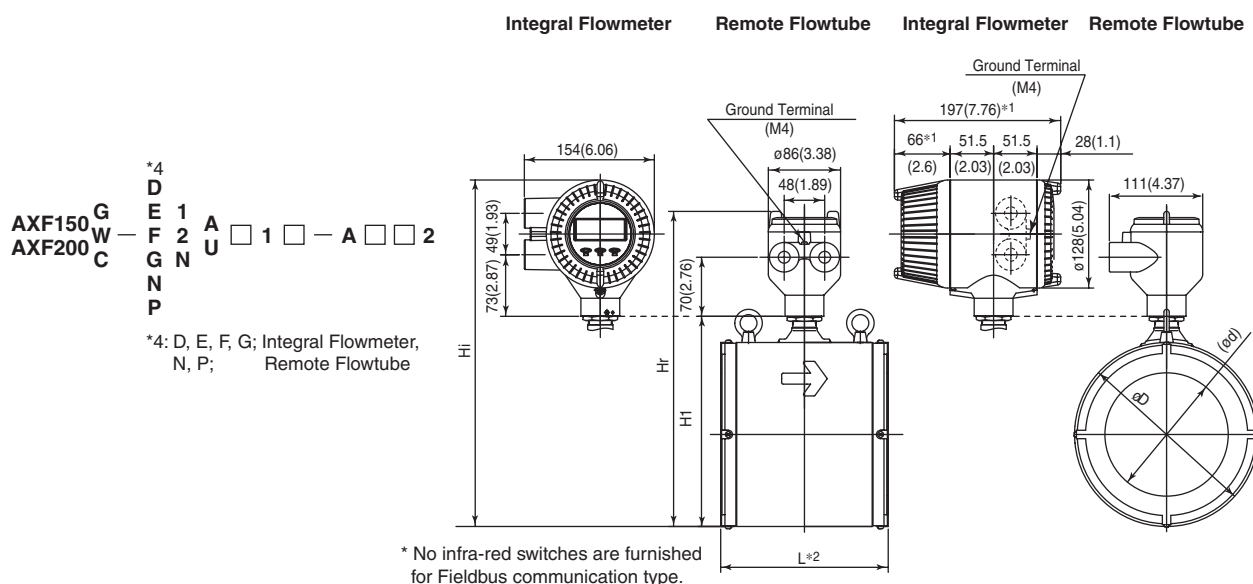

| Model | Size code | | 150 | 200 |
|--------------------|----------------------------------|------|-------------|-------------|
| | Size | | 150(6) | 200(8) |
| | Lining code | | A,U | A,U |
| Remote flowtube | Face-to-face length | L *2 | 230(9.06) | 300(11.81) |
| | Outside dia. | øD | 202(7.95) | 252(9.92) |
| Integral flowmeter | Inner diameter of Grounding ring | ød | 140.7(5.54) | 188.9(7.44) |
| | Height | H1 | 243(9.57) | 293(11.54) |
| Remote flowtube | Max. Height | Hr | 367(14.45) | 417(16.42) |
| | Weight kg (lb)*3 | | 17.9(39.5) | 26.8(59.1) |
| Integral flowmeter | Max. Height | Hi | 405(15.93) | 455(17.89) |
| | Weight kg (lb) | | 19.6(43.2) | 28.5(62.8) |

*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.

In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.

*2: Depending on the selection of grounding ring code and optional code, add the following value to L (face-to-face length).

| Grounding Ring Code | | S, L, H, V | P, T | N |
|---------------------|------------------------------|------------|-----------|----------|
| Option Code | None | +0 | +28(1.1) | -6(0.24) |
| | GA, GC, GD (Special Gaskets) | +2(0.08) | +30(1.18) | — |

*3: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg(20.9lb) to the weight in the table.

F39.EPS

*4: D, E, F, G; Integral Flowmeter,
N, P; Remote Flowtube

Unit : mm (approx. inch)



*1: When indicator code N is selected, subtract 12 mm (0.47 inch) from the value in the figure.
In case of explosion proof type with indicator, add 5 mm (0.2 inch) to it.

*2: Depending on the selection of grounding ring code and optional code, add the following value to "L" (face-to-face length) and "t" (thickness of flange).

| Nominal Size: 250 mm | | | | |
|-----------------------|------------|----|----------|----------|
| | L | t | L | t |
| Grounding Ring Code | S, L, H, V | | N | |
| Option Code is "None" | +0 | +0 | -6(0.24) | -3(0.12) |



6-49

IM 01E20D01-01E

● AXF Standard, AXF500-AXF10L, JIS/ANSI/DIN Flange Type, Polyurethane Rubber Lining

AXF500
AXF600
AXF700 G — NNUL 1S — CJ1
AXF800 W — CG1 1
AXF900 — CA1
AXF10L — CD1

Unit : mm (approx. inch)

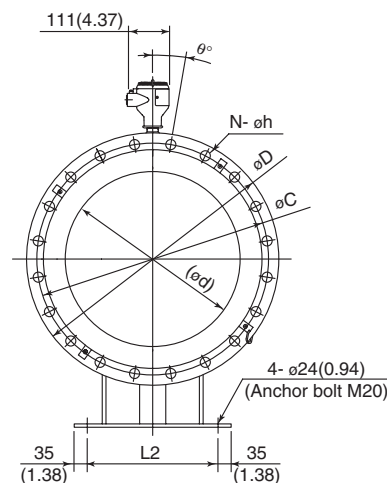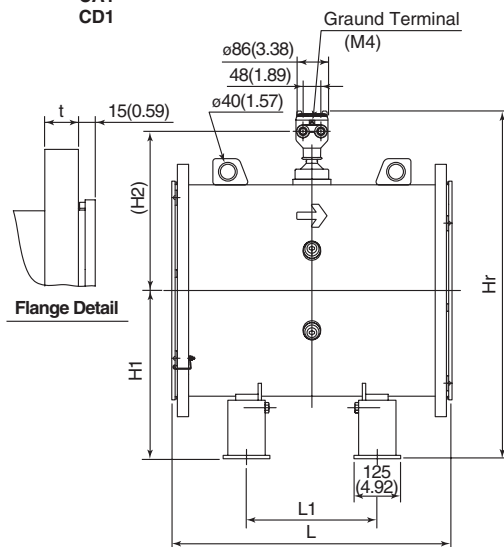

| Model | Process Connection | | CJ1(JIS10K) | | | | | | CG1(JIS F12) | | | | | | CA1(ANSI Class 150) | | CD1(DIN PN10) | | | | | |
|-----------------|----------------------------------|----|----------------|-----------------|-----------------|-----------------|-----------------|------------------|----------------|-----------------|-----------------|-----------------|-----------------|-----------------|---------------------|------------------|----------------|-----------------|-----------------|-----------------|------------------|------------------|
| | Size code | | 500 | 600 | 700 | 800 | 900 | 10L | 500 | 600 | 700 | 800 | 900 | 10L | 500 | 600 | 500 | 600 | 700 | 800 | 900 | 10L |
| | Size | | (20) | (24) | (28) | (32) | (36) | (40) | (20) | (24) | (28) | (32) | (36) | (40) | (20) | (24) | (20) | (24) | (28) | (32) | (36) | (40) |
| Remote Flowtube | Lining code | | U | U | U | U | U | U | U | U | U | U | U | U | U | U | U | U | U | U | U | U |
| | Face-to-face length | L | 750 (29.53) | 800 (31.50) | 900 (35.43) | 1050 (41.34) | 1200 (47.24) | 1300 (51.18) | 750 (29.53) | 800 (31.50) | 900 (35.43) | 1050 (41.34) | 1200 (47.24) | 1300 (51.18) | 750 (29.53) | 800 (31.50) | 750 (29.53) | 800 (31.50) | 900 (35.43) | 1050 (41.34) | 1200 (47.24) | 1300 (51.18) |
| | Support interval | L1 | 350 (13.78) | 400 (15.75) | 450 (17.72) | 550 (21.65) | 700 (27.56) | 800 (31.50) | 350 (13.78) | 400 (15.75) | 450 (17.72) | 550 (21.65) | 700 (27.56) | 800 (31.50) | 350 (13.78) | 400 (15.75) | 350 (13.78) | 400 (15.75) | 450 (17.72) | 550 (21.65) | 700 (27.56) | 800 (31.50) |
| | Mounting bolt interval | L2 | 350 (13.78) | 400 (15.75) | 500 (19.69) | 550 (21.65) | 650 (25.59) | 700 (27.56) | 350 (13.78) | 400 (15.75) | 500 (19.69) | 550 (21.65) | 650 (25.59) | 700 (27.56) | 350 (13.78) | 400 (15.75) | 350 (13.78) | 400 (15.75) | 500 (19.69) | 550 (21.65) | 650 (25.59) | 700 (27.56) |
| | Outside dia. | øD | 675 (26.57) | 795 (31.30) | 905 (35.63) | 1020 (40.16) | 1120 (44.09) | 1235 (48.62) | 706 (27.80) | 810 (31.89) | 928 (36.54) | 1034 (40.71) | 1156 (45.51) | 1262 (49.69) | 698.5 (27.50) | 812.8 (32.00) | 670 (26.38) | 780 (30.71) | 895 (35.24) | 1015 (39.96) | 1115 (43.90) | 1230 (48.43) |
| | Thickness | t | 30 (1.18) | 32 (1.26) | 34 (1.34) | 36 (1.42) | 38 (1.50) | 40 (1.57) | 30 (1.18) | 33 (1.30) | 35 (1.38) | 37 (1.46) | 39 (1.54) | 41 (1.61) | 42.9 (1.69) | 47.7 (1.88) | 28 (1.10) | 28 (1.10) | 30 (1.18) | 32 (1.26) | 34 (1.34) | 34 (1.34) |
| | Inner diameter of Grounding ring | ød | 468 (18.43) | 563 (22.17) | 665 (26.18) | 765 (30.12) | 855 (33.66) | 942 (37.09) | 485 (19.09) | 589 (23.19) | 689 (27.13) | 788 (31.02) | 888 (34.96) | 990 (38.98) | 468 (18.43) | 563 (22.17) | 468 (18.43) | 563 (22.17) | 665 (26.18) | 765 (30.12) | 855 (33.66) | 942 (37.09) |
| | Pitch circle dia. | øC | 620 (24.41) | 730 (28.74) | 840 (33.07) | 950 (37.40) | 1050 (41.34) | 1160 (45.67) | 639 (25.16) | 743 (29.25) | 854 (33.62) | 960 (37.80) | 1073 (42.24) | 1179 (46.42) | 635 (25.00) | 749.3 (29.50) | 620 (24.41) | 725 (28.54) | 840 (33.07) | 950 (37.40) | 1050 (41.34) | 1160 (45.67) |
| | Bolt hole interval | ø° | 9 | 7.5 | 7.5 | 6.4 | 6.4 | 6.4 | 15 | 11.25 | 11.25 | 9 | 9 | 7.5 | 9 | 9 | 9 | 9 | 7.5 | 7.5 | 6.4 | 6.4 |
| | Hole dia. | øh | 27 (1.06) | 33 (1.30) | 33 (1.30) | 33 (1.30) | 33 (1.30) | 39 (1.54) | 27 (1.06) | 33 (1.30) | 33 (1.30) | 33 (1.30) | 33 (1.30) | 33 (1.30) | 31.7 (1.25) | 35 (1.38) | 26 (1.02) | 30 (1.18) | 30 (1.18) | 33 (1.30) | 33 (1.30) | 36 (1.42) |
| | Number of holes | N | 20 | 24 | 24 | 28 | 28 | 28 | 12 | 16 | 16 | 20 | 20 | 24 | 20 | 20 | 20 | 20 | 24 | 24 | 28 | 28 |
| | Height | H1 | 450 (17.72) | 500 (19.69) | 550 (21.65) | 600 (23.62) | 650 (25.59) | 700 (27.56) | 450 (17.72) | 500 (19.69) | 550 (21.65) | 600 (23.62) | 650 (25.59) | 700 (27.56) | 450 (17.72) | 500 (19.69) | 450 (17.72) | 500 (19.69) | 550 (21.65) | 600 (23.62) | 650 (25.59) | 700 (27.56) |
| | Height | H2 | 426 (16.77) | 474 (18.66) | 529 (20.83) | 584 (22.99) | 633 (24.92) | 682 (26.85) | 435 (17.13) | 486 (19.13) | 536 (21.10) | 589 (23.19) | 645 (25.39) | 697 (27.44) | 426 (16.77) | 474 (18.66) | 426 (16.77) | 474 (18.66) | 529 (20.83) | 584 (22.99) | 633 (24.92) | 682 (26.85) |
| | Max. Height | Hr | 930 (36.61) | 1028 (40.47) | 1133 (44.61) | 1238 (48.74) | 1337 (52.64) | 1436 (56.54) | 939 (36.97) | 1040 (40.94) | 1140 (44.88) | 1243 (48.94) | 1349 (53.11) | 1451 (57.13) | 930 (36.61) | 1028 (40.47) | 930 (36.61) | 1028 (40.47) | 1133 (44.61) | 1238 (48.74) | 1337 (52.64) | 1436 (56.54) |
| | Weight kg (lb)*1 | | 260 (573.2) | 400 (881.8) | 510 (1124.4) | 680 (1499.1) | 870 (1918.0) | 1200 (2645.5) | 245 (540.1) | 300 (661.4) | 450 (992.1) | 620 (1366.9) | 770 (1697.6) | 980 (2160.5) | 450 (992.1) | 550 (1212.5) | 450 (992.1) | 550 (1212.5) | 680 (1499.1) | 870 (1918.0) | 1200 (2645.5) | 1660 (3661.4) |


*1: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached.
Add 9.5kg(20.9lb) to the weight in the table.

F48.EPS


● AXF Standard, AXF11L-AXF13L, JIS Flange Type, Polyurethane Rubber Lining

AXF11L
AXF12L^G — NNUL 1S — CG11
AXF13L^W

Unit : mm (approx. inch)

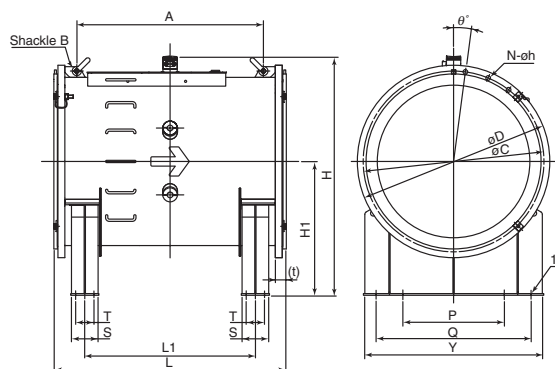

Flange Detail

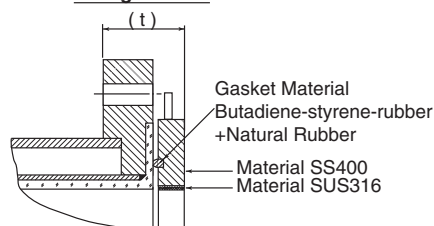

| Model | Process Connection | | CG1(JIS F12) | | | |
|--------------------|------------------------------|-----------|-----------------|---|---|---|
| | Size code | | 11L | 12L | 13L | |
| | Size | | 1100 (44) | 1200 (48) | 1300 (54) | |
| | Lining code | | U | U | U | |
| Remote Flowtube | Face-to-face length | | L | 1650 ⁰ ₋₁₀ (64.96) | 1800 ⁰ ₋₁₀ (70.87) | 2025 ⁰ ₋₁₀ (79.72) |
| | Shackle | Interval | A | 1325 (52.17) | 1470 (57.87) | 1640 (64.57) |
| | | Size | B | SB24 | SB24 | SB30 |
| | Support | Width | S | 200 (7.87) | 200 (7.87) | 200 (7.87) |
| | | Length | Y | 1280 (50.39) | 1380 (54.33) | 1540 (60.63) |
| | | Interval | L1 | 1211 (47.68) | 1261 (49.65) | 1366 (53.78) |
| | Mounting Bolt | Interval | P | 720 ±2 (28.35) | 780 ±2 (30.71) | 880 ±2 (34.65) |
| | | | Q | 1100 ±3 (43.31) | 1200 ±3 (47.24) | 1350 ±3 (53.15) |
| | | | T | 130 ±1 (5.12) | 130 ±1 (5.12) | 130 ±1 (5.12) |
| | | Hole dia. | ØR | 19 (0.75) | 19 (0.75) | 19 (0.75) |
| | Outside dia. | | ØD | 1366 (53.78) | 1470 (57.87) | 1642 (64.65) |
| | Thickness | | t ^{*1} | 78 (3.07) | 80 (3.15) | 82 (3.23) |
| | Pitch circle dia. | | ØC | 1283 (50.51) | 1387 (54.61) | 1552 (61.10) |
| | Bolt hole interval | | θ° | 7.5 | 6.4 | 6.4 |
| | Hole dia. | | øh | 33 (1.30) | 33 (1.30) | 39 (1.54) |
| | Number of holes | | N | 24 (0.94) | 28 (1.10) | 28 (1.10) |
| | Height | | H1 | 950 ⁺¹⁰ ₀ (37.40) | 1000 ⁺¹⁰ ₀ (39.37) | 1100 ⁺¹⁰ ₀ (43.31) |
| | Max. Height | | H | 1698 (66.85) | 1803 (70.98) | 1974 (77.72) |
| | Weight ka (lb) ^{*2} | | | 1650 (3637.6) | 1910 (4210.8) | 2420 (5335.2) |

*1: The value before the gasket is tightened.


*2: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg(20.9lb) to the weight in the table.

F45.EPS


● AXF Standard, AXF15L, JIS Flange Type, Polyurethane Rubber Lining

AXF15L^G
AXF15L^W — NNUL 1S — CG11

Unit : mm (approx. inch)

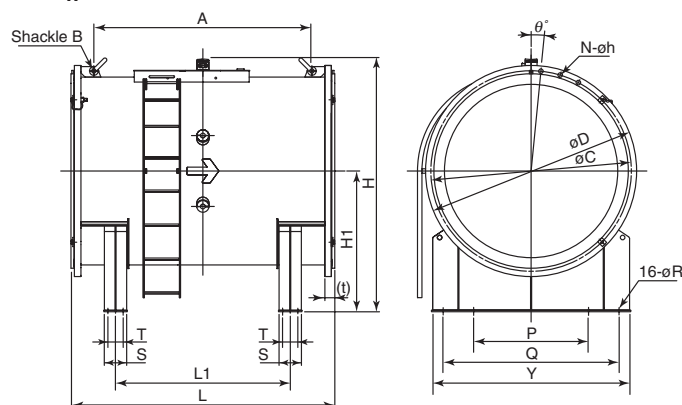

Flange Detail

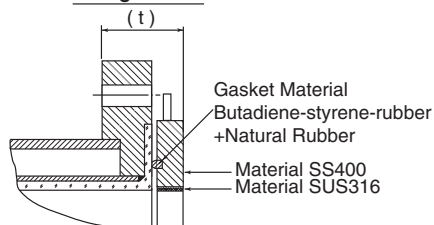

| Model | Process Connection | | CG1(JIS F12) | |
|------------------------------|---------------------|-----------|------------------|---|
| | Size code | | 15L | |
| | Size | | 1500 (60) | |
| | Lining code | | U | |
| Remote Flowtube | Face-to-face length | | L | 2250 ⁰ ₋₁₀ (88.58) |
| | Shackle | Interval | A | 1860 (73.23) |
| | | Size | B | SB30 |
| | Support | Width | S | 200 (7.87) |
| | | Length | Y | 1700 (66.93) |
| | | Interval | L1 | 1490 (58.66) |
| | Mounting Bolt | Interval | P | 980 ±2 (38.58) |
| | | | Q | 1500 ±3 (59.06) |
| | | | T | 130 ±1 (5.12) |
| | | Hole dia. | ØR | 19 (0.75) |
| | Outside dia. | | ØD | 1800 (70.87) |
| | Thickness | | t ^{*1} | 85 (3.35) |
| | Pitch circle dia. | | ØC | 1710 (67.32) |
| | Bolt hole interval | | θ° | 5.6 |
| | Hole dia. | | Øh | 39 (1.54) |
| | Number of holes | | N | 32 (1.26) |
| | Height | | H1 | 1200 ⁺¹⁶ ₀ (47.24) |
| Max. Height | | H | 2155 (84.84) | |
| Weight kg (lb) ^{*2} | | | 3150 (6944.6) | |

*1: The value before the gasket is tightened.


*2: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached. Add 9.5kg(20.9lb) to the weight in the table.

F46.EPS

● AXF Standard, AXF16L-AXF26L, JIS Flange Type, Polyurethane Rubber Lining

AXF16L
AXF18L
AXF20L G — NNUL 1S — CG11
AXF22L W
AXF24L
AXF26L

Unit : mm (approx. inch)

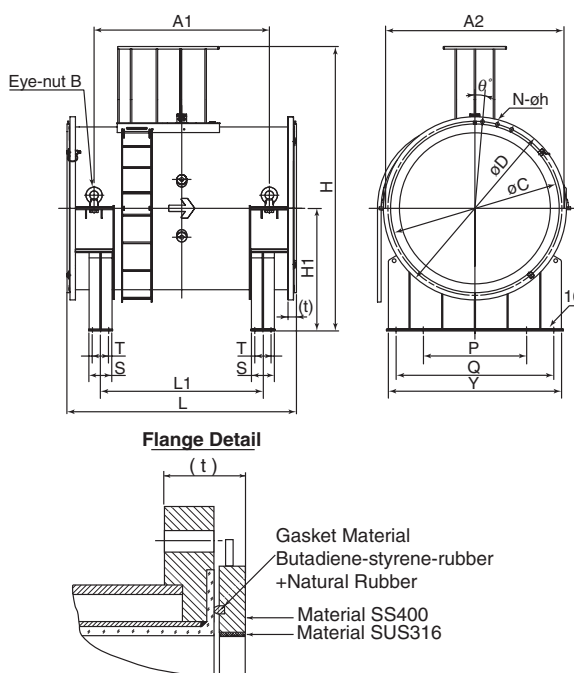

| Model | Process Connection | | CG1(JIS F12) | | | | | | |
|-----------------|---------------------|----------|---|---|--|--|--|--|--|
| | Size code | | 16L | 18L | 20L | 22L | 24L | 26L | |
| | Size | | 1600 (64) | 1800 (72) | 2000 (80) | 2200 (88) | 2400 (96) | 2600 (104) | |
| | Lining code | | U | U | U | U | U | U | |
| Eye-nut | Face-to-face length | | L | 2400 ⁰ ₋₁₀ (94.49) | 2610 ⁰ ₋₁₀ (102.76) | 2800 ⁰ ₋₁₀ (110.24) | 2970 ⁰ ₋₁₀ (116.93) | 3120 ⁰ ₋₁₀ (122.83) | 3300 ⁰ ₋₁₀ (129.92) |
| | Interval 1 | A1 | 1834 (72.20) | 2022 (79.61) | 2191 (86.26) | 2325 (91.54) | 2421 (95.31) | 2550 (100.39) | |
| | Interval 2 | A2 | 1872 (73.70) | 2078 (81.81) | 2300 (90.55) | 2520 (99.21) | 2724 (107.24) | 2946 (115.98) | |
| | Size | B | M48 | M48 | M48 | M48 | M64 | M64 | |
| Support | Width | S | 250 (9.84) | 250 (9.84) | 250 (9.84) | 300 (11.81) | 300 (11.81) | 300 (11.81) | |
| | Length | Y | 1850 (72.83) | 2000 (78.74) | 2220 (87.40) | 2420 (95.28) | 2620 (103.15) | 2820 (111.02) | |
| | Interval | L1 | 1698 (66.85) | 1864 (73.39) | 2010 (79.13) | 2172 (85.51) | 2218 (87.32) | 2300 (90.55) | |
| | Mounting Bolt | Interval | P | 1080±3 (42.52) | 1180±3 (46.46) | 1300±3 (51.18) | 1430±3 (56.30) | 1560±3 (61.42) | 1700±3 (66.93) |
| | | Q | 1650±3 (64.96) | 1800±3 (70.87) | 2000±3 (78.74) | 2200±3 (86.61) | 2400±3 (94.49) | 2600±3 (102.36) | |
| | | T | 170±1 (6.69) | 170±1 (6.69) | 170±1 (6.69) | 200±1 (7.87) | 200±1 (7.87) | 200±1 (7.87) | |
| Hole dia. | | ØR | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | 22 (0.87) | |
| Remote Flowtube | Outside dia. | ØD | 1915 (75.39) | 2115 (83.27) | 2325 (91.54) | 2550 (100.39) | 2760 (108.66) | 2960 (116.54) | |
| | Thickness | t*1 | 88 (3.46) | 90 (3.54) | 92 (3.62) | 95 (3.74) | 97 (3.82) | 101 (3.98) | |
| | Pitch circle dia. | ØC | 1820 (71.65) | 2020 (79.53) | 2230 (87.80) | 2440 (96.06) | 2650 (104.33) | 2850 (112.20) | |
| | Bolt hole interval | θ° | 5 | 4.1 | 3.75 | 3.5 | 3.2 | 3.2 | |
| | Hole dia. | ØH | 39 (1.54) | 39 (1.54) | 46 (1.81) | 46 (1.81) | 46 (1.81) | 52 (2.05) | |
| | Number of holes | N | 36 (1.42) | 44 (1.73) | 48 (1.89) | 52 (2.05) | 56 (2.20) | 56 (2.20) | |
| | Height | H1 | 1280 ⁺¹⁶ ₀ (50.39) | 1350 ⁺¹⁶ ₀ (53.15) | 1450 ⁺¹⁶ ₀ (57.09) | 1550 ⁺¹⁶ ₀ (61.02) | 1700 ⁺¹⁶ ₀ (66.93) | 1700 ⁺¹⁶ ₀ (66.93) | |
| | Max. Height | H | 2972 (117.01) | 3153 (124.13) | 3347 (131.77) | 3554 (139.92) | 3813 (150.12) | 3917 (154.21) | |
| | Weight kg (lb) *2 | | 3650 (8046.9) | 5270 (11618.3) | approx. (14330.0) | approx. (18518.8) | approx. (22046.2) | approx. (31967.0) | |


*1: The value before the gasket is tightened.

*2: When submersible type or option code DHC is selected, waterproof glands and a 30m long cable are attached.

Add 9.5kg(20.9lb) to the weight in the table.

F47.EPS

● Flameproof Packing Adapter for TIIS Flameproof Type (Optional code G12 or G11)

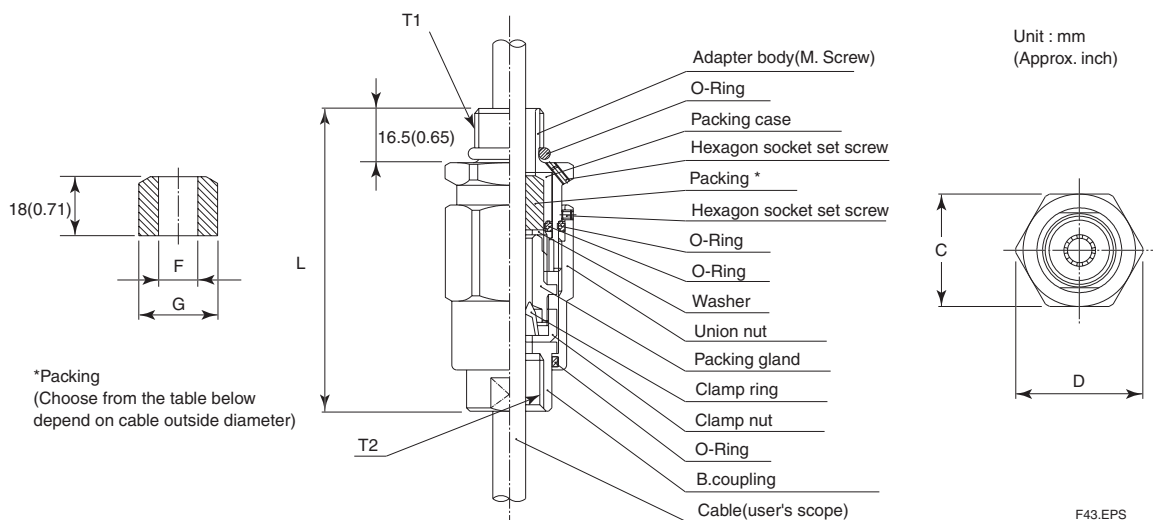

*Packing
(Choose from the table below
depend on cable outside diameter)

| Dimension | | | | | Cable outer diameter | Packing diameter | | Identification mark | Weight kg (lb) |
|-----------|-------|--------------|--------------|----------------|-------------------------------|------------------|--------|---------------------|----------------|
| T1 | T2 | C | D | L | | F | G | | |
| G 1/2 | G 1/2 | 35 (1.38) | 39 (1.54) | 94.5 (3.72) | ø8.0 to ø10.0 (0.31 to 0.39) | ø10.0(0.39) | ø20.0 | 16 8-10 | 0.26 |
| | | | | | ø10.0 to ø12.0 (0.39 to 0.47) | ø12.0(0.47) | (0.79) | 16 10-12 | (0.57) |

T31.EPS


● Unless otherwise specified, difference in the dimensions are refer to the following table.

General tolerance in the dimensional outline drawing. Unit : mm (approx.inch)

| Category of basic dimension | | Tolerance | Category of basic dimension | | Tolerance |
|-----------------------------|----------------|---------------|-----------------------------|----------------|---------------|
| Above | Equal or below | | Above | Equal or below | |
| | 3 (0.12) | ±0.7 (±0.03) | 500 (19.69) | 630 (24.80) | ±5.5 (±2.17) |
| 3 (0.12) | 6 (0.24) | ±0.9 (±0.04) | 630 (24.80) | 800 (31.50) | ±6.25 (±0.25) |
| 6 (0.24) | 10 (0.39) | ±1.1 (±0.04) | 800 (31.50) | 1000 (39.37) | ±7.0 (±0.28) |
| 10 (0.39) | 18 (0.71) | ±1.35 (±0.05) | 1000 (39.37) | 1250 (49.21) | ±8.25 (±0.32) |
| 18 (0.71) | 30 (1.18) | ±1.65 (±0.06) | 1250 (49.21) | 1600 (62.99) | ±9.75 (±0.38) |
| 30 (1.18) | 50 (1.97) | ±1.95 (±0.08) | 1600 (62.99) | 2000 (78.74) | ±11.5 (±0.45) |
| 50 (1.97) | 80 (3.15) | ±2.3 (±0.09) | 2000 (78.74) | 2500 (98.43) | ±14.0 (±0.55) |
| 80 (3.15) | 120 (4.72) | ±2.7 (±0.11) | 2500 (98.43) | 3150 (124.02) | ±16.5 (±0.65) |
| 120 (4.72) | 180 (7.09) | ±3.15 (±0.12) | | | |
| 180 (7.09) | 250 (9.84) | ±3.6 (±0.14) | | | |
| 250 (9.84) | 315 (12.40) | ±4.05 (±0.16) | | | |
| 315 (12.40) | 400 (15.75) | ±4.45 (±0.18) | | | |
| 400 (15.75) | 500 (19.69) | ±4.85 (±0.19) | | | |

Remarks: The numeric is based on criteria of tolerance class IT18 in JIS B 0401.

■ SIZING DATA (Measurable flow velocity is from 0 m/s.)

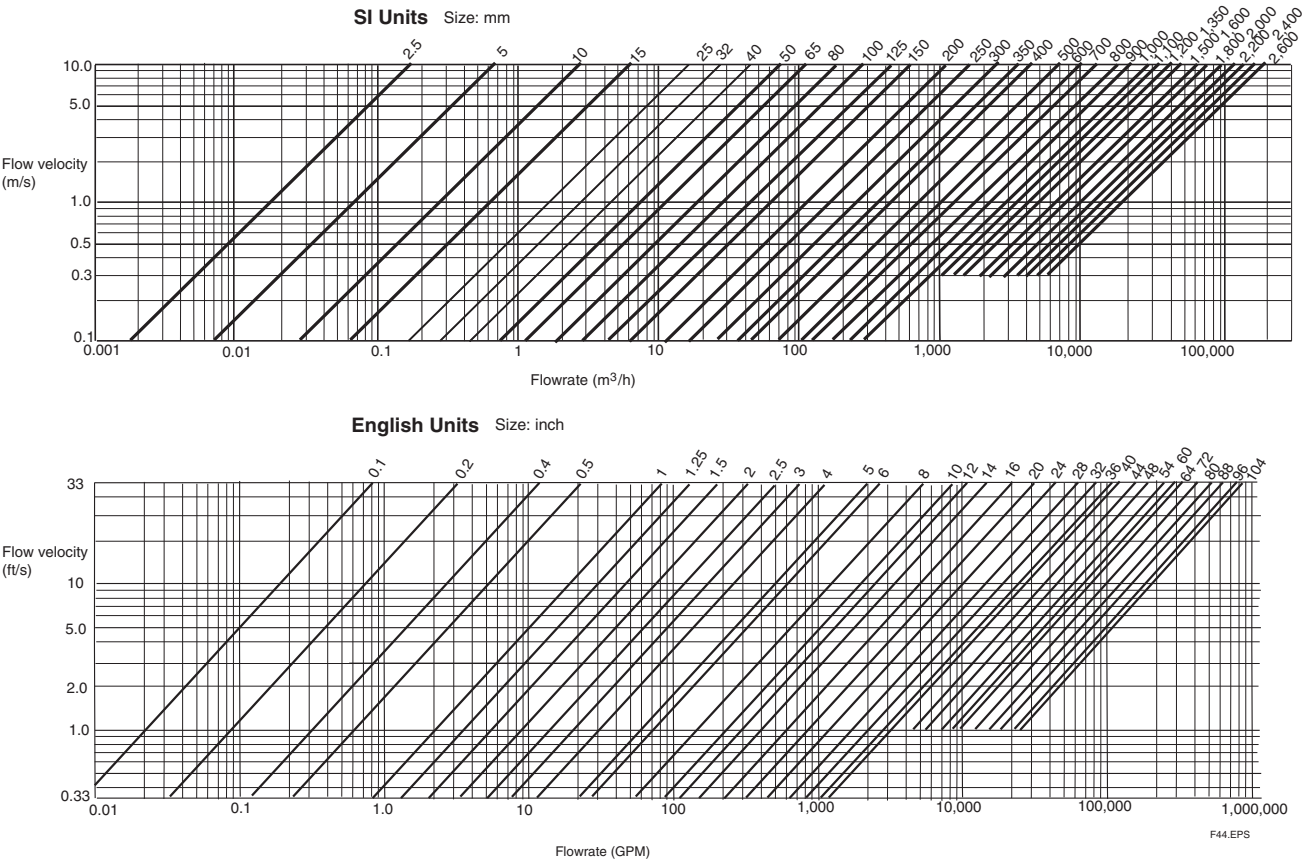

* Measurable flow velocity is from 0 m/s.

7. PED (PRESSURE EQUIPMENT DIRECTIVE)

This chapter describes further requirements and notices concerning the PED (Pressure Equipment Directive). The description in this chapter is prior to other description in this User's Manual.

(1) Technical Data

Module: H

Type of Equipment: Piping

Type of Fluid: Liquids and gas

Group of Fluid: 1 and 2

General-purpose Use / Submersible Type / Explosion Proof Type

| MODEL | DN (mm) (*1) | PS (MPa) (*1) | PS DN (MPa · mm) | CATEGORY(*2) |
|-------------|-----------------|------------------|---------------------|--------------------------------|
| AXF002G/C | 2.5 | 4 | 10 | Article 3, (*3) paragraph 3 |
| AXF005G/C | 5 | 4 | 20 | Article 3, (*3) paragraph 3 |
| AXF010G/C | 10 | 4 | 40 | Article 3, (*3) paragraph 3 |
| AXF015G/W/C | 15 | 4 | 60 | Article 3, (*3) paragraph 3 |
| AXF025G/W/C | 25 | 4 | 100 | Article 3, (*3) paragraph 3 |
| AXF032G/W/C | 32 | 4 | 128 | II |
| AXF040G/W/C | 40 | 4 | 160 | II |
| AXF050G/W/C | 50 | 4 | 200 | II |
| AXF065G/W/C | 65 | 2 | 130 | II |
| AXF080G/W/C | 80 | 2 | 160 | II |
| AXF100G/W/C | 100 | 2 | 200 | II |
| AXF125G/W/C | 125 | 2 | 250 | II |
| AXF150G/W/C | 150 | 2 | 300 | II |
| AXF200G/W/C | 200 | 2 | 400 | III |
| AXF250G/W/C | 250 | 2 | 500 | III |
| AXF300G/W/C | 300 | 2 | 600 | III |
| AXF350G/W/C | 350 | 1 | 350 | II |
| AXF400G/W/C | 400 | 1 | 400 | III |

T0701.EPS

Sanitary Type

| MODEL | DN (mm) (*1) | PS (MPa) (*1) | PS D (MPa · mm) | CATEGORY (*2) |
|---------|-----------------|------------------|--------------------|--------------------------------|
| AXF015H | 15 | 1 | 15 | Article 3, (*3) paragraph 3 |
| AXF025H | 25 | 1 | 25 | Article 3, (*3) paragraph 3 |
| AXF032H | 32 | 1 | 32 | I |
| AXF040H | 40 | 1 | 40 | I |
| AXF050H | 50 | 1 | 50 | I |
| AXF065H | 65 | 1 | 65 | I |
| AXF080H | 80 | 1 | 80 | I |
| AXF100H | 100 | 1 | 100 | I |
| AXF125H | 125 | 1 | 125 | II |

T0702.EPS

Note : The sizes of 500 to 2600 mm (20 to 104 in.) are not attached CE marking of PED.

*1: PS: Maximum allowable pressure for Flowtube

DN: Nominal size

*2: For details, see "Table 6 covered by ANNEX II of EC Directive on Pressure Equipment Directive 97/23/EC."

*3: AXF002G/C to AXF025G/W/C, AXF015H and AXF025H are outside the scope of CE marking of PED.

(2) Installation



WARNING

- Tighten the bolts of the piping joints according to the prescribed torque values.
- Take measures to protect the flowmeters from forces caused by vibration channeled through the piping.

(3) Operation



WARNING

- The instrument should be operated with the temperature and pressure of the fluid under normal operating conditions.
- The ambient temperature should be that of normal operating conditions.
- Take measures to prevent excessive pressure such as water hammer, etc. To avoid water hammer prevent the pressure from exceeding the PS (maximum allowable pressure) by setting the system's safety valves, etc. appropriately.
- Should external fire occur, take safety measures at the device itself or system-wide prevent it having an effect on the flowmeters.
- Avoid using fluids exceeding the corrosion proof limitations of the lining and electrodes.
- Take measures not to abrade the metal pipe, and avoid abrading the lining by using fluids such as slurry and sand are contained.

8. EXPLOSION PROTECTED TYPE INSTRUMENT

In this section, further requirements and differences for explosion proof type instrument are described.



WARNING

- Magnetic flowmeters with the model name AXF□□□C are products which have been certified as explosion proof type instruments. Strict limitations are applied to the structures, installation locations, external wiring work, maintenance and repairs, etc. of these instruments. Sufficient care must be taken, as any violation of the limitations may cause dangerous situations.

Be sure to read this chapter before handling the instruments.

For explosion proof type instrument, the description in this chapter is prior to other description in this user's manual.

For TIIS flameproof type instruments, be sure to read "INSTALLATION AND OPERATING PRECAUTIONS FOR TIIS FLAMEPROOF EQUIPMENT" at the end of this manual.



WARNING

The terminal box cover and display cover is locked by special screw. In case of opening the cover, please use the hexagonal wrench attached.

The covers of explosion proof type products are locked. Use the attached hexagonal wrench to open and close the cover. Before opening the cover, be sure to check that the power of flowmeter has been turned off. Once the cover is closed, be sure to re-lock the product.

Be sure to lock the cover with the special screw using the hexagonal wrench attached after tightening the cover.

8.1 ATEX



WARNING

Only trained persons use this instrument in industrial locations.

(1) Technical Data

*AXF002C – AXF400C

Applicable Standard:

EN 50014: 1997, EN 50018: 2000,

EN 50019: 2000, EN 50020: 2002,

EN 50028: 1987, EN 50281-1-1: 1998

Certificate: KEMA 03ATEX2435

(Integral Flowmeter)

ATEX Flameproof Type

Group: II

Category: 2G

EEx dme [ia] IIC T6...T3

Electrode Circuit Um: 250 Vac/dc

Maximum power supply voltage: 250 Vac/130 Vdc

Excitation Circuit: 140V max

Enclosure: IP66, IP67

Temperature Class:

| Temperature Class | Maximum Process Temperature | Minimum Process Temperature |
|-------------------|-----------------------------|-----------------------------|
| T6 | +70°C (+158°F) | –40°C (–40°F) |
| T5 | +85°C (+185°F) | –40°C (–40°F) |
| T4 | +120°C (+248°F) | –40°C (–40°F) |
| T3 | +130°C (+266°F) | –40°C (–40°F) |

T0801.EPS

Ambient Temp.: –40°C to +60°C (–40°F to +140°F)

ATEX Type of Protection "Dust"

Group: II

Category: 1D

Electrode Circuit Um: 250 Vac/dc

Maximum power supply voltage: 250 Vac/130 Vdc

Excitation Circuit: 140V max

Enclosure: IP66, IP67

Maximum surface temperature:

| Maximum Surface Temperature | Maximum Process Temperature |
|-----------------------------|-----------------------------|
| T75°C (+167°F) | +70°C (+158°F) |
| T85°C (+185°F) | +85°C (+185°F) |
| T100°C (+212°F) | +120°C (+248°F) |
| T110°C (+230°F) | +130°C (+266°F) |

T0802.EPS

Ambient Temp.: -40°C to +60°C (-40°F to +140°F)

(Remote Flowtube)

ATEX Flameproof Type

Group: II

Category: 2G

EEx dme [ia] IIC T6...T3

Electrode Circuit Um: 250 Vac/dc

Excitation Circuit: 170V max

Enclosure: IP66, IP67

Temperature Class:

| Temperature Class | Maximum Process Temperature | Minimum Process Temperature |
|-------------------|-----------------------------|-----------------------------|
| T6 | +70°C (+158°F) | -40°C (-40°F) |
| T5 | +85°C (+185°F) | -40°C (-40°F) |
| T4 | +120°C (+248°F) | -40°C (-40°F) |
| T3 | +150°C (+302°F) | -40°C (-40°F) |

T0803.EPS

Ambient Temp.: -40°C to +60°C (-40°F to +140°F)

ATEX Type of Protection “Dust”

Group: II

Category: 1D

Electrode Circuit Um: 250 Vac/dc

Excitation Circuit: 170V max

Enclosure: IP66, IP67

Maximum surface temperature:

| Maximum Surface Temperature | Maximum Process Temperature |
|-----------------------------|-----------------------------|
| T75°C (+167°F) | +70°C (+158°F) |
| T85°C (+185°F) | +85°C (+185°F) |
| T100°C (+212°F) | +120°C (+248°F) |
| T115°C (+239°F) | +150°C (+302°F) |

T0804.EPS


Ambient Temp.: -40°C to +60°C (-40°F to +140°F)

(2) Electrical Connection

The type of electrical connection is stamped near the electrical connection port according to the following codes.

(Integral Flowmeter)

| Screw Size | Marking |
|--------------------|---------|
| ISO M20x1.5 female | △ M |
| ANSI 1/2NPT female | △ A |



(Remote Flowtube)

| Screw Size | Marking |
|--------------------|---------|
| ISO M20x1.5 female | △ M |
| ANSI 1/2NPT female | △ A |



F0801.EPS

(3) Installation



WARNING

- All wiring shall comply with local installation requirements and local electrical code.
- In hazardous locations, the cable entry devices shall be of a certified ATEX flameproof type, suitable for the conditions of use and correctly installed.
- Unused apertures shall be closed with suitable flameproof certified blanking elements. (The plug attached is flameproof certified.)

(4) Operation

(Integral Flowmeter)



WARNING

- After de-energizing, delay 20 minutes before opening.
- Take care not to generate mechanical spark when access to the instrument and peripheral devices in hazardous locations.

8.2 FM

(1) Technical Data

*AXF002C – AXF400C

Applicable Standard:

FM3600, FM3610, FM3615,
FM3810, ANSI/NEMA 250

(Integral Flowmeter)

Explosion proof for Class I, Division 1, Groups A, B, C & D.

Dust-ignition proof for Class II/III, Division1, Groups E, F & G.

Intrinsically safe (electrodes) for Class I, Division 1, Groups A, B, C & D.

“SEAL ALL CONDUITS WITHIN 18 INCHES”

“WHEN INSTALLED IN DIV. 2, SEALS NOT REQUIRED”

Electrode Circuit Um: 250 Vac/dc

Maximum power supply voltage: 250 Vac/130 Vdc

Excitation Circuit: 140V max

Enclosure: NEMA 4X

Temperature Code: T6

Refer to following table;

| Temperature Code | Maximum Process Temperature | Minimum Process Temperature |
|------------------|-----------------------------|-----------------------------|
| T6 | +70°C (+158°F) | –40°C (–40°F) |
| T5 | +85°C (+185°F) | –40°C (–40°F) |
| T4 | +120°C (+248°F) | –40°C (–40°F) |
| T3 | +130°C (+266°F) | –40°C (–40°F) |

T27-1.EPS

Ambient Temp.: –40°C to +60°C (–40°F to +140°F)

(Remote Flowtube)

Explosion proof for Class I, Division 1, Groups A, B, C & D.

Dust-ignition proof for Class II/III, Division1, Groups E, F & G.

Intrinsically safe (electrodes) for Class I, Division 1, Groups A, B, C & D.

“SEAL ALL CONDUITS WITHIN 18 INCHES”

“WHEN INSTALLED IN DIV. 2, SEALS NOT REQUIRED”

Electrode Circuit Um: 250 Vac/dc

Excitation Circuit: 170V max

Enclosure: NEMA 4X

Temperature Code: T6

Refer to following table;

| Temperature Code | Maximum Process Temperature | Minimum Process Temperature |
|------------------|-----------------------------|-----------------------------|
| T6 | +70°C (+158°F) | –40°C (–40°F) |
| T5 | +85°C (+185°F) | –40°C (–40°F) |
| T4 | +120°C (+248°F) | –40°C (–40°F) |
| T3 | +150°C (+302°F) | –40°C (–40°F) |

T28-1_1.EPS

Ambient Temp.: –40°C to +60°C (–40°F to +140°F)

(2) Installation



WARNING

- All wiring shall comply with National Electrical Code ANSI/NFPA 70 and Local Electrical Code.
- In hazardous locations, wiring to be in conduit as shown in Figure 8.2.1.
- When installed in Division 2, “SEALS NOT REQUIRED”

(3) Operation



WARNING

- “OPEN CIRCUIT BEFORE REMOVING COVERS.”
- “SEALS ALL CONDUITS WITHIN 18 INCHES” in hazardous locations.
- When installed in Division 2, “SEALS NOT REQUIRED”
- Take care not to generate mechanical spark when access to the instrument and peripheral devices in hazardous locations.

(4) Maintenance and Repair



WARNING

The instrument modification or parts replacement by other than authorized representative of Yokogawa Electric Corporation is prohibited and will void the approval of Factory Mutual Research Corporation.

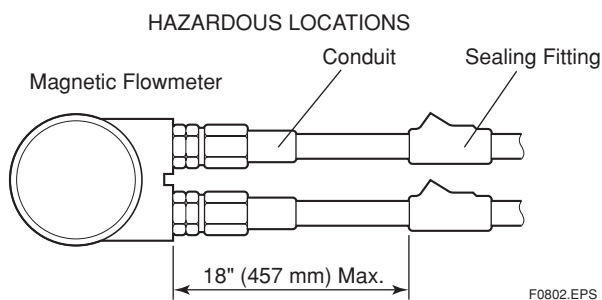


Figure 8.2.1 Conduit Wiring

8.3 CSA

(1) Technical Data

*AXF002C – AXF400C

Applicable Standard:

For CSA C22.2 Series;

C22.2 No 0, C22.2 No 0.4, C22.2 No 0.5,
C22.2 No 25, C22.2 No 30, C22.2 No 94,
C22.2 No 157, C22.2 No 1010.1

For CSA E79 Series;

CAN/CSA-E79-0, CAN/CSA-E79-1,
CAN/CSA-E79-7, CAN/CSA-E79-11,
CAN/CSA-E79-18

Certificate: 1481213

Process Sealing Certification:

Dual Seal certified by CSA to the requirements of
ANSI/ISA 12.27.01.

No additional sealing required.

Primary seal failure annunciation;

Deterioration of the flowrate output at nonzero
flow point.

Unstable flowrate output at zero flow point.

(Integral Flowmeter)

For CSA C22. 2 Series

Explosion proof for Class I, Division 1, Groups A,
B, C & D.

Dust-ignition proof for Class II/III, Division 1,
Groups E, F & G.

Intrinsically safe (electrodes) for Class I, Division 1,
Groups A, B, C & D.

“SEAL ALL CONDUITS WITHIN 50 cm OF THE
ENCLOSURE”

“WHEN INSTALLED IN DIV. 2, SEALS NOT
REQUIRED”

Electrode Circuit Um: 250 Vac/dc

Maximum power supply voltage: 250 Vac/130 Vdc

Excitation Circuit: 140V max

Enclosure: Type 4X

Temperature Code:

| Temperature Code | Maximum Process Temperature | Minimum Process Temperature |
|------------------|-----------------------------|-----------------------------|
| T6 | +70°C (+158°F) | –40°C (–40°F) |
| T5 | +85°C (+185°F) | –40°C (–40°F) |
| T4 | +120°C (+248°F) | –40°C (–40°F) |
| T3 | +130°C (+266°F) | –40°C (–40°F) |

T27-1.EPS

Ambient Temp.: –40°C to +60°C (–40°F to +140°F)

For CSA E79 Series

Flameproof for Zone 1, Ex dme [ia] IIC T6...T3

Intrinsically safe (electrodes), Ex ia IIC T6...T3

Electrode Circuit Um: 250 Vac/dc

Maximum power supply voltage: 250 Vac/130 Vdc

Excitation Circuit: 140V max

Enclosure: IP66, IP67

Temperature Code:

| Temperature Code | Maximum Process Temperature | Minimum Process Temperature |
|------------------|-----------------------------|-----------------------------|
| T6 | +70°C (+158°F) | –40°C (–40°F) |
| T5 | +85°C (+185°F) | –40°C (–40°F) |
| T4 | +120°C (+248°F) | –40°C (–40°F) |
| T3 | +130°C (+266°F) | –40°C (–40°F) |

T0807.EPS

Ambient Temp.: –40°C to +60°C (–40°F to +140°F)

(Remote Flowtube)

For CSA C22.2 Series

Explosion proof for Class I, Division 1, Groups A,
B, C & D.

Dust-ignition proof for Class II/III, Division 1,
Groups E, F & G.

Intrinsically safe (electrodes) for Class I, Division 1,
Groups A, B, C & D.

“SEAL ALL CONDUITS WITHIN 50 cm OF THE
ENCLOSURE”

“WHEN INSTALLED IN DIV. 2, SEALS NOT
REQUIRED”

Electrode Circuit Um: 250 Vac/dc

Excitation Circuit: 170V max

Enclosure: Type 4X

Temperature Code:

| Temperature Code | Maximum Process Temperature | Minimum Process Temperature |
|------------------|-----------------------------|-----------------------------|
| T6 | +70°C (+158°F) | –40°C (–40°F) |
| T5 | +85°C (+185°F) | –40°C (–40°F) |
| T4 | +120°C (+248°F) | –40°C (–40°F) |
| T3 | +150°C (+302°F) | –40°C (–40°F) |

T28-1.EPS

Ambient Temp.: –40°C to +60°C (–40°F to +140°F)

For CSA E79 Series

Flameproof for Zone 1, Ex dme [ia] IIC T6...T3

Intrinsically safe (electrodes), Ex ia IIC T6...T3

Electrode Circuit Um: 250 Vac/dc

Excitation Circuit: 170V max

Enclosure: IP66, IP67

Temperature Code:

| Temperature Code | Maximum Process Temperature | Minimum Process Temperature |
|------------------|-----------------------------|-----------------------------|
| T6 | +70°C (+158°F) | −40°C (−40°F) |
| T5 | +85°C (+185°F) | −40°C (−40°F) |
| T4 | +120°C (+248°F) | −40°C (−40°F) |
| T3 | +150°C (+302°F) | −40°C (−40°F) |

T0808.EPS

Ambient Temp.: −40°C to +60°C (−40°F to +140°F)

(2) Installation

For CSA C22.2 Series



WARNING

- All wiring shall comply with Canadian Electrical Code Part I and Local Electrical Codes.
- In hazardous location, wiring shall be in conduit as shown in Figure 8.3.1.

WARNING : SEAL ALL CONDUITS WITHIN 50cm OF THE ENCLOSURE'.
UN SCELLEMENT DOIT ÊTRE INSTALLÉ À MOINS DE 50cm DU BOÎTIER.

- When installed in Division 2, "SEALS NOT REQUIRED"

For CSA E79 Series



WARNING

- All wiring shall comply with local installation requirements and local electrical code.
- In hazardous locations, the cable entry devices shall be of a certified flameproof type, suitable for the conditions of use and correctly installed.
- Unused apertures shall be closed with suitable flameproof certified blanking elements. (The plug attached is flameproof certified.)

(3) Operation

For CSA C22.2 Series



WARNING

WARNING : OPEN CIRCUIT BEFORE REMOVING COVER.

OUVRIR LE CIRCUIT AVANT D'ENLEVER LE COUVERCLE.

- Take care not to generate mechanical spark when access to the instrument and peripheral devices in hazardous locations.

For CSA E79 Series

(Integral Flowmeter)



WARNING

WARNING : AFTER DE-ENERGIZING, DELAY 20 MINUTES BEFORE OPENING.
APRÉS POWER-OFF, ATTENDRE 20 MINUTES AVANT D'OUVRIER.

- Take care not to generate mechanical spark when access to the instrument and peripheral devices in hazardous locations.

(Remote Flowtube)



WARNING

WARNING : DE-ENERGIZE BEFORE OPENING.

OUVRIR LE CIRCUIT AVANT D'ENLEVER LE COUVERCLE.


- Take care not to generate mechanical spark when access to the instrument and peripheral devices in hazardous locations.

(4) Maintenance and Repair



WARNING

The instrument modification or parts replacement by other than authorized representative of YOKOGAWA Electric Corporation or YOKOGAWA Corporation of AMERICA is prohibited and will void Canadian Standards Explosionproof Certification.

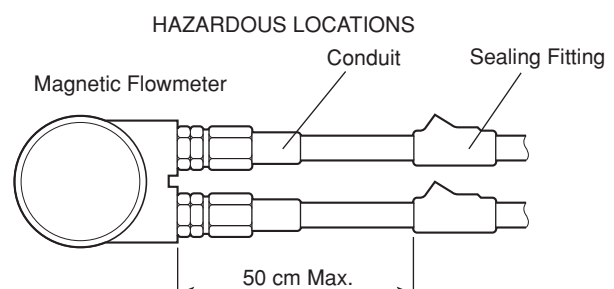

F0803.EPS

Figure 8.3.1 Conduit Wiring

8.4 IECEx



WARNING

Only trained persons use this instrument in industrial locations.

(1) Technical Data

*AXF002C – AXF400C

Applicable Standard:

IEC60079-0: 2004, IEC60079-1: 2003,
IEC60079-7: 2001, IEC60079-11: 1999,
IEC60079-18: 2004,
IEC61241-0: 2004, IEC61241-1: 2004,
IEC60529: 1999 + Edition 2.1: 2001

Certificate: IECEx KEM 05.0018

(Integral Flowmeter)

IECEx Flameproof Type

Ex demb[ia] IIC T6...T3

Electrode Circuit Um: 250 Vac/dc

Maximum power supply voltage: 250 Vac/130 Vdc

Excitation Circuit: 140V max

Enclosure: IP66, IP67

Temperature Class:

| Temperature Class | Process Temperature |
|-------------------|-----------------------------------|
| T6 | –40°C to +70°C (–40°F to +158°F) |
| T5 | –40°C to +85°C (–40°F to +185°F) |
| T4 | –40°C to +120°C (–40°F to +248°F) |
| T3 | –40°C to +130°C (–40°F to +266°F) |

T0809.EPS

Ambient Temp.:

PFA Lining; –40°C to +60°C (–40°F to +140°F)

Ceramics Lining; –15°C to +60°C (+5°F to +140°F)

IECEx Type of Protection "Dust"

Ex tD A21 IP6x T95°C, T105°C, T120°C, T130°C

Electrode Circuit Um: 250 Vac/dc

Maximum power supply voltage: 250 Vac/130 Vdc

Excitation Circuit: 140V max

Enclosure: IP66, IP67

Maximum surface temperature:

| Maximum Surface Temperature | Process Temperature |
|-----------------------------|-----------------------------------|
| T95°C (+203°F) | –40°C to +70°C (–40°F to +158°F) |
| T105°C (+221°F) | –40°C to +85°C (–40°F to +185°F) |
| T120°C (+248°F) | –40°C to +120°C (–40°F to +248°F) |
| T130°C (+266°F) | –40°C to +130°C (–40°F to +266°F) |

T0810.EPS

Ambient Temp.:

PFA Lining; –40°C to +60°C (–40°F to +140°F)

Ceramics Lining; –15°C to +60°C (+5°F to +140°F)

(Remote Flowtube)

IECEx Flameproof Type

Ex demb[ia] IIC T6...T3

Electrode Circuit Um: 250 Vac/dc

Excitation Circuit: 170V max

Enclosure: IP66, IP67

Temperature Class:

| Temperature Class | Process Temperature |
|-------------------|-----------------------------------|
| T6 | –40°C to +70°C (–40°F to +158°F) |
| T5 | –40°C to +85°C (–40°F to +185°F) |
| T4 | –40°C to +120°C (–40°F to +248°F) |
| T3 | –40°C to +150°C (–40°F to +302°F) |

T0811.EPS

Ambient Temp.:

PFA Lining; –40°C to +60°C (–40°F to +140°F)

Ceramics Lining; –15°C to +60°C (+5°F to +140°F)

IECEx Type of Protection "Dust"

Ex tD A21 IP6x T95°C, T105°C, T120°C, T135°C

Electrode Circuit Um: 250 Vac/dc

Excitation Circuit: 170V max

Enclosure: IP66, IP67

Maximum surface temperature:

| Maximum Surface Temperature | Process Temperature |
|-----------------------------|-----------------------------------|
| T95°C (+203°F) | –40°C to +70°C (–40°F to +158°F) |
| T105°C (+221°F) | –40°C to +85°C (–40°F to +185°F) |
| T120°C (+248°F) | –40°C to +120°C (–40°F to +248°F) |
| T135°C (+275°F) | –40°C to +150°C (–40°F to +302°F) |

T0812.EPS

Ambient Temp.:

PFA Lining; –40°C to +60°C (–40°F to +140°F)

Ceramics Lining; –15°C to +60°C (+5°F to +140°F)

(2) Installation



WARNING

- All wiring shall comply with local installation requirements and local electrical code.
- In hazardous locations, the cable entry devices shall be of a certified IECEx flameproof type, suitable for the conditions of use and correctly installed.
- Unused apertures shall be closed with suitable flameproof certified blanking elements. (The plug attached is certified as the flameproof and IP66 or IP67 as a part of this apparatus.)
- In case of ANSI 1/2 NPT plug, ANSI hexagonal wrench should be applied to screw in.

(3) Operation**(Integral Flowmeter)****WARNING**

- After de-energizing, delay 20 minutes before opening.
- Take care not to generate mechanical spark when access to the instrument and peripheral devices in hazardous locations.

(Remote Flowtube)**WARNING**

- De-energize before opening.
- Take care not to generate mechanical spark when access to the instrument and peripheral devices in hazardous locations.

(4) Maintenance and Repair**WARNING**

The instrument modification or parts replacement by other than authorized representative of Yokogawa Electric Corporation is prohibited and will void the certification.

8.5 TIIS**CAUTION**

The model AXF□□□C magnetic flowmeter with optional code JF3, which has obtained certification according to technical criteria for explosion-protected construction of electric machinery and equipment (Standards Notification No. 556 from the Japanese Ministry of Labor) conforming to IEC standards, is designed for hazardous areas where inflammable gases or vapors may be present. (This allows installation in Division 1 and 2 areas)

To preserve the safety of flameproof equipment requires great care during mounting, wiring, and piping. Safety requirements also place restrictions on maintenance and repair activities. Users absolutely must read “INSTALLATION AND OPERATING PRECAUTIONS FOR TIIS FLAMEPROOF EQUIPMENT” at the end of this manual.

(1) Technical Data

Certificate:

Wafer Type;

| Lining / Process Connection code Size: mm (inch) | Integral Flowmeter | | Remote Flowtube | |
|--|--------------------|--------------------|-----------------|--------------------|
| | PFA Lining | Ceramics Lining | PFA Lining | Ceramics Lining |
| | -A** | -A** | -A** | -A** |
| 2.5 (0.1) | TC18966 | TC16645 | TC18982 | TC16669 |
| 5 (0.2) | TC18966 | TC16645 | TC18982 | TC16669 |
| 10 (0.4) | TC18966 | TC16645 | TC18982 | TC16669 |
| 15 (0.5) | TC18966 | TC16646 | TC18982 | TC16670 |
| 25 (1.0) (Lay length code 1) | TC16631 | TC16647 | TC16655 | TC16671 |
| 25 (1.0) (Lay length code 2) | TC18967 | — | TC18983 | — |
| 32 (1.25) | TC16632 | — | TC16656 | — |
| 40 (1.5) | TC16633 | TC16648 | TC16657 | TC16672 |
| 50 (2.0) | TC16634 | TC16649 | TC16658 | TC16673 |
| 65 (2.5) | TC16635 | — | TC16659 | — |
| 80 (3.0) | TC16636 | TC18978 | TC16660 | TC18994 |
| 100 (4.0) | TC16637 | TC18979 | TC16661 | TC18995 |
| 125 (5.0) | TC16638 | — | TC16662 | — |
| 150 (6.0) | TC18968 | TC18980 | TC18984 | TC18996 |
| 200 (8.0) | TC18970 | TC18981 | TC18986 | TC18997 |
| 250 (10) | TC18972 | — | TC18988 | — |
| 300 (12) | TC18974 | — | TC18990 | — |
| 350 (14) | — | — | — | — |
| 400 (16) | — | — | — | — |

T33-1.EPS

Flange Type (PFA lining only);

| Lining / Process Connection code Size: mm (inch) | Integral Flowmeter | Remote Flowtube |
|--|--------------------|-----------------|
| | PFA Lining | PFA Lining |
| | -B**, -D | -B**, -D** |
| 2.5 (0.1) | TC18966 | TC18982 |
| 5 (0.2) | TC18966 | TC18982 |
| 10 (0.4) | TC18966 | TC18982 |
| 15 (0.5) | TC18966 | TC18982 |
| 25 (1.0) | TC16631 | TC16655 |
| 32 (1.25) | TC16632 | TC16656 |
| 40 (1.5) | TC16633 | TC16657 |
| 50 (2.0) | TC16634 | TC16658 |
| 65 (2.5) | TC16635 | TC16659 |
| 80 (3.0) | TC16636 | TC16660 |
| 100 (4.0) | TC16637 | TC16661 |
| 125 (5.0) | TC16638 | TC16662 |
| 150 (6.0) | TC18969 | TC18985 |
| 200 (8.0) | TC18971 | TC18987 |
| 250 (10) | TC18973 | TC18989 |
| 300 (12) | TC18975 | TC18991 |
| 350 (14) | TC18976 | TC18992 |
| 400 (16) | TC18977 | TC18993 |

T33-2.EPS

(Integral Flowmeter)

- Construction: Ex de[ia] IIC T4
: Converter ; Explosion proof
Flowtube ; Increased Safety and
Intrinsically Safety(ia)
Electrode ; Intrinsically Safety(ia)
Um=250VAC 50/60Hz, 250VDC,

$$U_o=250V^*, I_o=3.37mA^*, P_o=0.211W$$

* U_o and I_o are rms value.

- Ignition and Explosion Class of gas or vapour: IIC T4
- Ambient Temperature: -20 to 60°C (power supply code 1)
: -20 to 50°C (power supply code 2)
- Fluid Temperature: 120°C max
- Electrode Circuit: 250 V AC/DC
- Maximum power supply voltage: 250V AC/130V DC
- Grounding: JIS Class C(grounding resistance 10Ω or less) or JIS Class A(grounding resistance 10Ω or less)

**WARNING**

In case that ambient temperature exceeds 50°C, use heat-resistant cables with maximum allowable temperature of 70°C or above.

(Remote Flowtube)

- Construction: Ex de[ia] IIC T4
: Terminal box ; Explosion proof
Flowtube; Increased Safety and
Intrinsically Safety(ia)
Electrode; Intrinsically Safety(ia)
 $U_m=250VAC$ 50/60Hz, 250VDC,
 $U_o=250V^*, I_o=3.37mA^*, P_o=0.211W$
* U_o and I_o are rms value.
- Ignition and Explosion class of gas or vapour: IIC T4
- Ambient Temperature: -20 to 60°C
- Fluid Temperature: 120°C max
- Electrode Circuit: 250 V AC/DC
- Grounding: JIS Class C(grounding resistance 10Ω or less) or JIS Class A(grounding resistance 10Ω or less)

**WARNING**

* In case of T1IS Flameproof type, a remote flowtube is available for combined use with the AXFA14 only.

**WARNING**

In case that ambient temperature exceeds 50°C, use heat-resistant cables with maximum allowable temperature of 70°C or above.

(2) Wiring Installation


For the external wiring of flameproof types, use a flameproof packing adapter approved by Yokogawa (refer to Figure 8.4.2) or cable wiring using a flameproof metal conduit (refer to Figure 8.4.4 and "INSTALLATION AND OPERATING PRECAUTIONS FOR T1IS FLAMEPROOF EQUIPMENT" at the end of this manual).

**NOTE**

This section describes the remote flowmeter as an example. The same attention must be paid to the integral flowmeter.

(2-1) Wiring Cable through Flameproof Packing Adapter**WARNING**

For the T1IS flameproof type with wiring using a flameproof packing adapter, wire cables through the packing adapters approved by Yokogawa (optional code G12 or G11).

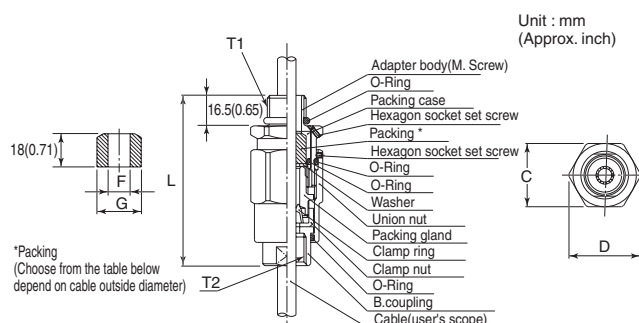

| Dimension | | | | | Cable outer diameter | | Packing diameter | | Identification mark | Weight kg (lb) |
|-----------|-------|--------------|--------------|----------------|----------------------|----------------|------------------|--------|---------------------|----------------|
| T1 | T2 | C | D | L | | | F | G | | |
| G 1/2 | G 1/2 | 35 (1.38) | 39 (1.54) | 94.5 (3.72) | φ8.0 to φ10.0 | (0.31 to 0.39) | φ10.0(0.39) | φ20.0 | 16 8-10 | 0.26 |
| | | | | | φ10.0 to φ12.0 | (0.39 to 0.47) | φ12.0(0.47) | (0.79) | 16 10-12 | (0.57) |

F0809.EPS

Figure 8.4.1 Flameproof Packing Adapter

- Apply a nonhardening sealant to the terminal box connection port and to the threads on the flameproof packing adapter for waterproofing.
- The same wiring as described below is required for both of the terminal box connection ports except when a four-wire cable is used for power input and signal output with DC power supply in the Integral flowmeter.

8. EXPLOSION PROTECTED TYPE INSTRUMENT

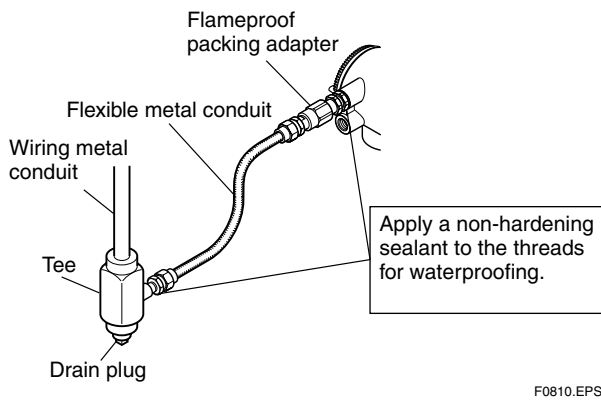


Figure 8.4.2 Typical Wiring Using Flexible Metal Conduit

Follow the procedure for flameproof packing adapter setting. (refer to Figure 8.4.3)



CAUTION

Before fighting, confirm cable length from terminal to flameproof packing adapter when setting. Once it is tightened, loosening and re-tightening may damage its sealing performance.

- (a) Loosen the locking screw and remove the terminal box cover.
- (b) Measure the cable outer diameter in two directions to within 0.1 mm.
- (c) Calculate the average of the two diameters, and use packing with an internal diameter nearest to this value (see the table of Figure 8.4.1).
- (d) Screw the flameproof packing adapter into the terminal box until the O-ring touches the wiring port (at least 6 full turns), and firmly tighten the lock nut.
- (e) Insert the cable through the union cover, the union coupling, the clamp nut, the clamp ring, the gland, the washer, the rubber packing, and the packing box, in that order.
- (f) Insert the end of the cable into the terminal box.
- (g) Tighten the union cover to grip the cable. When tightening the union cover, tighten approximately one turn past the point where the cable will no longer move up and down.
Proper tightening is important. If it is too tight, a circuit break in the cable may occur; if not tight enough, the flameproof effectiveness will be compromised.
- (h) Fasten the cable by tightening the clamp nut.
- (i) Tighten the lock nut on the union cover.
- (j) Connect the cable wires to each terminal.

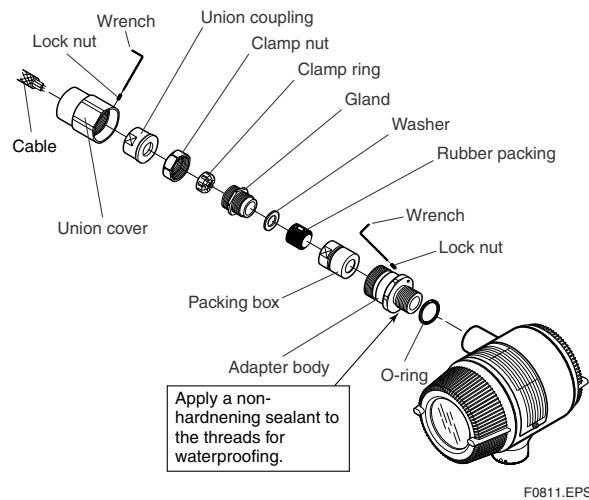


Figure 8.4.3 Installing Flameproof Packing Adapter

(2-2) Cable Wiring Using Flameproof Metal Conduit

- A seal fitting must be installed near the terminal box connection port for a sealed construction.
- Apply a non-hardening sealant to the threads of the terminal box connection port, flexible metal conduit and seal fitting for waterproofing.
- The same wiring as described below is required for both of the terminal box connection ports except when a four-wire cable is used for power input and signal output with DC power supply in the Integral flowmeter.

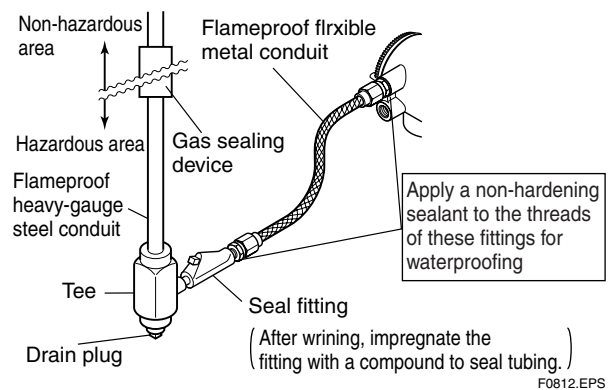


Figure 8.4.4 Typical Wiring Using Flameproof Metal Conduit

INSTALLATION AND OPERATING PRECAUTIONS FOR TIIS FLAMEPROOF EQUIPMENT

Apparatus Certified Under Technical Criteria (IEC-compatible Standards)

1. General

The following describes precautions on electrical apparatus of flameproof construction (hereinafter referred to as flameproof apparatus) in explosion-protected apparatus.

Following the Labour Safety and Health Laws of Japan, flameproof apparatus is subjected to type tests to meet either the technical criteria for explosionproof electrical machinery and equipment (standards notification no. 556 from the Japanese Ministry of Labour) (hereinafter referred to as technical criteria), in conformity with the IEC Standards, or the “Recommended Practice for Explosion-Protected Electrical Installations in General Industries,” published in 1979. These certified apparatus can be used in hazardous locations where explosive or inflammable gases or vapours may be present.

Certified apparatus includes a certification label and an equipment nameplate with the specifications necessary for explosion requirements as well as precautions on explosion protection. Please confirm these precautionary items and use them to meet specification requirements.

For electrical wiring and maintenance servicing, please refer to “Internal Wiring Rules” in the Electrical Installation Technical Standards as well as “USER’S GUIDELINES for Electrical Installations for Explosive Gas Atmospheres in General Industry,” published in 1994.

To meet flameproof requirements, equipment that can be termed “flameproof” must:

- (1) Be certified by a Japanese public authority in accordance with the Labour Safety and Health Laws of Japan and have a certification label in an appropriate location on its case, and
- (2) Be used in compliance with the specifications marked on its certification label, equipment nameplate and precautionary information furnished.

2. Electrical Apparatus of Flameproof Type of Explosion-Protected Construction

Electrical apparatus which is of flameproof construction is subjected to a type test and certified by the Japanese Ministry of Labour aiming at preventing explosion caused by electrical apparatus in a factory or any location where inflammable

gases or vapours may be present. The flameproof construction is of completely enclosed type and its enclosure shall endure explosive pressures in cases where explosive gases or vapours entering the enclosure cause explosion. In addition, the enclosure construction shall be such that flame caused by explosion does not ignite gases or vapours outside the enclosure.

In this manual, the word “flameproof” is applied to the flameproof equipment combined with the types of protection “e”, “o”, “i”, and “d” as well as flameproof equipment.

3. Terminology

(1) Enclosure

An outer shell of an electrical apparatus, which encloses live parts and thus is needed to configure explosion-protected construction.

(2) Shroud

A component part which is so designed that the fastening of joint surfaces cannot be loosened unless a special tool is used.

(3) Enclosure internal volume

This is indicated by:— the total internal volume of the flameproof enclosure minus the volume of the internal components essential to equipment functions.

(4) Path length of joint surface

On a joint surface, the length of the shortest path through which flame flows from the inside to outside of the flameproof enclosure. This definition cannot be applied to threaded joints.

(5) Gaps between joint surfaces

The physical distance between two mating surfaces, or differences in diameters if the mating surfaces are cylindrical.

Note: The permissible sizes of gaps between joint surfaces, the path length of a joint surface and the number of joint threads are determined by such factors as the enclosure’s internal volume, joint and mating surface construction, and the explosion classification of the specified gases and vapours.

4. Installation of Flameproof Apparatus

(1) Installation Area

Flameproof apparatus may be installed, in accordance with applicable gases, in a hazardous area in Zone 1 or 2, where the specified gases are present. Those apparatus shall not be installed in a hazardous area in Zone 0.

Note: Hazardous areas are classified in zones based upon the frequency of the appearance and the duration of an explosive gas atmosphere as follows:

Zone 0: An area in which an explosive gas atmosphere is present continuously or is present for long periods.

Zone 1: An area in which an explosive gas atmosphere is likely to occur in normal operation.

Zone 2: An area in which an explosive gas atmosphere is not likely to occur in normal operation and if it does occur it will exist for a short period only.

(2) Environmental Conditions

The standard environmental condition for the installation of flameproof apparatus is limited to an ambient temperature range from -20°C to $+40^{\circ}\text{C}$ (for products certified under Technical Criteria). However, some field-mounted instruments may be certified at an ambient temperature up to $+60^{\circ}\text{C}$ as indicated on the instrument nameplates. If the flameproof apparatus are exposed to direct sunshine or radiant heat from plant facilities, appropriate thermal protection measures shall be taken.

5. External Wiring for Flameproof Apparatus

Flameproof apparatus require cable wiring or flameproof metal conduits for their electrical connections. For cable wiring, cable glands (cable entry devices for flameproof type) to wiring connections shall be attached. For metal conduits, attach sealing fittings as close to wiring connections as possible and completely seal the apparatus. All non-live metal parts such as the enclosure shall be securely grounded. For details, see the “USER’S GUIDELINES for Electrical Installations for Explosive Gas Atmospheres in General Industry,” published in 1994.

(1) Cable Wiring

- For cable wiring, cable glands (cable entry devices for flameproof type) specified or supplied with the apparatus shall be directly attached to the wiring connections to complete sealing of the apparatus.
- Screws that connect cable glands to the apparatus are those for G-type parallel pipe threads (JIS B 0202) with no sealing property. To protect the apparatus from corrosive gases or moisture, apply nonhardening sealant such as liquid gaskets to those threads for waterproofing.
- Specific cables shall be used as recommended by the “USER’S GUIDELINES for Electrical Installations for Explosive Gas Atmospheres in General Industry,” published in 1994.
- In necessary, appropriate protective pipes (conduit or flexible pipes), ducts or trays shall be used for preventing the cable run (outside the cable glands) from damage.
- To prevent explosive atmosphere from being propagated from Zone 1 or 2 hazardous location to any different location or non-hazardous location through the protective pipe or duct, apply sealing of the protective pipes in the vicinity of individual boundaries, or fill the ducts with sand appropriately.
- When branch connections of cables, or cable connections with insulated cables inside the conduit pipes are made, a flameproof or increased-safety connection box shall be used. In this case, flameproof or increased-safety cable glands meeting the type of connection box must be used for cable connections to the box.

(2) Flameproof Metal Conduit Wiring

- For the flameproof metal conduit wiring or insulated wires shall be used as recommended by the USER’S GUIDELINES for Electrical Installations for Explosive Gas Atmospheres in General Industry, published in 1994.
- For conduit pipes, heavy-gauge steel conduits conforming to JIS C 8305 Standard shall be used.
- Flameproof sealing fittings shall be used in the vicinity of the wiring connections, and those fittings shall be filled with sealing compounds to complete sealing of the apparatus. In addition, to prevent explosive gases, moisture, or flame caused by explosion from being propagated through the conduit, always provide sealing fittings to complete sealing of the conduit in the following locations:
 - (a) In the boundaries between the hazardous and non-hazardous locations.
 - (b) In the boundaries where there is a different classification of hazardous location.
- For the connections of the apparatus with a conduit pipe or its associated accessories, G-type parallel pipe threads (JIS B 0202) shall be used to provide a minimum of five-thread engagement to complete tightness. In addition, since these parallel threads do not have sealing property, nonhardening sealant such as liquid gaskets shall thus be applied to those threads for ensuring waterproofness.
- If metal conduits need flexibility, use flameproof flexible fittings.

6. Maintenance of Flameproof Apparatus

To maintain the flameproof apparatus, do the following. (For details, see Chapter 10 “MAINTENANCE OF EXPLOSION-PROTECTED ELECTRICAL INSTALLATION” in the USER’S GUIDELINES for Electrical Installations for Explosive Gas Atmospheres in General Industry.)

(1) Maintenance servicing with the power on.

Flameproof apparatus shall not be maintenance-serviced with its power turned on. However, in cases where maintenance servicing is to be conducted with the power turned on, with the equipment cover removed, always use a gas detector to check that there is no explosive gas in that location. If it cannot be checked whether an explosive gas is present or not, maintenance servicing shall be limited to the following two items:

- (a) Visual inspection
Visually inspect the flameproof apparatus, metal conduits, and cables for damage or corrosion, and other mechanical and structural defects.
- (b) Zero and span adjustments
These adjustments should be made only to the extent that they can be conducted from the outside without opening the equipment cover. In doing this, great care must be taken not to cause mechanical sparks with tools.

(2) Repair

If the flameproof apparatus requires repair, turn off the power and transport it to a safety (non-hazardous) location. Observe the following points before attempting to repair the apparatus.

- (a) Make only such electrical and mechanical repairs as will restore the apparatus to its original condition. For the flameproof apparatus, the gaps and path lengths of joints and mating surfaces, and mechanical strength of enclosures are critical factors in explosion protection. Exercise great care not to damage the joints or shock the enclosure.
- (b) If any damage occurs in threads, joints or mating surfaces, inspection windows, connections between the transmitter and terminal box, shrouds or clamps, or external wiring connections which are essential in flameproofness, contact Yokogawa Electric Corporation.



CAUTION

Do not attempt to re-process threaded connections or refinish joints or mating surfaces.

- (c) Unless otherwise specified, the electrical circuitry and internal mechanisms may be repaired by component replacement, as this will not directly affect the

requirements for flameproof apparatus (however, bear in mind that the apparatus must always be restored to its original condition). If you attempt to repair the flameproof apparatus, company-specified components shall be used.

- (d) Before starting to service the apparatus, be sure to check all parts necessary for retaining the requirements for flameproof apparatus. For this, check that all screws, bolts, nuts, and threaded connections have properly been tightened.

(3) Prohibition of specification changes and modifications

Do not attempt to change specifications or make modifications involving addition of or changes in external wiring connections.

7. Selection of Cable Entry Devices for Flameproof Type



CAUTION

The cable glands (cable entry devices for flameproof type) conforming to IEC Standards are certified in combination with the flameproof apparatus. So, Yokogawa-specified cable entry devices for flameproof type shall be used to meet this demand.

References:

- (1) Type Certificate Guide for Explosion-Protected Construction Electrical Machinery and Equipment (relating to Technical Standards Conforming to International Standards), issued by the Technical Institution of Industrial Safety, Japan
- (2) USER’S GUIDELINES for Electrical Installations for Explosive Gas Atmospheres in General Industry (1994), issued by the Japanese Ministry of Labour, the Research Institute of Industrial Safety

REVISION RECORD

Title: AXF Magnetic Flowmeter Integral Flowmeter/Remote Flowtube
[Hardware Edition]
Manual No.: IM 01E20D01-01E

| Edition | Date | Page | Revised Item |
|---------|-----------|--|--|
| 6th | Oct. 2005 | 3-22 to 3-24 5-1 5-5 6-7 6-12 6-14 6-21 to 6-27 6-28 6-29 6-31 6-39 6-40 6-48 8-7 to 8-8 | (7) Added the "Confirmation of adapter mounting screw" Added the sentence. Added the note of installation Added the note of permeable fluids to the grounding ring/grounding electrode. Added the "IECEX" to the hazardous area classification. Added the "SF2 (IECEX)" to the withstand voltage. Changed the note for wetted parts material. MU Changed description of the "mass unit setting (MU)". PM Changed the value of the mirror finished PFA lining (PM). Changed from "Ra 0.05 to 0.15 μ m" to "Size 15 to 200 mm : Ra 0.05 to 0.15 μ m, Size 250 to 400 mm : Ra 0.05 to 0.25 μ m" SF2 Added the "IECEX Certification (SF2)" to the optional specifications. Corrected the "Weight kg (lb)" of BD4. Corrected the "Weight kg (lb)" of BJ1/CJ1, BJ2/CJ2 and BG1/CG1. Corrected the "Inner diameter of grounding ring (ϕ d)" of size 250mm. 8.5 Added the "IECEX". |
| 7th | June 2006 | 1-1 3-11 3-12 3-13 3-16 3-17 3-18 3-22 3-23 3-24 4-3 4-6 4-13 5-5 5-8 5-9 5-10 6-1, 14, 20, 28 6-7 6-17 to 20 6-21 to 6-23 6-25 to 6-27 6-34 to 6-48 | Added the postscript about FOUNDATION Fieldbus protocol type. Table 3.3.7 Changed the Torque Value. Table 3.3.8 Changed the Torque Value. Table 3.3.9 Changed the Torque Value. Table 3.3.14 Changed the Torque Value. Table 3.3.15 Changed the Torque Value. Table 3.3.16 Changed the Torque Value. 5) Added the sentence. 5) Added the sentence. 5) Added the sentence. Changed the Figure 3.3.10. (2) Added the postscript about FOUNDATION Fieldbus protocol type. (6) Added the postscript about FOUNDATION Fieldbus protocol type. 1), 2) Added the "IECEX". 5.3 Added the CAUTION. Changed the Figure 5.3.1. 5.4.3 Added the postscript about FOUNDATION Fieldbus protocol type. 5.5.1 Added the postscript about FOUNDATION Fieldbus protocol type. 5.5.2 Added the postscript about FOUNDATION Fieldbus protocol type. Added the postscript about FOUNDATION Fieldbus protocol type. Corrected from "SPCC" to "SS400" in Housing of size 500 mm to 2600 mm Corrected the value of Pressure on figure. Added the "-F" (FOUNDATION Fieldbus protocol). Added the "-F" (FOUNDATION Fieldbus protocol). Added the postscript about FOUNDATION Fieldbus protocol type. |

| Edition | Date | Page | Revised Item |
|---------|-----------|--|--|
| 8th | Apr. 2007 | 1-2 1-5 4-3, 4-10 4-4 5-1 5-7 5-7 to 5-8 5-8 5-9 6-1 6-13 6-15 6-16 6-17 6-28 6-29 6-30 6-31 8-8 | (4) Changed the warning note of "Maintenance". 1.4 Added the ATEX documentation. 4.3 Added the important note for the wiring ports. (4) Added the important note for a 24 V power supply version (power supply code 2). 2) Corrected the graph of "Supply Voltage and Cable Length". 5 Changed the warning note of "Maintenance". 5.4 Changed the warning note and important note of "Maintenance". 5.4.1 Changed the caution note of "Fuse Replacement". Deleted the Figure 5.4.1. 5.4.2 Changed the content of section "Display Unit Replacement" to "Changing the Direction of the Display Unit". 5.4.3 Deleted the section "Amplifier Replacement". 5.5 Added the important note for "Setting of Switches". Deleted the "Communication Distance" and "Cable length for Specific Applications" from item of "HART". Changed the certificate number of TIIS. Corrected the graph of "Supply Power and Cable Length for Power Supply Code 2". Corrected the value of span flow rate of size 32 mm. Corrected the value of span flow rate of size 1.25 inch and size 36 inch. Added the note to optional codes C1, C2, C3, EM, and G13. Changed the gasket part number of manufacturer for optional code GC. Changed the descriptive text of HF1. Corrected the value of span flow rate of size 32 mm. Added the note to optional codes C1, C2, C3, EM, and G13. 8.5 (1) Changed the certificate number of TIIS. |
| 9th | Jan. 2008 | 1-1 1-2 4-3 4-6 5-11 6-1 6-7 6-15 6-19 6-21 to 6-32 6-33 to 6-36 6-39 to 6-53 | Added the postscript about PROFIBUS PA protocol type. 1.1 Added the warning note on "write protect". 4.1.4 (2) Added the postscript about PROFIBUS PA protocol type. Added the postscript about PROFIBUS PA protocol type. 5.8.1 Changed the flow chart. Added the postscript about PROFIBUS PA protocol type. Corrected the frequency of "Input Impedance of Communicating Device". Changed the material of housing from "Carbon steel-JIS SPCC" to "Carbon steel-JIS SPCC equivalent". Corrected from "EN1.4404 equivalent" to "EN1.4401 equivalent" in grounding ring of size 1100mm to 2600mm. Added the CAUTION to "EMC Conformity Standard". Changed the note of "Fluid Conductivity". Changed the unit of "Vibration Conditions" from "G" to "m/s ² ". Added the "-G" (PROFIBUS PA protocol). Added the note of process connection code. Added the note of calibration code C. Added the applicable size for the electrode material code W. Added the code F and G to item name. Changed the value of mirror finished ceramics for optional code CM. Added the code G. |

| Edition | Date | Page | Revised Item |
|---------|-----------|--------------|--|
| 10th | June 2012 | 1-3 | Added the "Trademarks". |
| | | 2-1 | 2.2 Deleted the fuse from item of accessories. |
| | | 3-1 | 3.1(3) Added the sentence. Changed ths sentence of *3. |
| | | 3-4 | 3.3 Added the important note. |
| | | 3-14 | Changed the table 3.3.13. |
| | | 3-22 | 3.1 Added the table 3.3.20 (Sanitary Adapter Identification). |
| | | 4-2 | 4.1.3 Deleted the sentence of JIS C0920 standard. 4.1.3 (2) Corrected the Figure 4.1.1 and added the a washer. Corrected the Figure 4.1.3 and added the a gasket. |
| | | 4-6 | Corrected the current range of Figure 4.1.12. |
| | | 4-10 | 4.2.3 Deleted the sentence of JIS C0920 standard. Corrected the Figure 4.2.4 and added a washer. Corrected the Figure 4.2.6 and added a gasket. |
| | | 5-7 | 5.4.1 Changed the caution note. |
| | | 6-1 | 6 Added the descriptive text for Converter. Corrected the communication distance and the value of maximum load resistance of BRAIN. Changed the value of minimum load resistance of HART. Deleted the type by JIS C0920 of protection. Changed the kind of coating. |
| | | 6-2 | Corrected item names of instantaneous flow rate/totalized value display functions. Added the default value of damping time constant. |
| | | 6-5 | Deleted the type by JIS C0920 of protection. Changed the kind of coating. |
| | | 6-6 to 6-8 | Changed the housing material in size 2.5 mm to 15 mm from "Stainless steel-JIS SCS11" to "Stainless steel-JIS SCS11 equivalent". Changed the flange material and mini-flange material in size 25 mm to 2600 mm from "Carbon steel-JIS SS400" to "Carbon steel-JIS SS400 or SFVC 2A". Changed the housing material in size 500 to 2600 mm from "Carbon steel-JIS SS400" to "Carbon steel-JIS SS400 equivalent". Changed the material for Adapters (clamp, union, butt weld) of Sanitary Type from "Stainless steel-JIS SUS316L" to "Stainless steel-JIS SUS316L or SUSF316L". Moved the item of Recommended Gaskets Between Flowtubes And User's Flanges from P6-53. Added the Gaskets Size. |
| | | 6-9 | Abbreviated the HAZARDOUS AREA CLASSIFICATION. |
| | | 6-11 | Changed the definition of accuracy. |
| | | 6-13 | Changed the numbers of EMC conformity standards. Changed the note of Fluid Conductivity. |
| | | 6-14 | Changed the English Units of Measurable Flow Rate Range. |
| | | 6-16 | Corrected the temperatures of note for General-Purpose Use, Integral Flowmeter. |
| | | 6-18 to 6-28 | Changed the figures of Ceramics Lining. Deleted the fuse from item of accessories. |
| | | 6-21, 6-27 | Changed the standardized number on note, from "JIS G 3451" to "JIS G 3443-2". |
| | | 6-29 | Changed the material for process connection adapters of Sanitary Type from "JIS SUS316L" to "JIS SUS316L or SUSF316L". Changed the applicable model of carbon steel flange. |
| | | 6-30 | Corrected the current range of /EM. |
| | | 6-31 | Corrected the sentence of /MU. |
| | | 6-32 | Added the descriptive text for Special Gaskets. Added the "union joint" to /M01 Changed the selectable range of flow rate span for optional code "SC". Added the "Dual Seal" to Specifications of "CSA Certifications (CF1)". Added notes for Bolts, Nuts, and Gaskets. Added the Singapore and India to applicable sales area of IECEx explosion proof. |

| | | | |
|--|--|------|---|
| | | 6-33 | Corrected the sentence of /MU. |
| | | 6-34 | Changed the selectable range of flow rate span for optional code "SC". |
| | | 6-43 | Corrected the figure. |
| | | 6-49 | Corrected the value of ød of CG1. |
| | | 6-53 | Moved the item of Recommended Gaskets Between Flowtubes And User's Flanges to P6-8. |
| | | 8-1 | Added the year to applicable standard numbers of CENELEC ATEX. |
| | | 8-5 | Added the "Process Sealing Certification". |
| | | 8-8 | Changed the certificate numbers of TIIS Flameproof. |